



COMMISSION OF ARCHITECTURAL REVIEW

APPLICATION / CERTIFICATE OF APPROPRIATENESS

PROPERTY (Location of Work)

Address 3625 E BROAD St.

Historic District Chimborazo

PROPOSED ACTION

- Alteration (including paint colors)
- Addition
- Rehabilitation
- New Construction (Conceptual Review required)
- Demolition
- Conceptual Review
- Final Review

OWNER

Name Jason Moneymaker
 Company Moneymaker Properties
 Mailing Address 5217 Monument Ave.
Richmond VA 23226
 Phone 804-943-5327
 Email jmoneymaker@moneybuyshomes.com
 Signature [Signature]
 Date 4-10-17

APPLICANT (if other than owner)

Name _____
 Company _____
 Mailing Address _____
 Phone _____
 Email _____
 Signature _____
 Date _____

ACKNOWLEDGEMENT OF RESPONSIBILITY

Requirements: A complete application includes all applicable information requested on checklists to provide a complete and accurate description of existing and proposed conditions. Preliminary review meeting or site visit with staff may be necessary to process the application. Owner contact information and signature is required. Late or incomplete applications will not be considered.

Zoning Requirements: Prior to CAR review, it is the responsibility of the applicant to determine if zoning approval is required and application materials should be prepared in compliance with zoning.

Compliance: If granted, you agree to comply with all conditions of the COA. Revisions to approved work require staff review and may require a new application and CAR approval. Failure to comply with the COA may result in project delays or legal action. The COA is valid for one (1) year and may be extended for an additional year, upon written request.

ECE VED

(Space below for staff use only)


APR 10 2017

Application received:

Date/Time 4/10/17 11:5 am

Complete Yes No

By C. J. [Signature]

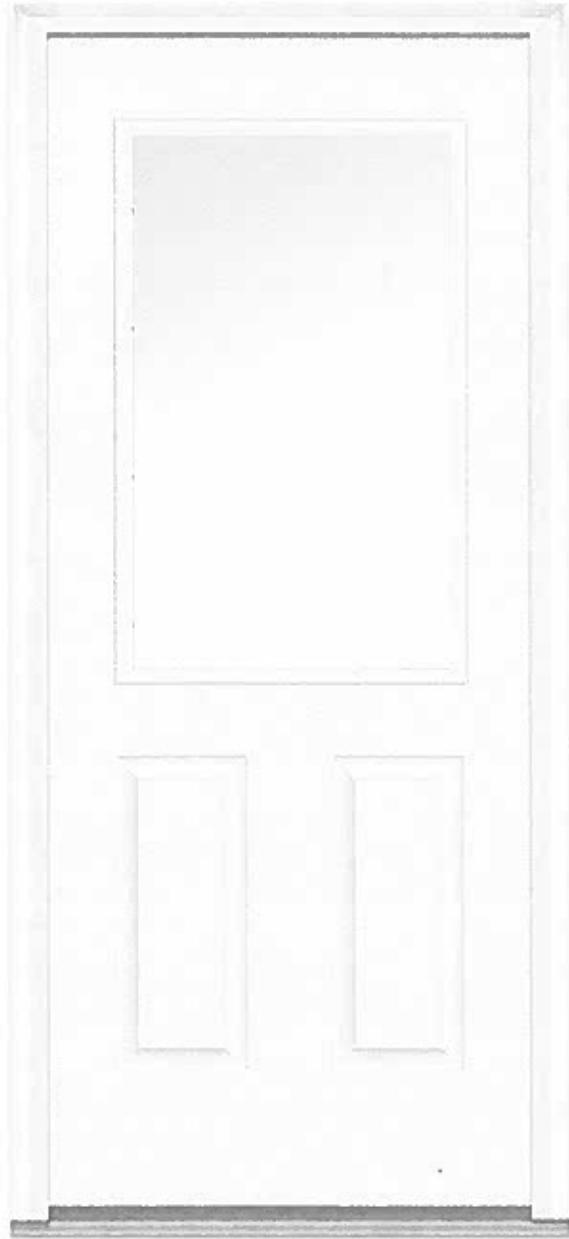

The front porch columns will be Fypon cellular polyurethane in the color white.

The railing will be custom black painted metal railing.

Decking

The front porch will be Azek tongue and groove cellular PVC in the color SW 2844. The porch will be constructed on brick piers. A wood lattice panel will be located between the piers and will be painted white.

The rear deck will be pressure treated wood on brick piers. A wood lattice panel will be located between the piers.

Roofing

Front porch and tower roof: Architectural shingles

Color: Dark Gray

Main roof: TPO roof membrane

Color: White on main roof

Color: Black on front porch and bay windows

Site Construction

Site stair railing required to satisfy building code will be painted metal

Color: Black

Stairs will be framed out of pressure treated lumber and wrapped with Azek tongue and groove cellular PVC decking in the color SW 2844

Brick foundation will be natural Pine Hall Ashton Court brick

There will be a 6' pine privacy fence in the rear yard of the proposed dwelling. It will stretch to the rear property bound.

HVAC units will be adjacent to the rear deck.

Waste containers will be placed on the property inside the fence in the rear.

Gutters will be white aluminum K-Style gutters.

DETAILED DESCRIPTION OF PROPOSED WORK AT 3625 E BROAD ST.:

The applicant proposes to construct a new single family home on the vacant lot at 3625 E Broad St in the city of Richmond, Virginia. The lot is located in the Church Hill District.

SITING:

The proposed dwelling will match the setback of the 2 adjacent properties #3623 & #3627 E Broad St. of 15' from sidewalk. The minimum of 3' sideyard setback will be maintained.

FORM:

The form of the proposed dwelling will be a Queen Anne style and will be indicative of other historical homes in the area as shown at 3604, 3606, & 3608 E Broad St.

SCALE:

The proposed dwelling maintains the existing human scale of the neighborhood and does not overwhelm pedestrians at street level.

HEIGHT, WIDTH, PROPORTION & MASSING:

The proposed dwelling respects the typical height of the houses on the 3600 block of E Broad St. and will maintain this look.

MATERIALS, COLORS, & DETAILS:

Exterior Cladding

The proposed dwelling will be clad in James Hardie Plank fiber cement smooth lap siding with a 7" reveal. The color will be **SW 2846**. All of the window and door trim will be 4.5" prefinished smooth in Arctic White. Any soffit will be James Hardie vented prefinished smooth in Arctic White.

Doors and Windows

The front door will be Milliken Millwork 1/2 light over 2 panel smooth fiberglass with clear glass.

The front door will be painted in **SW 2839**.

The front door will have a single light transom the same width as the door. The top of the transom will be aligned with the top of the first floor windows.

The rear door will be Pella ½ light Smooth Fiberglass in pre-painted white.

The windows will be MW Jefferson 300 series cellular PVC double hung 2/2 simulated divided light. See plans for window sizes.

TRIM

GENERAL NOTES AND DESIGN CRITERIA

FOLLOW LATEST BUILDING CODE: IRC 2012
DESIGN LOADS (MIN.):

FLOOR:	40 PSF LIVE LOAD 10 PSF DEAD LOAD 20 PSF LIVE LOAD	CEILING:	20 PSF LIVE LOAD 10 PSF DEAD LOAD
ROOF:	20 PSF LIVE LOAD	ROOF DESIGN WIND SPEED:	90 MPH
SLEEPING AREAS:	30 PSF LIVE LOAD	TRUSSES: TC AND BC DEAD LOAD OF 10 PSF EACH	

SOIL BEARING ASSUMED CAPACITY: ASSUMED 2000 PSF

LIVE LOADS, DEAD LOADS, WIND LOADS, SNOW LOADS, LATERAL LOADS, SEISMIC ZONING, AND ANY OTHER SPECIALTY LOADING WILL NEED TO BE CONFIRMED BEFORE CONSTRUCTION AND DEALT WITH ACCORDINGLY.

FRAMING MEMBERS:

UNLESS OTHERWISE NOTED, ALL FRAMING LUMBER TO BE SPF #2 OR BETTER, CONTRACTOR TO CONFIRM THE SIZE, SPACING, AND SPECIES OF ALL FRAMING AND STRUCTURAL MEMBERS. ALL EXTERIOR WALLS AND CEILING/ROOF ARE TO BE INSULATED BY CODE. ENGINEERED WOOD PRODUCTS TO BE ENGINEERED BY MANUFACTURER/SUPPLIER. TRUSSES TO BE ENGINEERING BY TRUSS MANUFACTURER/SUPPLIER. FOLLOW BRACING GUIDELINES SUBMITTED BY TRUSS MANUFACTURER.

CONCRETE AND FOUNDATIONS:

ALL SLABS ON GRADE SHALL BE 3000 PSI MIN.
ALL SLABS ON GRADE SHALL BEAR ON 4" COMPACTED GRANULAR FILL WITH 6X6 MIN. WELDED WIRE MESH (WWM). INTERIOR SLABS SHALL HAVE A 6 MIL. MIN. PLOETHYLENE VAPOR BARRIER UNDERNEATH. PROVIDE PROPER EXPANSION AND CONTROL JOINTS. PROVIDE REINFORCING WHERE NEEDED ACCORDING TO LOCAL CODES, REQUIREMENTS, AND DESIGN. FOUNDATION WALLS ARE NOT TO BE BACKFILLED UNTIL STRUCTURAL FRAMING IS COMPLETE. VERIFY DEPTH OF FOOTINGS TO MAKE SURE IT IS BELOW FROST LINE.

STEEL:

ALL STRUCTURAL STEEL TO COMPLY WITH ASTM STANDARDS AND SPECIFICATIONS.

3625 E BROAD ST.

LOCATION:
RICHMOND, VA

FLOOR AND WALL FRAMING NOTES:

- 1) ALL FRAMING LUMBER SHALL BE IDENTIFIED PER SECTION R302.1. ALL FLOOR/CEILING/WALL FRAMING LUMBER TO BE NO. 2 GRADE OR BETTER SPF. ALL LVL BEAMS SHOULD HAVE A MIN. ALLOWABLE BENDING STRESS OF 2300 PSI AND MIN. E VALUE OF 1.8 LNO.
- 2) ALL PRE-ENGINEERED AND STEEL STRUCTURAL MEMBERS ARE TO BE DESIGNED BY THE MANUFACTURER OR CERTIFIED ARCHITECT/ENGINEER. STEEL BEAMS SUPPORTED ON EXT. WALLS SHALL BE INSULATED FROM END OF BEAM TO MID-SPAN A MIN. DISTANCE OF 24". STEEL BEAMS SHALL HAVE A MIN. OF (6) JACK STUDS UNDER EACH END. ENGINEERED BEAMS SHALL HAVE A MIN. OF (4) JACK STUDS UNDER EACH BEARING END.
- 3) SAFETY GLAZING IS REQUIRED PER SECTION R308 INCLUDING BUT NOT LIMITED TO THE FOLLOWING: GLAZING IN SWINGING DOORS EXCEPT JALOUSIES, GLAZING IN FIXED AND SLIDING PANEL DOORS, GLAZING IN STORM DOORS, GLAZING IN ALL UN-FRAMED DOORS, GLAZING IN DOORS AND ENCLOSURES FOR BATHROOMS AND SHOWERS WHOSE BOTTOM EXPOSED EDGE IS LESS THAN 6" ABOVE THE WALKING SURFACING SURFACE. GLAZING IN PANELS ADJACENT TO AND WITHIN 24" OF THE EDGE OF A SWINGING DOOR, GLAZING LESS THAN 18" ABOVE THE FLOOR, GLAZING IN BALUNGS, GLAZING IN FENCES OR WALLS ENCLOSING SWIMMING POOLS, HOT TUBS, SPAS, GLAZING IN STAIRWAYS, LANDINGS, RAMPS, GLAZING WITHIN 6" OF THE BOTTOM TREAD OF A STAIRWAY.
- 4) PER SECTION R310, A MIN. NET CLEAR OPENING OF 57 SQ. FT. (24" HIGH X 20" WIDE) AND A MAX. SILL HEIGHT OF 44" ABOVE FINISH FLOOR IS REQUIRED FOR ALL EMERGENCY ESCAPE AND RESCUE WINDOWS. THE WINDOW DIMENSIONS SHOWN ON THIS PLAN MAY VARY DEPENDING ON THE CHOSEN MANUFACTURER. CONTRACTOR MUST VERIFY THE CHOSEN WINDOW MEET THE EXCESS REQUIREMENTS. PROVIDE WINDOW WEALS AS REQUIRED. COMPLIANCE TO EMERGENCY EGRESS IS REQUIRED.
- 5) MIN. HALLWAY WIDTH IS 36" PER SECTION 111.3. MIN. HABITABLE ROOM SIZE IS 70 SQ. FT. PER SECTION R304.2. MIN. LIGHTING AND VENTILATION REQUIREMENTS PER SECTION R303.1. MIN. CEILING HEIGHT IS 7 FEET PER SECTION R303.1. 36" EXT DOOR IS REQUIRED PER SECTION R311.4. STAIRWAY DIMINATION PER SECTION 303.A
- 6) BATHROOM AND SHOWER SPACES SHALL BE CONSTRUCTED IN ACCORDANCE TO SECTION R307.2 AND FIGURE R307.2. BATHROOM AND SHOWER WALLS/FLOORS ABOVE BATHROOMS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON-ABSORBANT SURFACE SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 6' ABOVE THE FLOOR. ALL BATHROOMS WITH NO VENTING WINDOW MUST HAVE EXHAUST FAN VENTED TO THE OUTSIDE.
- 7) COMPLIANCE TO SECTION R313 FOR SMOKE DETECTORS IS REQUIRED. SMOKE DETECTORS SHALL BE LISTED IN ACCORDANCE WITH UL 217 AND HARDWIRED, INTERCONNECTED, AND ABC FAULT PROTECTED WITH A BATTERY BACKUP.
- 8) GARBAGE WALLS ARE TO BE COVERED PER SECTION R309. TYPICAL GARBAGE WALLS AND ATTIC SPACE/CEILING ASSEMBLIES ARE TO BE COVERED WITH A MIN. 1/2" GYPSUM WALLBOARD. GARBAGE RESISTANCE SEPARATION WALLS AND FLOOR/CEILING ASSEMBLIES ARE TO BE COVERED WITH A MIN. 5/8" TYPE "X" GYPSUM WALLBOARD. DOORS SEPARATING THE GARAGE AND RESIDENCE ARE TO BE MIN. 20-MINUTE FIRE RATED OR SOLID WOOD, NOT LESS THAN 1.38" THICK.

FLOOR AND WALL FRAMING NOTES CONT:

- 9) COMPLIANCE TO SECTION R311 OF THE IRC IS REQUIRED FOR EXT DOOR STAIRS, RAMPS, AND LANDINGS. THERE SHALL BE A FLOOR OR LANDING ON EACH SIDE OF EACH EXT. DOOR EXCEPT WHERE A STAIRWAY OF TWO OR FEWER RISERS IS LOCATED. THE WIDTH OF EACH LANDING SHALL NOT BE LESS THAN THE WIDTH OF THE DOOR SEAVED. EVERY LANDING SHALL HAVE A MIN. OF 36" IN DICTION OF TRAVEL PER SECTION R311.4.3
- 10) COMPLIANCE TO SECTION R312 IS REQUIRED FOR HANDRAILS (TYPE 1) AND GUARDRAILS. ALL INT. AND EXT. BALUNGS ARE TO BE A CONTINUOUS AND MIN. 36" IN HEIGHT, BE ABLE TO WITHSTAND 200 LBS OF FORCE, AND NOT ALLOW A SPHERE GREATER THAN 4" IN DIAMETER TO PASS THROUGH GUARDRAILS. ARE TO BE 36" HIGH WITH MAX SPACING BETWEEN PICKETS OF LESS THAN 4". HANDRAILS ARE TO BE BETWEEN 34"-36" HIGH WITH MAX SPACING BETWEEN PICKETS NOT LESS THAN 4".
- 12) JOISTS UNDER BEARING PARTITIONS ARE TO COMPLY WITH SECTION R302.4. 5/8" MIN LUMBER FLOOR JOISTS ARE TO BE DOUBLED WHEN UNDER ONE-STORY PARALLEL BEARING PARTITIONS AND SHALL BE PLACED 4' APART TO ACCOMMODATE PLUMBING. 5/8" MIN LUMBER FLOOR JOISTS ARE TO BE TRIPLED WHEN UNDER TWO-STORY PARALLEL BEARING PARTITIONS AND SHALL BE PLACED 4' APART TO ACCOMMODATE PLUMBING. WHERE PARTITIONS FALL BETWEEN FLOOR JOISTS, PROVIDE FULL HEIGHT BLOCKING AT 48" O.C. BETWEEN JOISTS.
- 13) FLOOR SHEATHING SHALL BE IN ACCORDANCE WITH SECTION R303.1 AND TABLE R303.1. TYPICAL FLOOR SHEATHING TO BE MIN. 3/4" THICK SET PERPENDICULAR TO JOISTS.
- 14) APPROVED CORROSION RESISTANT FLASHING SHALL BE INSTALLED BY THE FOLLOWING LOCATIONS: 1-AT TOP OF ALL EXT WINDOW AND DOOR OPENINGS. 2-AT THE INTERSECTION OF CHIMNEYS OR OTHER MASONRY CONSTRUCTION WITH FRAME OR STUCCO WALLS WITH PROJECTING UPS OR BOTH SIDES UNDER STUCCO CORNICES. 3-UNDER THE ENDS OF MASONRY, WOOD OR METAL CORNICES AND SILLS (CONTINUOUSLY) ABOVE ALL PROJECTING WOOD TRIM. 5-WHERE EXT PORCHES, DECKS, OR STAIRS ATTACH TO A WALL, FLOOR ASSEMBLY, OR ANY WOOD-FRAMED CONSTRUCTION. 6-AT ALL WALL AND ROOF INTERSECTIONS. 7-AT BUILD-UP GUTTERS.
- 15) DRAFT STOPPING IS REQUIRED PER SECTION R302.12. WHEN THERE IS USABLE SPACE BOTH ABOVE AND BELOW THE CONCEALED SPACE OF A FLOOR/CEILING ASSEMBLY, DRAFT STOPS SHALL BE INSTALLED SO THAT THE CONCEALED SPACE DOES NOT EXCEED 1000 SF. DRAFT STOPPING SHALL BE INSTALLED SO AS TO DIVIDE THE SPACE EVENLY. DRAFT STOPPING IS REQUIRED IN SUSPENDED CEILINGS UNDER THE FLOOR SYSTEM AND WHEN THE FLOOR FRAMING IS CONSTRUCTED OF TRUSS TYPE OPEN WEB OR PERFORATED MEMBERS.
- 16) FIRE BLOCKING IS REQUIRED PER SECTION R302.8. FIRE BLOCKING SHALL BE PROVIDED TO CUT OFF ALL CONCEALED DRAFT OPENINGS (VERTICAL & HORIZONTAL) AND FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES, A TOP STORY, AND A ROOF SPACE. FIRE BLOCKING SHALL BE PROVIDED IN WOOD FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS: 1- IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS INCLUDING FINISHED SPACES, ALSO VERTICAL AT CEILING AND FLOOR LEVELS AND HORIZONTAL INTERVALS NOT EXCEEDING 16 FT. 2- AT ALL INTERSECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS SORTERS, DROPPED CEILINGS, AND COVE CEILINGS. 3- IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. 4- AT OPENINGS AROUND VENTS, PIPES, AND DUCTS AT CEILING AND FLOOR LEVELS WITH AN APPROVED PRODUCT TO RESIST THE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION. 5- FOR FIRE BLOCKING OF CHIMNEYS AND FIREPLACES SEE R1001.16. 6- FIRE BLOCKING OF CORNICES OF A TWO-STORY DWELLING IS REQUIRED AT THE LINE OF DWELLING UNIT SEPARATION.
- 17) THE ENDS OF JOISTS, BEAMS AND GIRDERS SHALL HAVE NOT LESS THAN 1/2" OF BEARING ON WOOD OR METAL AND NOT LESS THAN 3" ON MASONRY OR CONCRETE UNLESS WHERE SUPPORTED ON A 1" X 4" RIBBON STRIP AND NAILLED TO THE ADJACENT STUD OR BY THE USE OF APPROVED JOIST HANGERS.
- 18) WALL RAMION SHALL BE IN COMPLIANCE WITH THE FOLLOWING:
 - SECTIONS R302.6 & R302.6 FOR BEARING POINT CONDITIONS.
 - SECTIONS R302.12, R302.4 & R302.8 FOR DRAFT STOPPING AND FIRE BLOCKING.
 - SECTIONS R302.11 & R302.4 FOR STUD SIZE, HEIGHT, AND SPACING.
 - SECTIONS R302.33, R302.14, & R302.4 FOR TOP AND BOTTOM FLATES.
 - SECTIONS AND TABLES R302.30, R302.32, R302.7, AND R302.9 FOR HEADER SPANS.
 - SECTION R302.10 FOR BRACED WALL LINES AND BRACED WALL PANELS.
 - SECTION R302.7 FOR MASONRY VENEER CONSTRUCTION REQUIREMENTS (WALL, THE WEEP HOLE SPACING, LIMIT SIZE & FLASHING DETAILS).
 - TABLE R302.30 FOR WOOD STRUCTURAL WALL SHEATHING ATTACHMENT.
- 19) A COMPLETE CONTINUOUS LOAD PATH SHALL BE PROVIDED PER SECTION R301.1. THEREFORE, ALL EXTERIOR WALL AREAS (INCLUDING ABOVE AND BELOW OPENINGS) SHALL BE COVERED WITH WOOD SHEATHING IN ACCORDANCE TO SECTION R302.10.3 AND TABLE R302.10.3.1. WALL SHEATHING SHALL BE ATTACHED IN ACCORDANCE WITH TABLES R302.10.1, R302.30, AND R302.10.3. WALL SHEATHING SHALL BE NAILLED W/ 6d COMMON NAIL @ 6" O.C. ON THE EDGES AND 12" O.C. AT INTERMEDIATE SUPPORTS. 20) WALLS SUPPORTING ROOF STRUCTURE SHALL HAVE MIN. (3) STUDS U.O.M. UNDER EACH POINT LOAD AND ARE TO BEAR ON MEMBERS DESIGNED TO CARRY THE LOAD TO THE FOUNDATION.
- 21) WHERE CEILING JOISTS ARE PARALLEL TO EXTERIOR WALLS, BRACE EXTERIOR WALL BACK TO CEILING JOIST FRAMING AS REQUIRED.
- 22) ALL TWO-STORY WALLS WITH AN OPENING MUST USE (1) 3-1/2" X 3-1/2" X 1/2" RUD, HEIGHT CONTINUOUS STEEL, ANGLE LAPPED TO KING STUD @ 24" O.C. FROM SOLE PLATE TO TOP PLATE ON EACH SIDE OF THE OPENING.
- 23) DWELLING UNIT SEPARATION SHALL BE ACCORDANCE WITH SECTION R317.
- 24) MASONRY CHIMNEYS AND FIREPLACES SHALL BE CONSTRUCTED IN ACCORDANCE TO SECTION R1001.
- 25) DESIGN PRESSURES FOR EXTERIOR GLASS DOORS & WINDOWS SHALL BE IN COMPLIANCE WITH SECTIONS R301.2.1 & R617 AND TABLES R301.202 & R301.203.
- 26) ALL INTERIOR AND EXTERIOR STAIRWAYS (INCLUDING LANDINGS AND TREADS) SHALL BE DIMINATED PER SECTION 3.303.A. INTERIOR STAIRWAYS SHALL BE PROVIDED WITH ARTIFICIAL LIGHT SOURCE LOCATED IN THE IMMEDIATE VICINITY OF EACH LANDING OF THE STAIRWAY. PROVIDE LIGHT CONTROLS AT THE TOP AND BOTTOM OF INTERIOR STAIRS. INTERIOR LIGHT SHALL BE CAPABLE OF ILLUMINATING TREADS AND LANDINGS TO LEVELS NOT LESS THAN 1 FLOOR CYCLE MEASURED AT THE CENTER OF THE TREADS AND LANDINGS. EXTERIOR STAIRWAYS PROVIDING ACCESS TO A BASEMENT FROM THE OUTSIDE GRADE LEVEL SHALL BE PROVIDED WITH AN ARTIFICIAL LIGHT SOURCE LOCATED INT HE IMMEDIATE VICINITY OF THE BOTTOM OF THE LANDING.

3625 E BROAD ST.

COBBLESTONE DEVELOPMENT GROUP


SCALE:
1" = 1'-0"

DATE:
01-16-17


SHEET:
1 OF 6

COBBLESTONE
DEVELOPMENT GROUP


PERMIT SET 100%

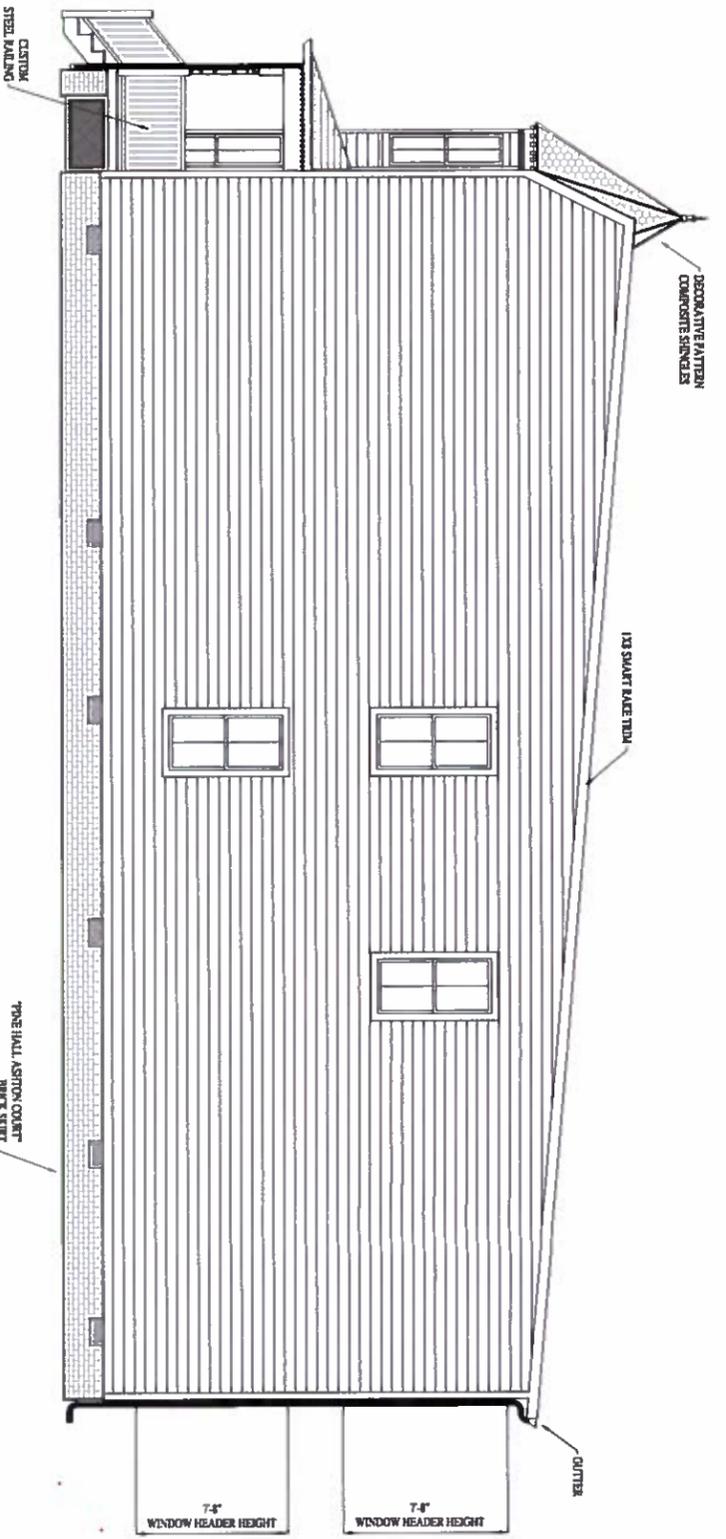


RIGHT ELEVATION
FACING 22ND ST.

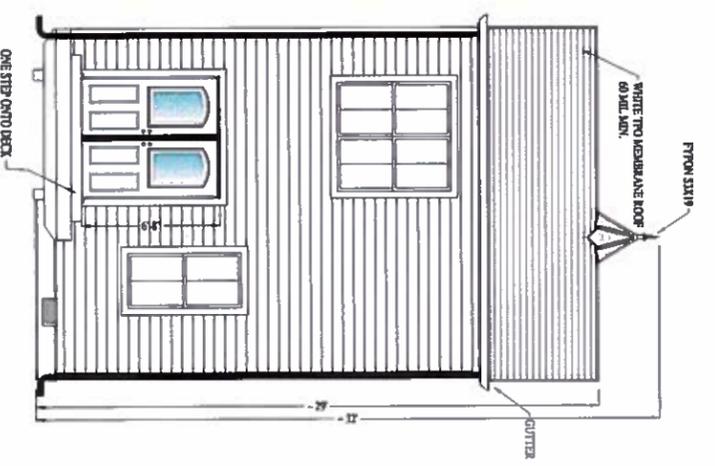

REAR ELEVATION

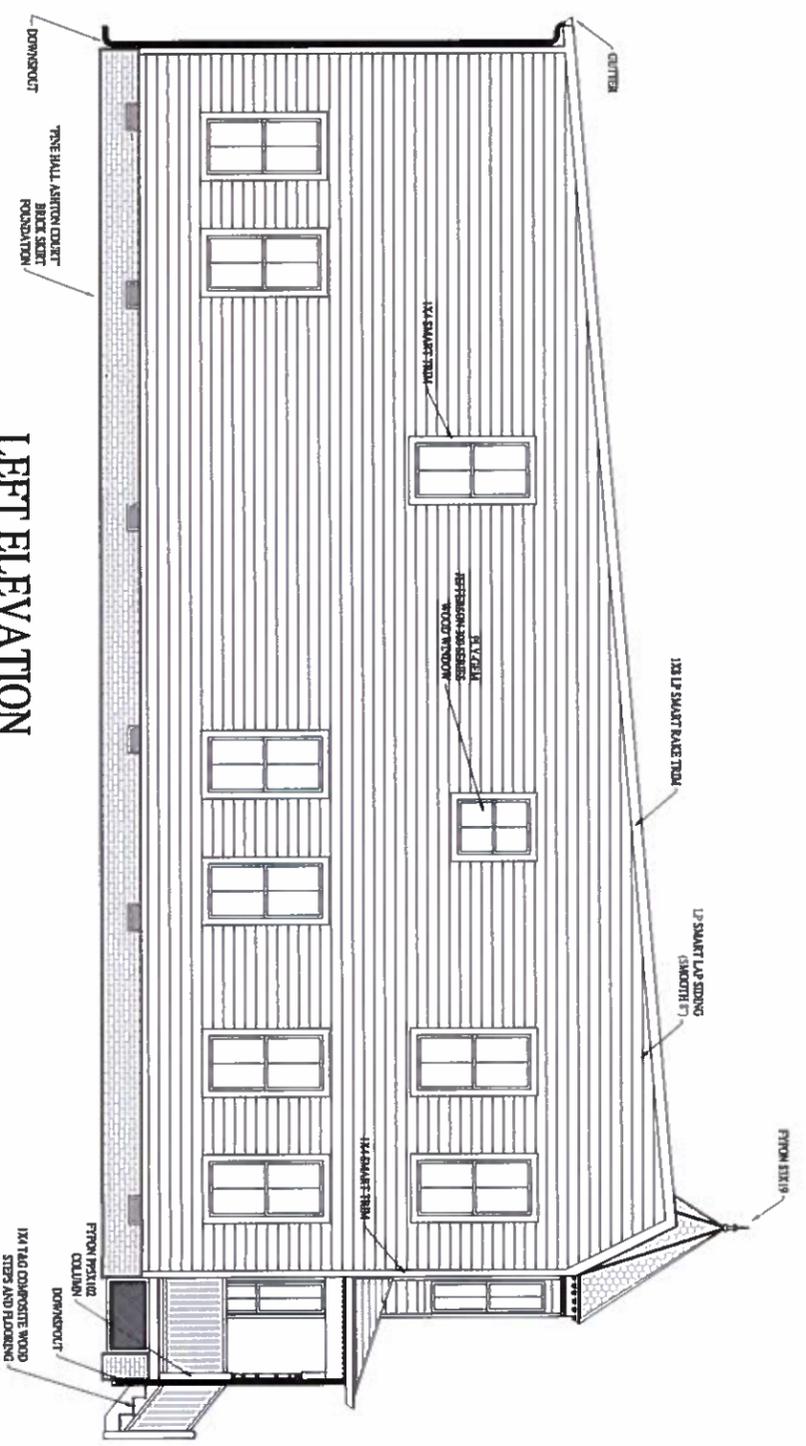

LEFT ELEVATION

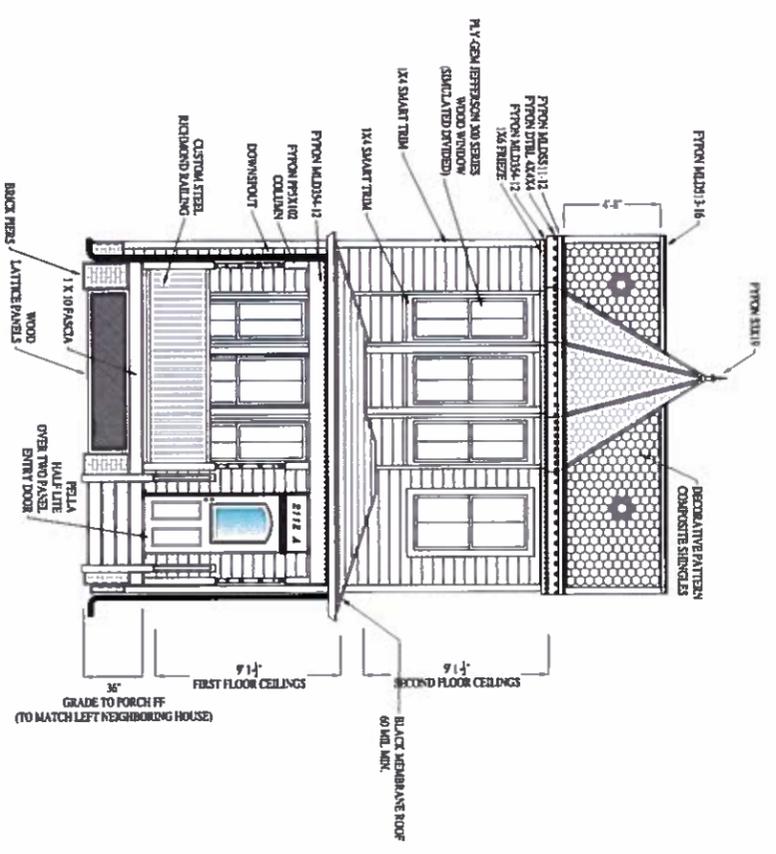

FRONT ELEVATION

COBBLESTONE
DEVELOPMENT GROUP

SHEET:
2 OF 6




DATE:
01-16-17

SCALE:
1/4" = 1'-0"


3625 E BROAD ST.
COBBLESTONE DEVELOPMENT GROUP

1ST FLOOR HEATED SQ. FOOTAGE: 1032 S.F.
 2ND FLOOR HEATED SQ. FOOTAGE: 1002 S.F.


UPPER ROOF VENTING:
 1208 S.F. TOTAL - 1/150 REQUIRED
 1160 S. INCHES REQUIRED

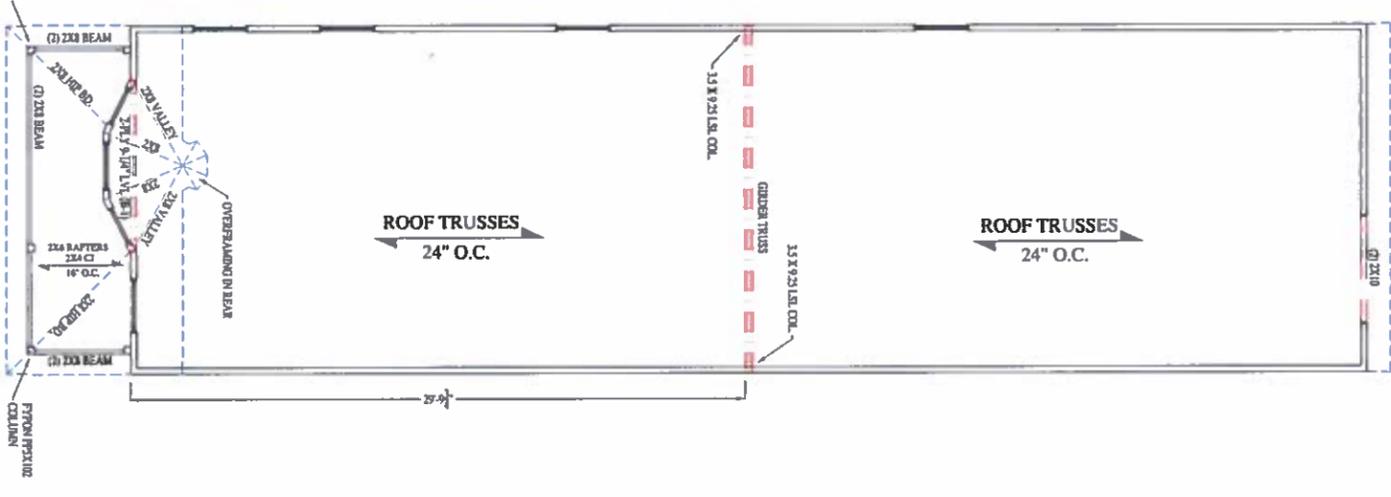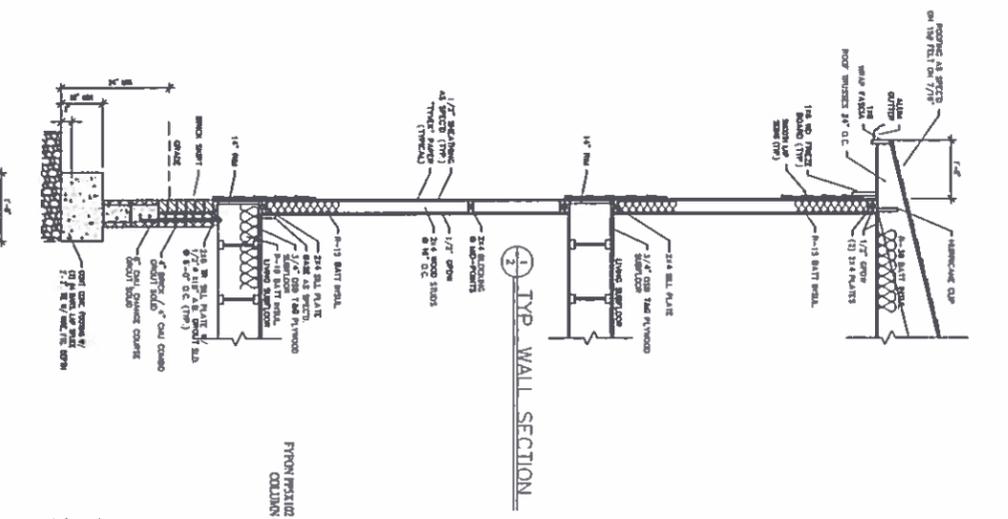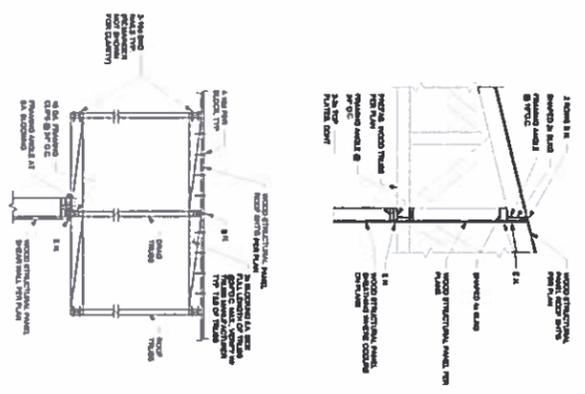

ROOF FRAMING PLAN

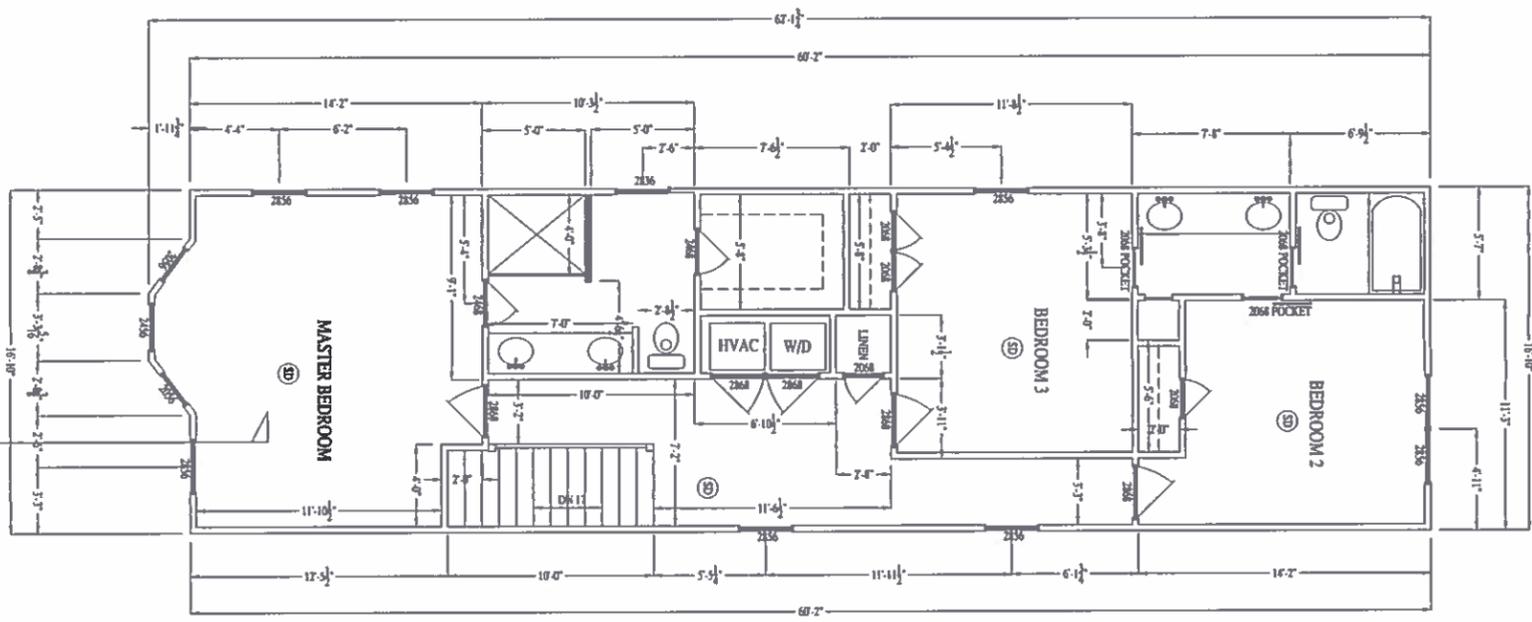

SECOND FLOOR PLAN

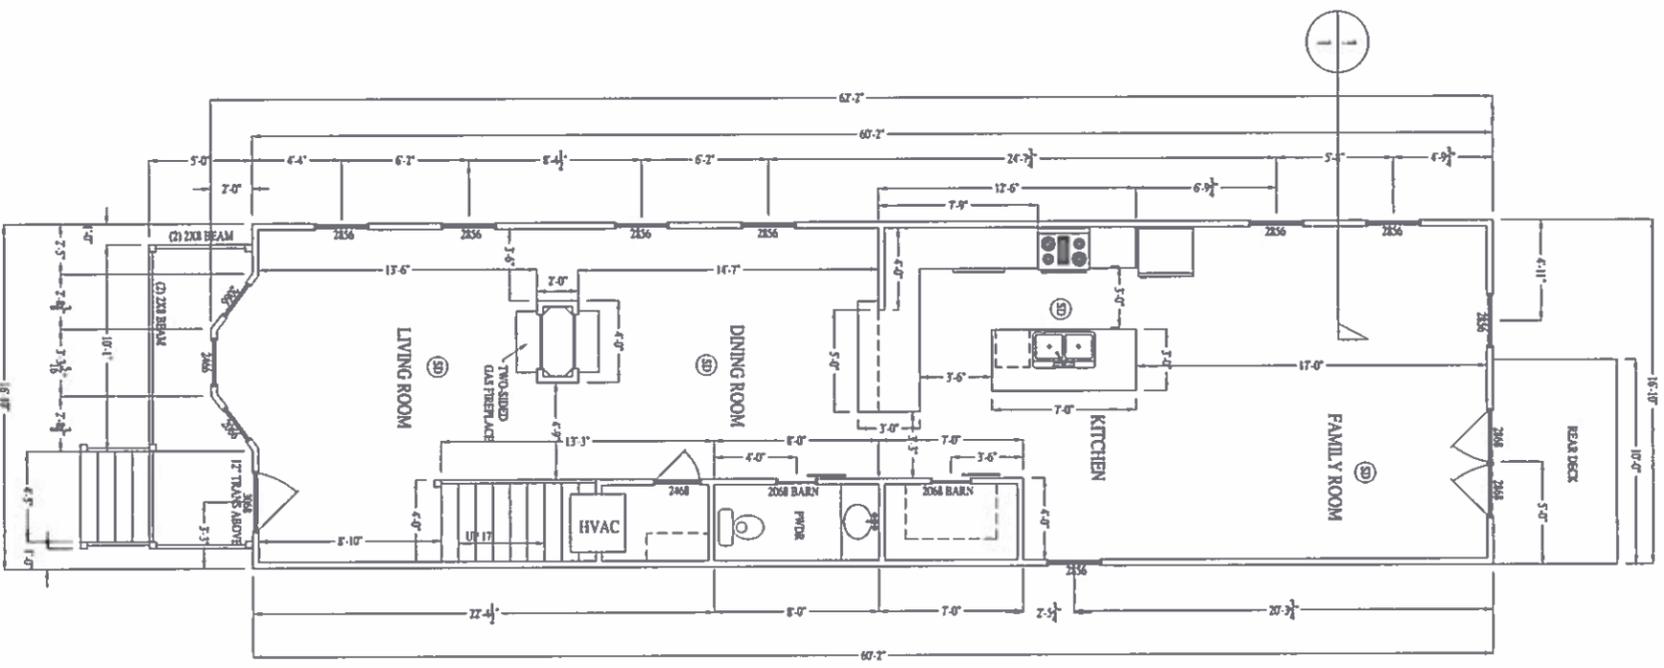

FIRST FLOOR PLAN

COBBLESTONE
 DEVELOPMENT GROUP

SHEET:
 3 OF 6


DATE:
 01-16-17

SCALE:
 1/4" = 1'-0"

3625 E BROAD ST.

COBBLESTONE DEVELOPMENT GROUP


ALL EXTERIOR SINGLE WINDOW AND DOOR HEADERS TO BE (2) 2X8 MIN. UNLESS OTHERWISE NOTED.

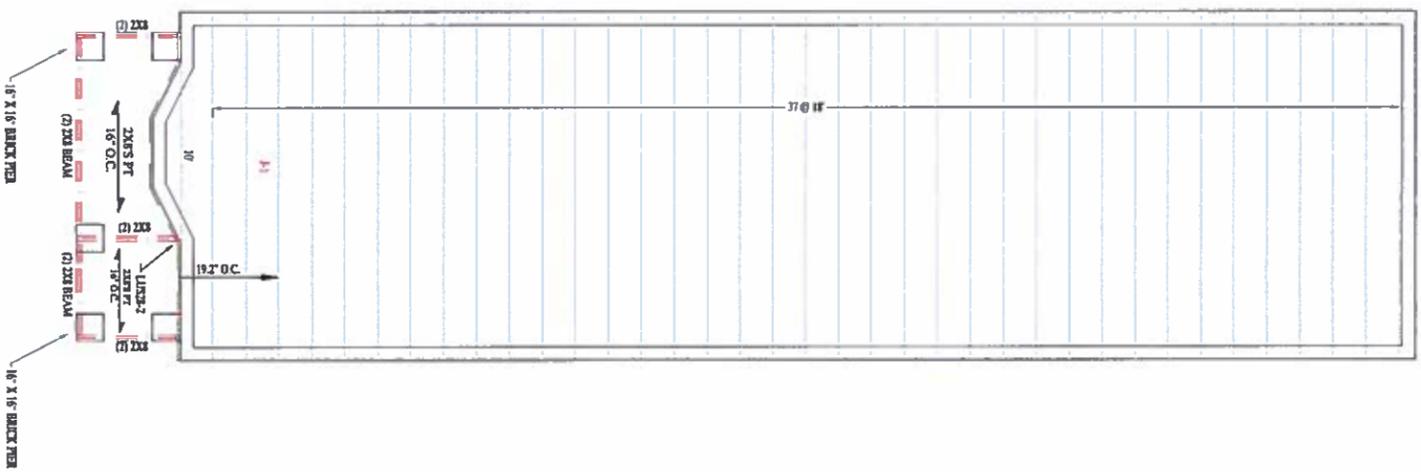


FIRST FLOOR FRAMING PLAN



SECOND FLOOR FRAMING PLAN

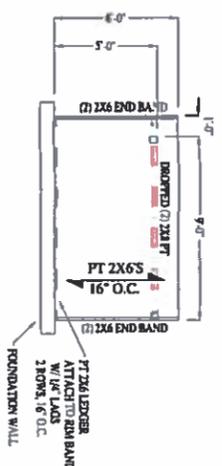


REAR DECK PLAN (LEFT SIDE)

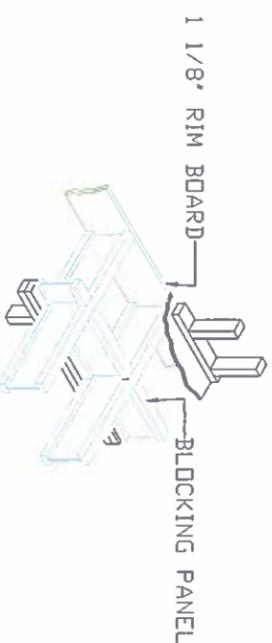


3 CANTILEVER DETAIL

EMP MATERIAL LIST

- 11-7/8" LPH-20
- 1 @ 10'
- 2 @ 17'
- 6 @ 14'
- 71 @ 18'
- 11-7/8" RIM
- 25 @ 12'
- 2 @ 18'
- 9 1/2" LVL
- 2 @ 10'
- COLLINS
- (4) 3.5 X 9.25 X 20"
- HANGERS
- (2) MIT311-88-2
- (6) IT52-56-188

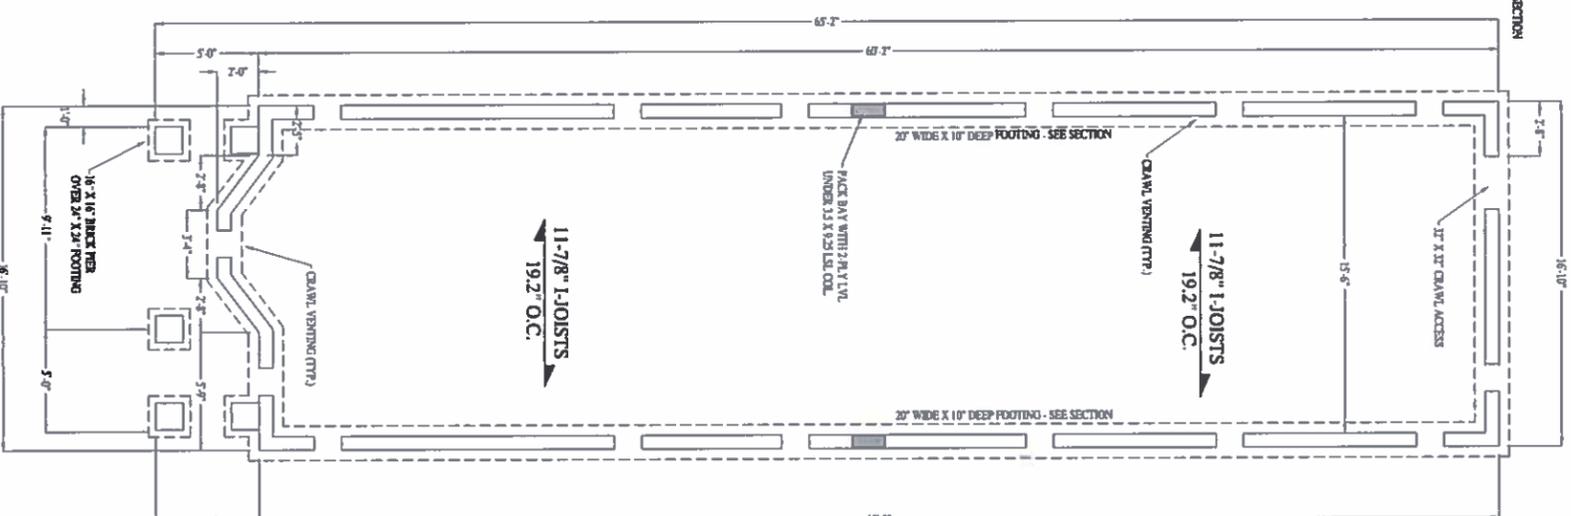

FOUNDATION PLAN
VERIFY SOIL BEARING CAPACITY.

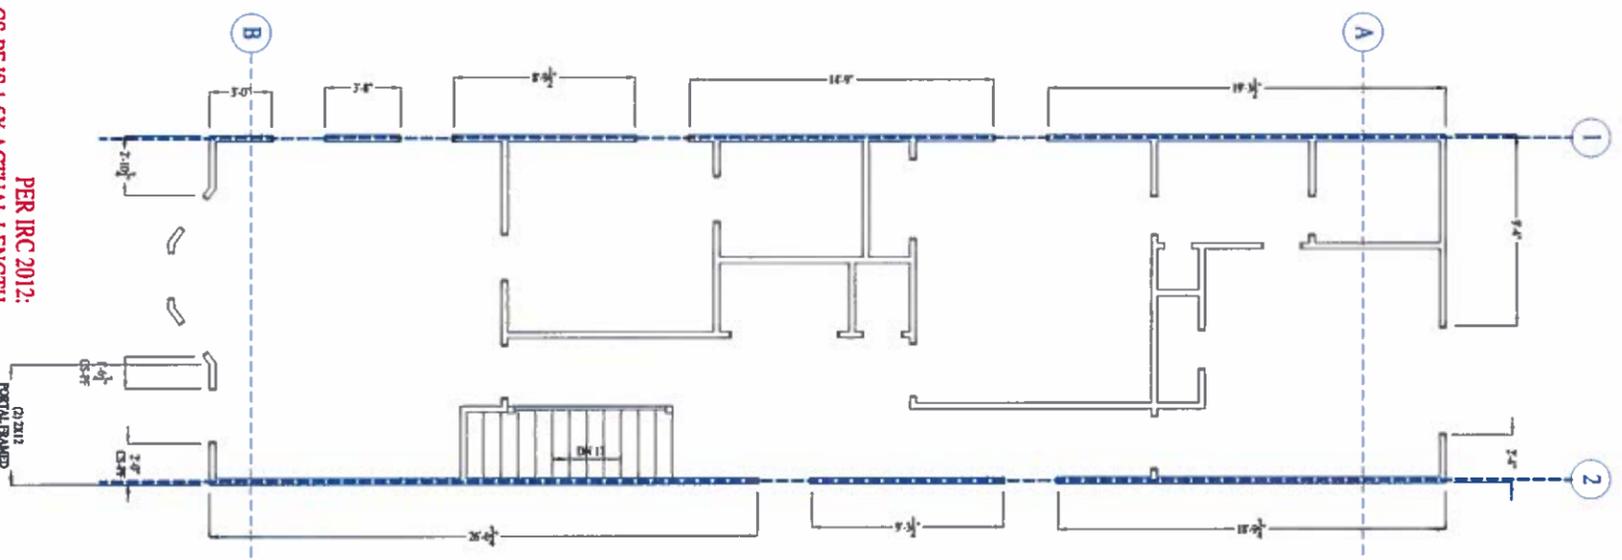


PER IRC 2012:
CS-PF IS 1.5X ACTUAL LENGTH

FIRST FLOOR WALL BRACING PLAN

WIND SPEED (MPH)	90	90	90	90	90
BRACED WALL LINE	1	2	3	4	5
STORY					
BRACED WALL PANEL METHOD	CS-WSP CS-PF CS-D				
AVG BWL SPACING (ft)	17	17	17	17	17
TABULAR REQUIRED (ft)	3.05	3.05	5.60	5.60	5.60
EXPOSURE	B	B	B	B	B
EAVE RIDGE HT (ft)	4.00	0.70	4.00	0.85	4.00
WALL HEIGHT (ft)	8.00	0.95	9.00	0.95	9.00
# BWLS	2.00	1.00	2.00	1.00	2.00
CHART INTERIOR CB	NO	NO	NO	NO	NO
ADD PAIR ROOF HOLD DOWNS	NO	NO	NO	NO	NO
METHOD CB FASTEN @ 4" o.c.	NO	NO	NO	NO	NO
REQUIRED BWL LENGTH (ft)	2.03	2.03	4.32	4.32	4.32
ACTUAL BWL LENGTH (ft)	49.42	54.50	37.67	57.17	57.17
ACTUAL > REQUIRED	YES	YES	YES	YES	YES
SPACE	YES	YES	YES	YES	YES
BWFLS < 5' APART	YES	YES	YES	YES	YES
Length of BWL (ft)	60	60	60	60	60
BWFL 1 x 16, 2 x 16	YES	YES	YES	YES	YES
BWFL WITHIN 1' OF END	YES	YES	YES	YES	YES
CONTINUOUS END CONDITION	1	1	1	1	1
BWL COMPLIANCE PASS/FAIL	PASS	PASS	PASS	PASS	PASS

WIND SPEED (MPH)	90	90	90	90	90	90
BRACED WALL LINE	A	B	C	D	E	
STORY						
BRACED WALL PANEL METHOD	CS-WSP CS-PF CS-D	CS-WSP CS-PF CS-D	CS-WSP CS-PF CS-D	WSP SFR POP WSP CS-SFR	CS-WSP CS-PF CS-D	CS-WSP CS-PF CS-D
AVG BWL SPACING (ft)	53	53	29.5	28.5	24.5	24.5
TABULAR REQUIRED (ft)	7.95	7.95	8.87	10.35	7.82	7.82
EXPOSURE	B	B	B	B	B	B
EAVE RIDGE HT (ft)	4.00	0.70	4.00	4.00	0.85	4.00
WALL HEIGHT (ft)	9.00	0.95	9.00	0.95	9.00	0.95
# BWLS	2.00	1.00	2.00	3.00	1.30	3.00
CHART INTERIOR CB	NO	NO	NO	NO	NO	NO
ADD PAIR ROOF HOLD DOWNS	NO	NO	NO	NO	NO	NO
METHOD CB FASTEN @ 4" o.c.	NO	NO	NO	NO	NO	NO
REQUIRED BWL LENGTH (ft)	5.29	5.29	9.32	10.86	8.00	8.00
ACTUAL BWL LENGTH (ft)	11.66	7.88	13.50	12.00	9.15	9.15
ACTUAL > REQUIRED	YES	YES	YES	YES	YES	YES
SPACE	YES	YES	YES	YES	YES	YES
BWFLS < 5' APART	YES	YES	YES	YES	YES	YES
Length of BWL (ft)	17	17	17	17	17	17
BWFL 1 x 16, 2 x 16	YES	YES	YES	YES	YES	YES
BWFL WITHIN 1' OF END	YES	YES	YES	YES	YES	YES
CONTINUOUS END CONDITION	1	1	1	1	1	1
BWL COMPLIANCE PASS/FAIL	PASS	PASS	PASS	PASS	PASS	PASS

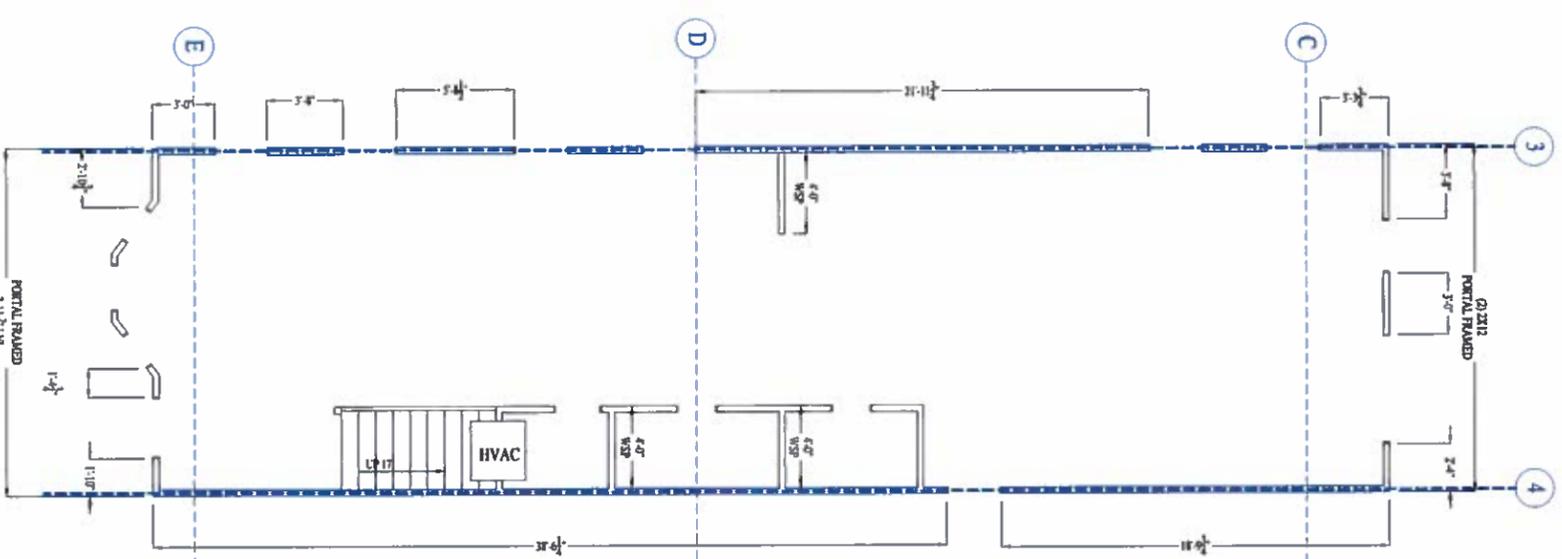

SECOND FLOOR WALL BRACING PLAN

