

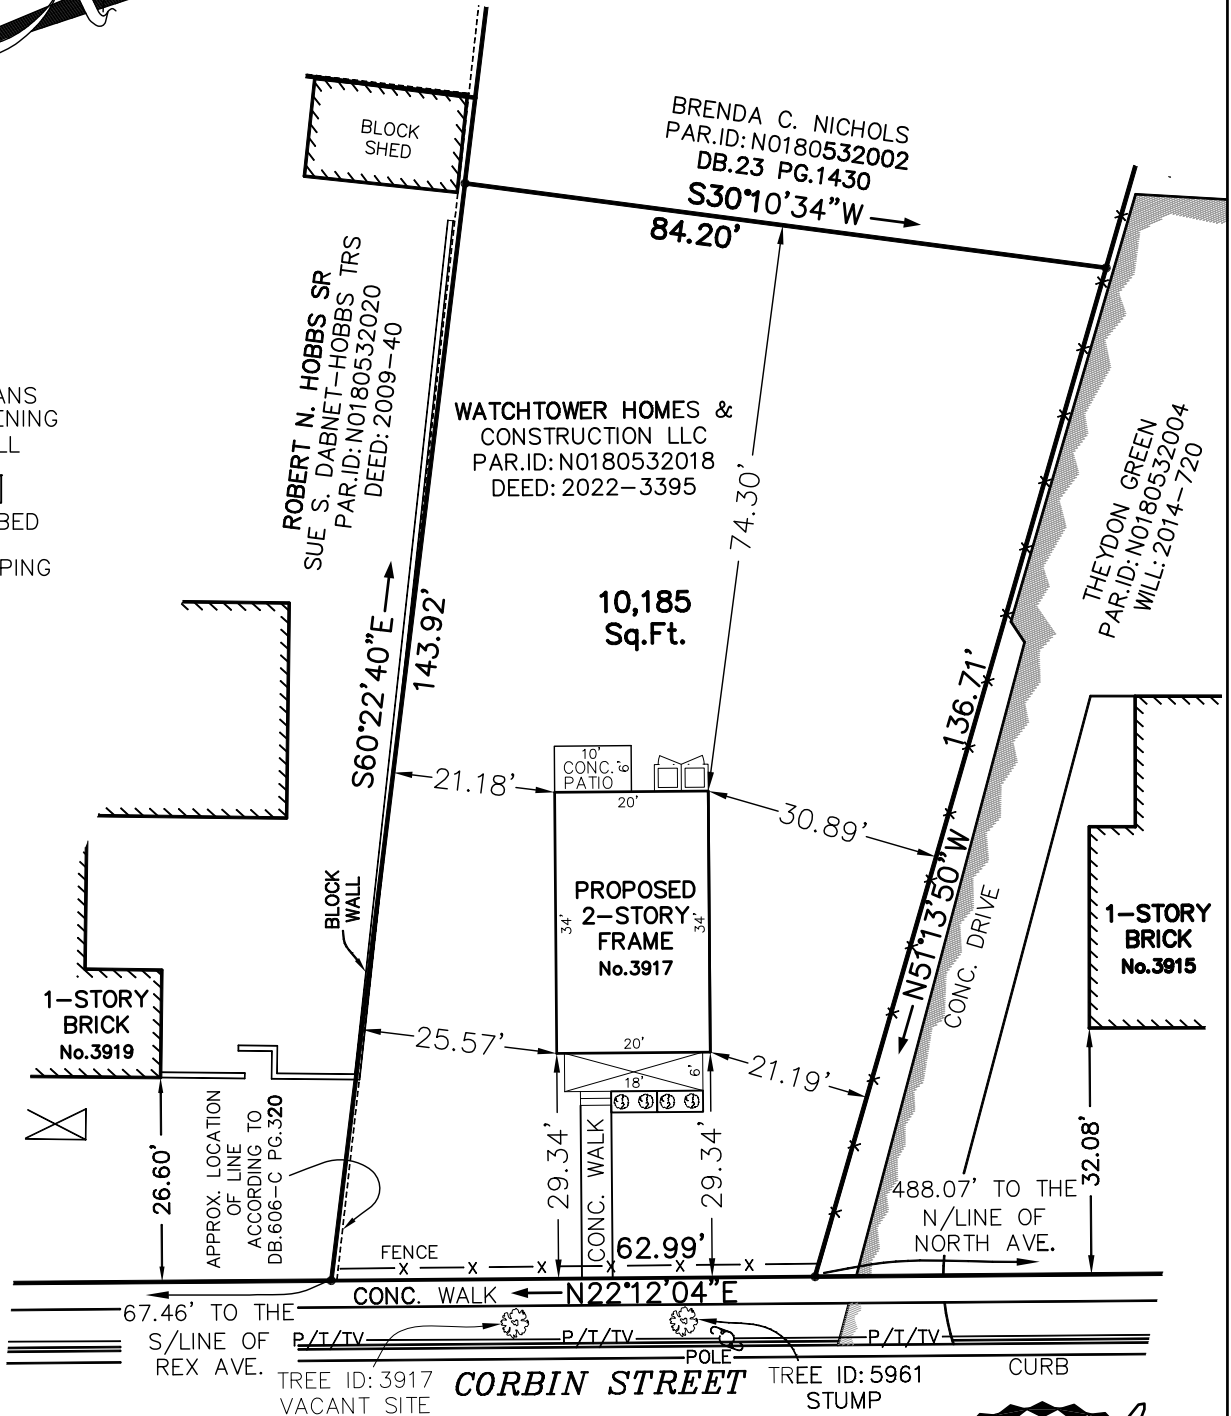


This is to certify to the PURCHASER/OWNER shown hereon, and his TITLE INSURER and Lender, that on 6-13-2022 I made an Accurate survey of the premises shown hereon and that there are no easements or encroachments visible on the ground other than those shown hereon. This survey has been made without the benefit of a title search and is subject to any uses recorded and unrecorded and other pertinent facts in which a title search may disclose. Copies of this plat without the certifying surveyor's seal with an original signature are INVALID.

This property IS NOT within a FEMA Floodway Hazard as shown on Comm. Panel # 5101290029D Zone: "X" DATED: 4-2-2022

DB.759 PG.1483

-  SUPER CANS WITH SCREENING < 5' TALL
-  MULCH BED WITH LANDSCAPING




TREE ID: 3917 VACANT SITE SMALL *Wax Myrtles will be planted in the vacant tree wells in the ROW

MAP SHOWING THE PROPOSED IMPROVEMENTS ON No. 3917 CORBIN STREET




Virginia Surveys IN THE CITY OF RICHMOND, VA.

P.O. BOX 118
 CHESTERFIELD, VA 23832
 (804) 748-9481
 COPYRIGHT © VIRGINIA SURVEYS
 All rights reserved.

DATE: 9-8-2022
 CERTIFIED BY JEFFREY K. FLOYD
 VIRGINIA CERTIFICATE NO. 001905

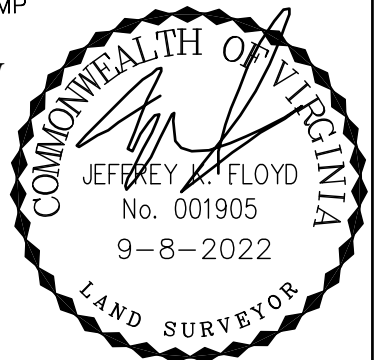

SCALE: 1"=25'
 JOB NO. 220214792

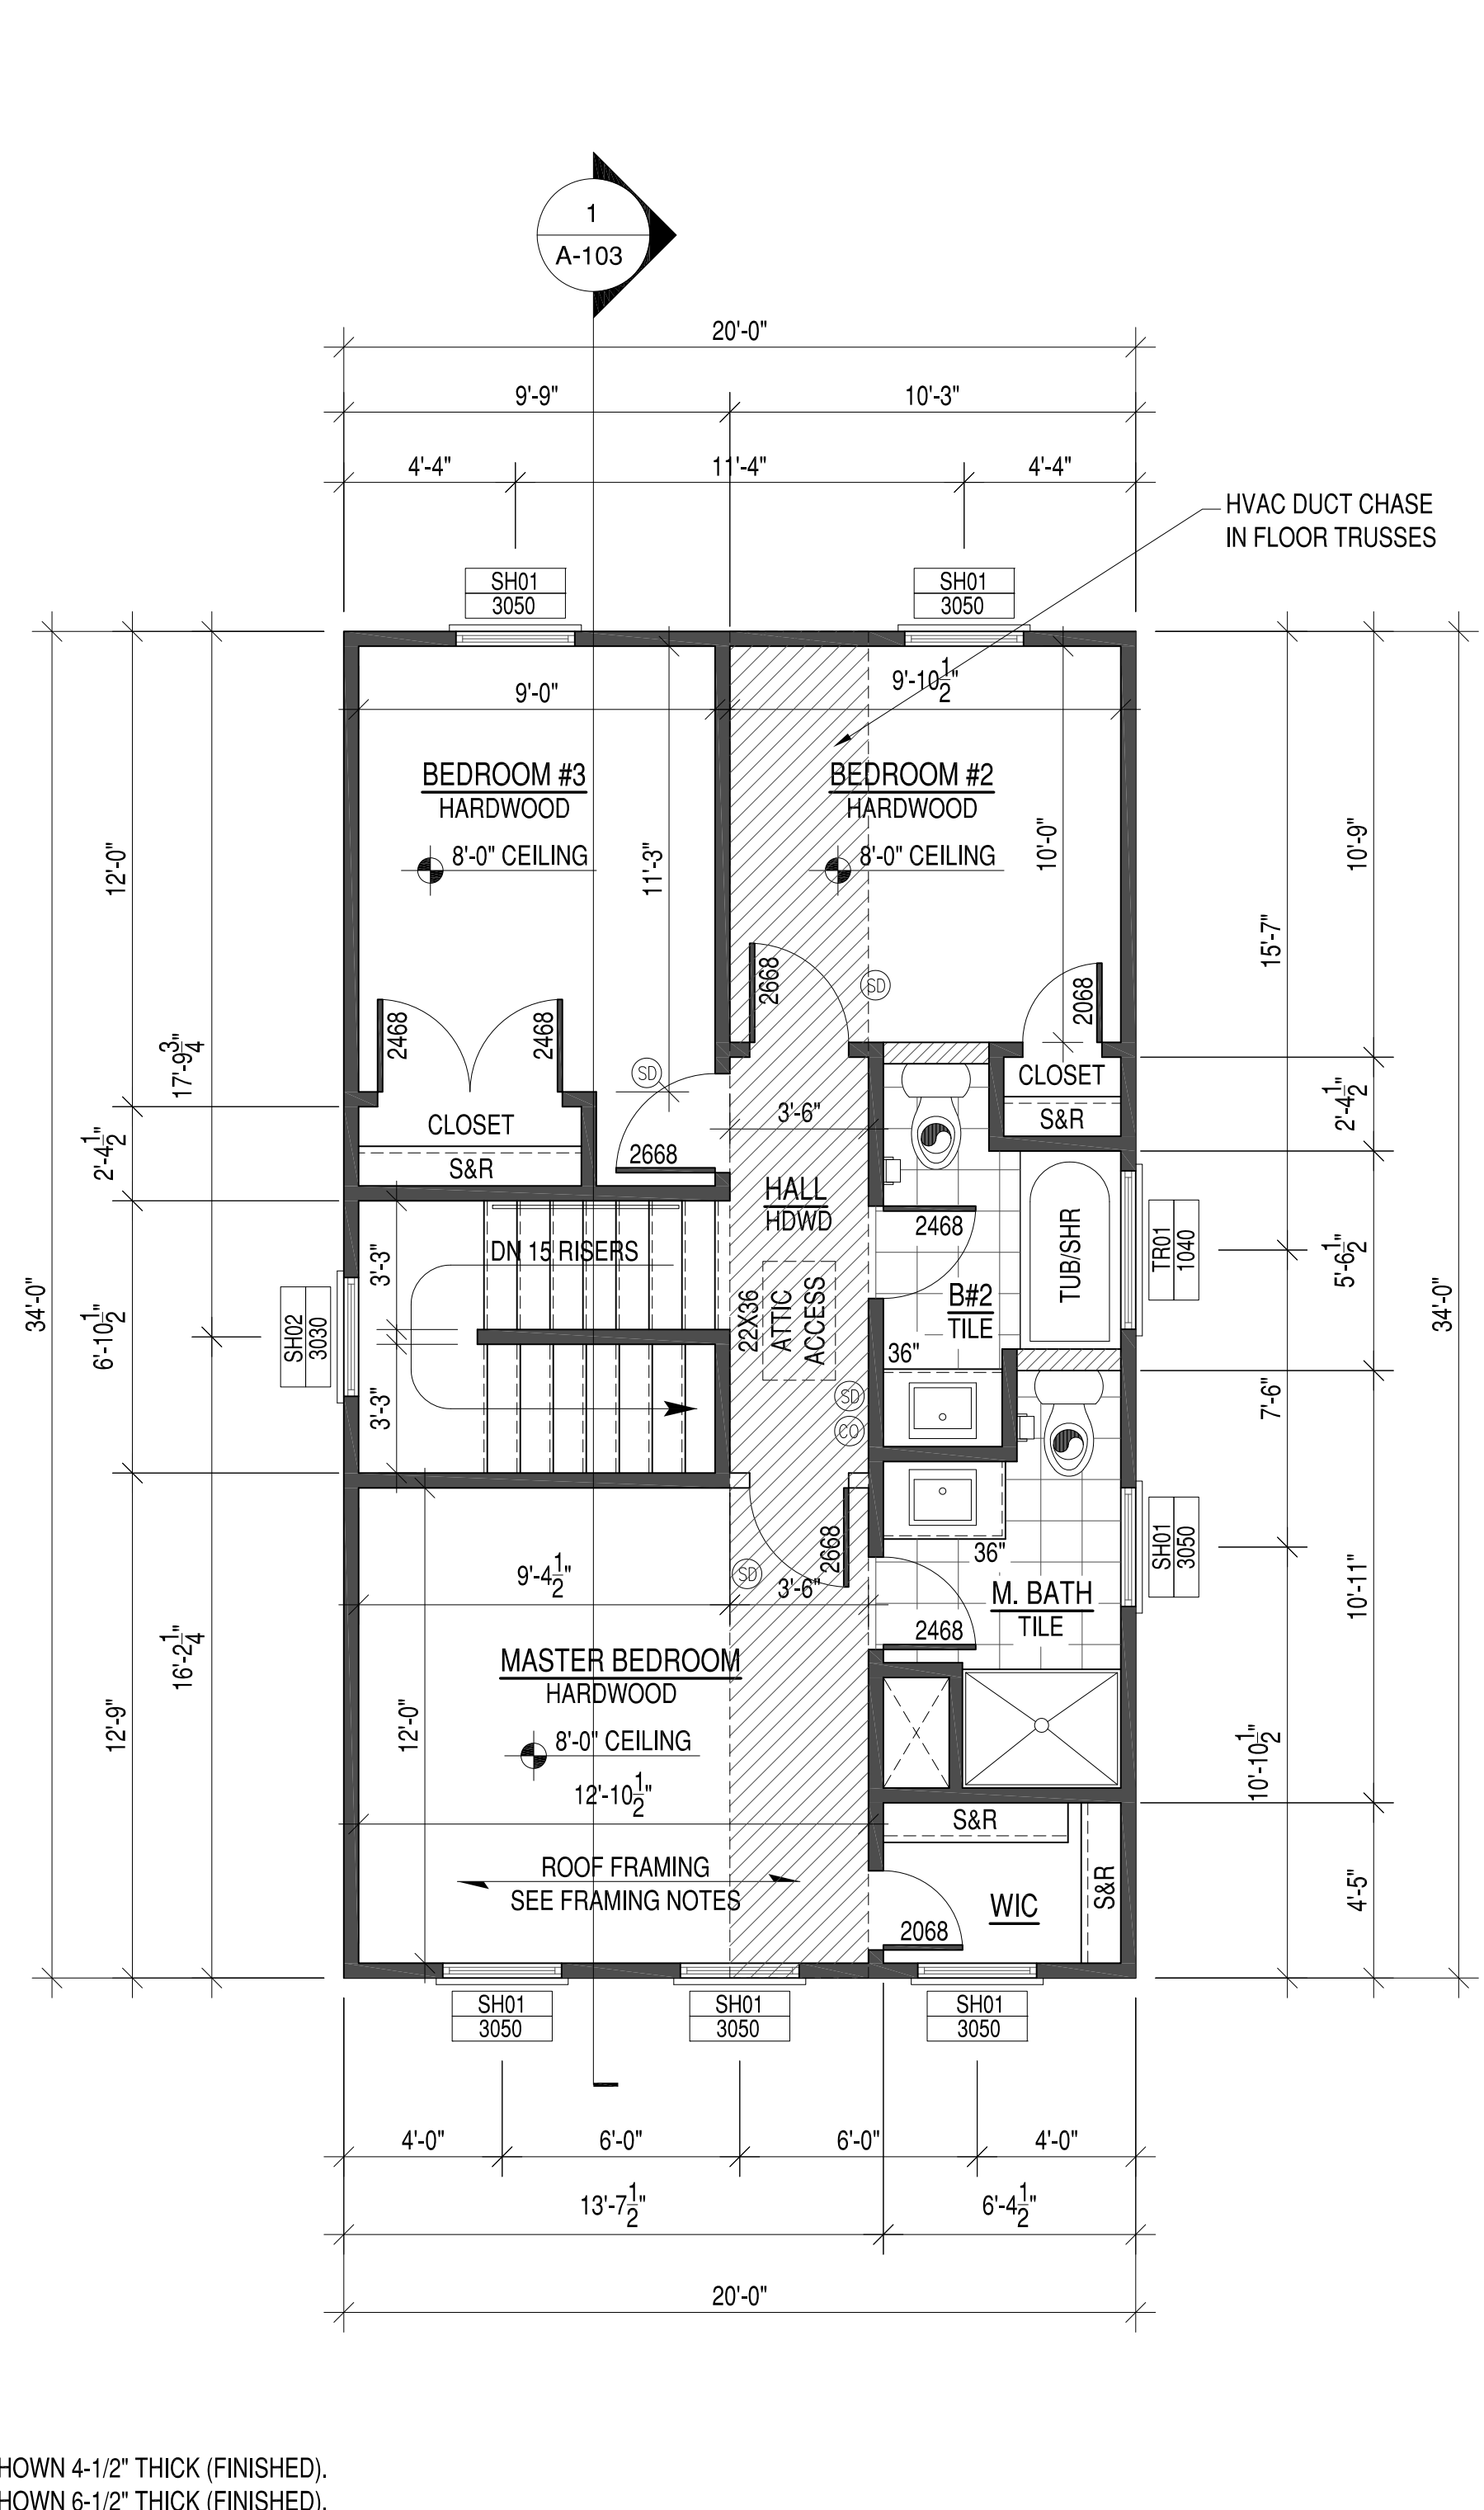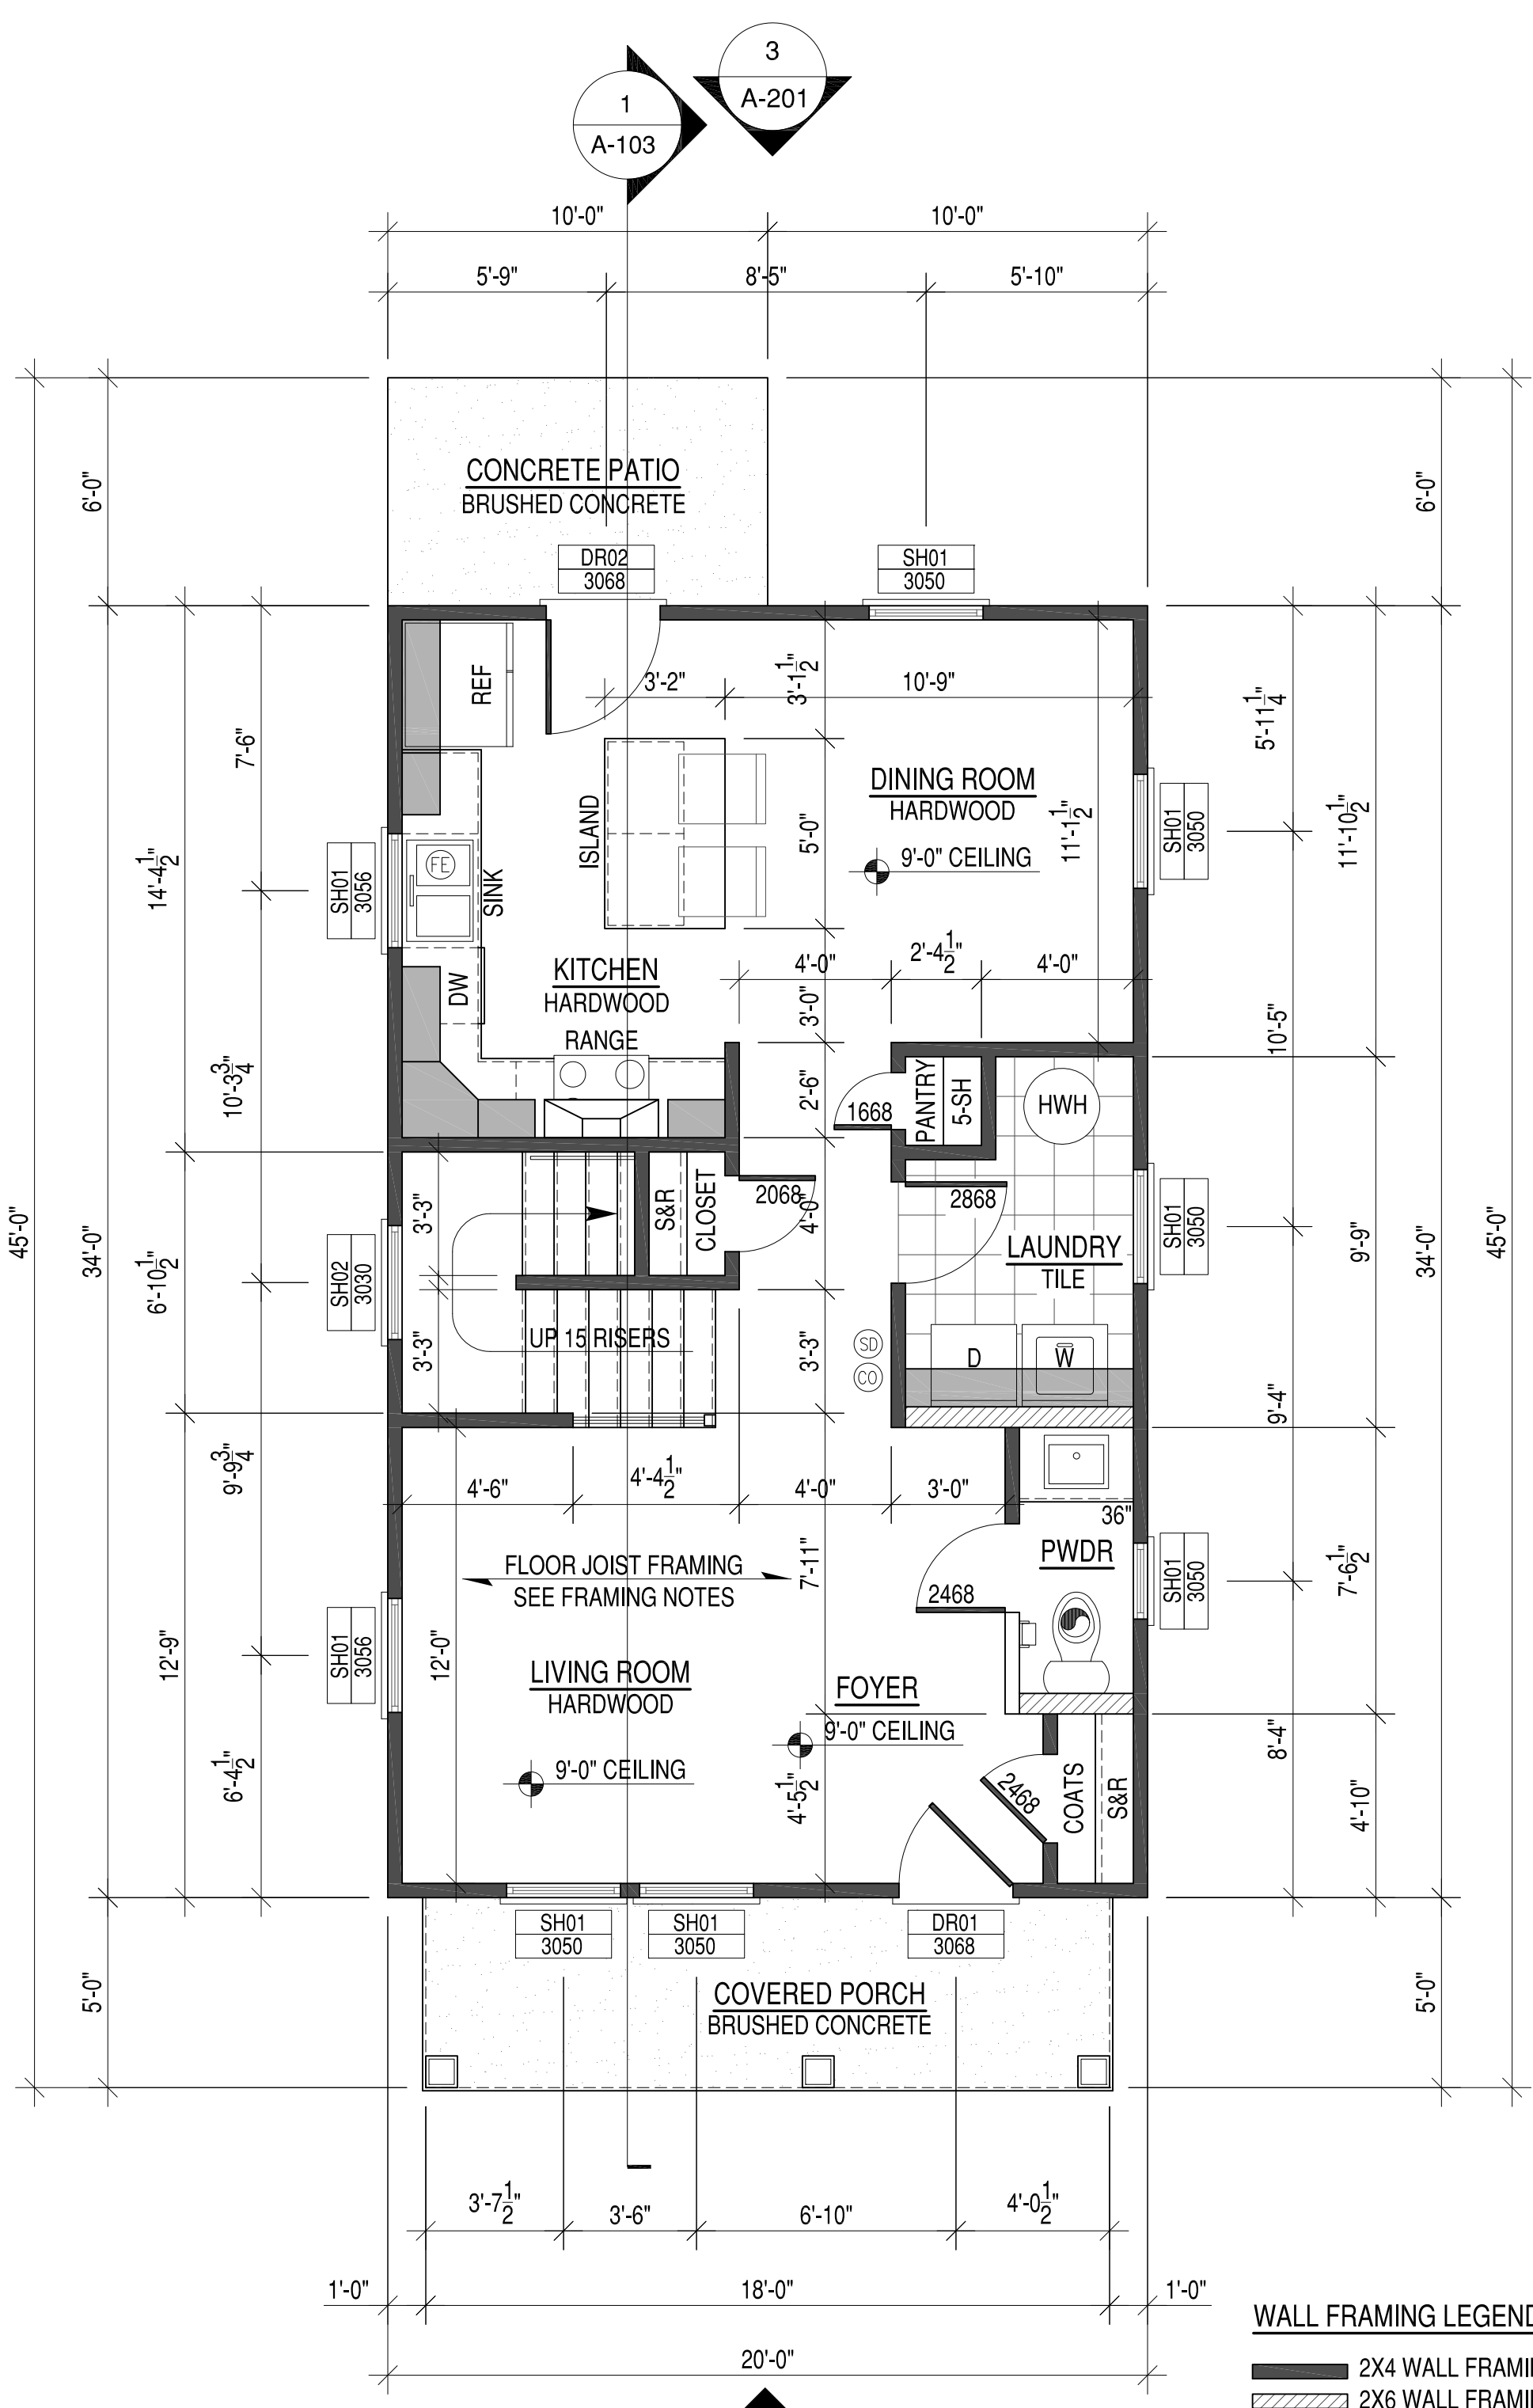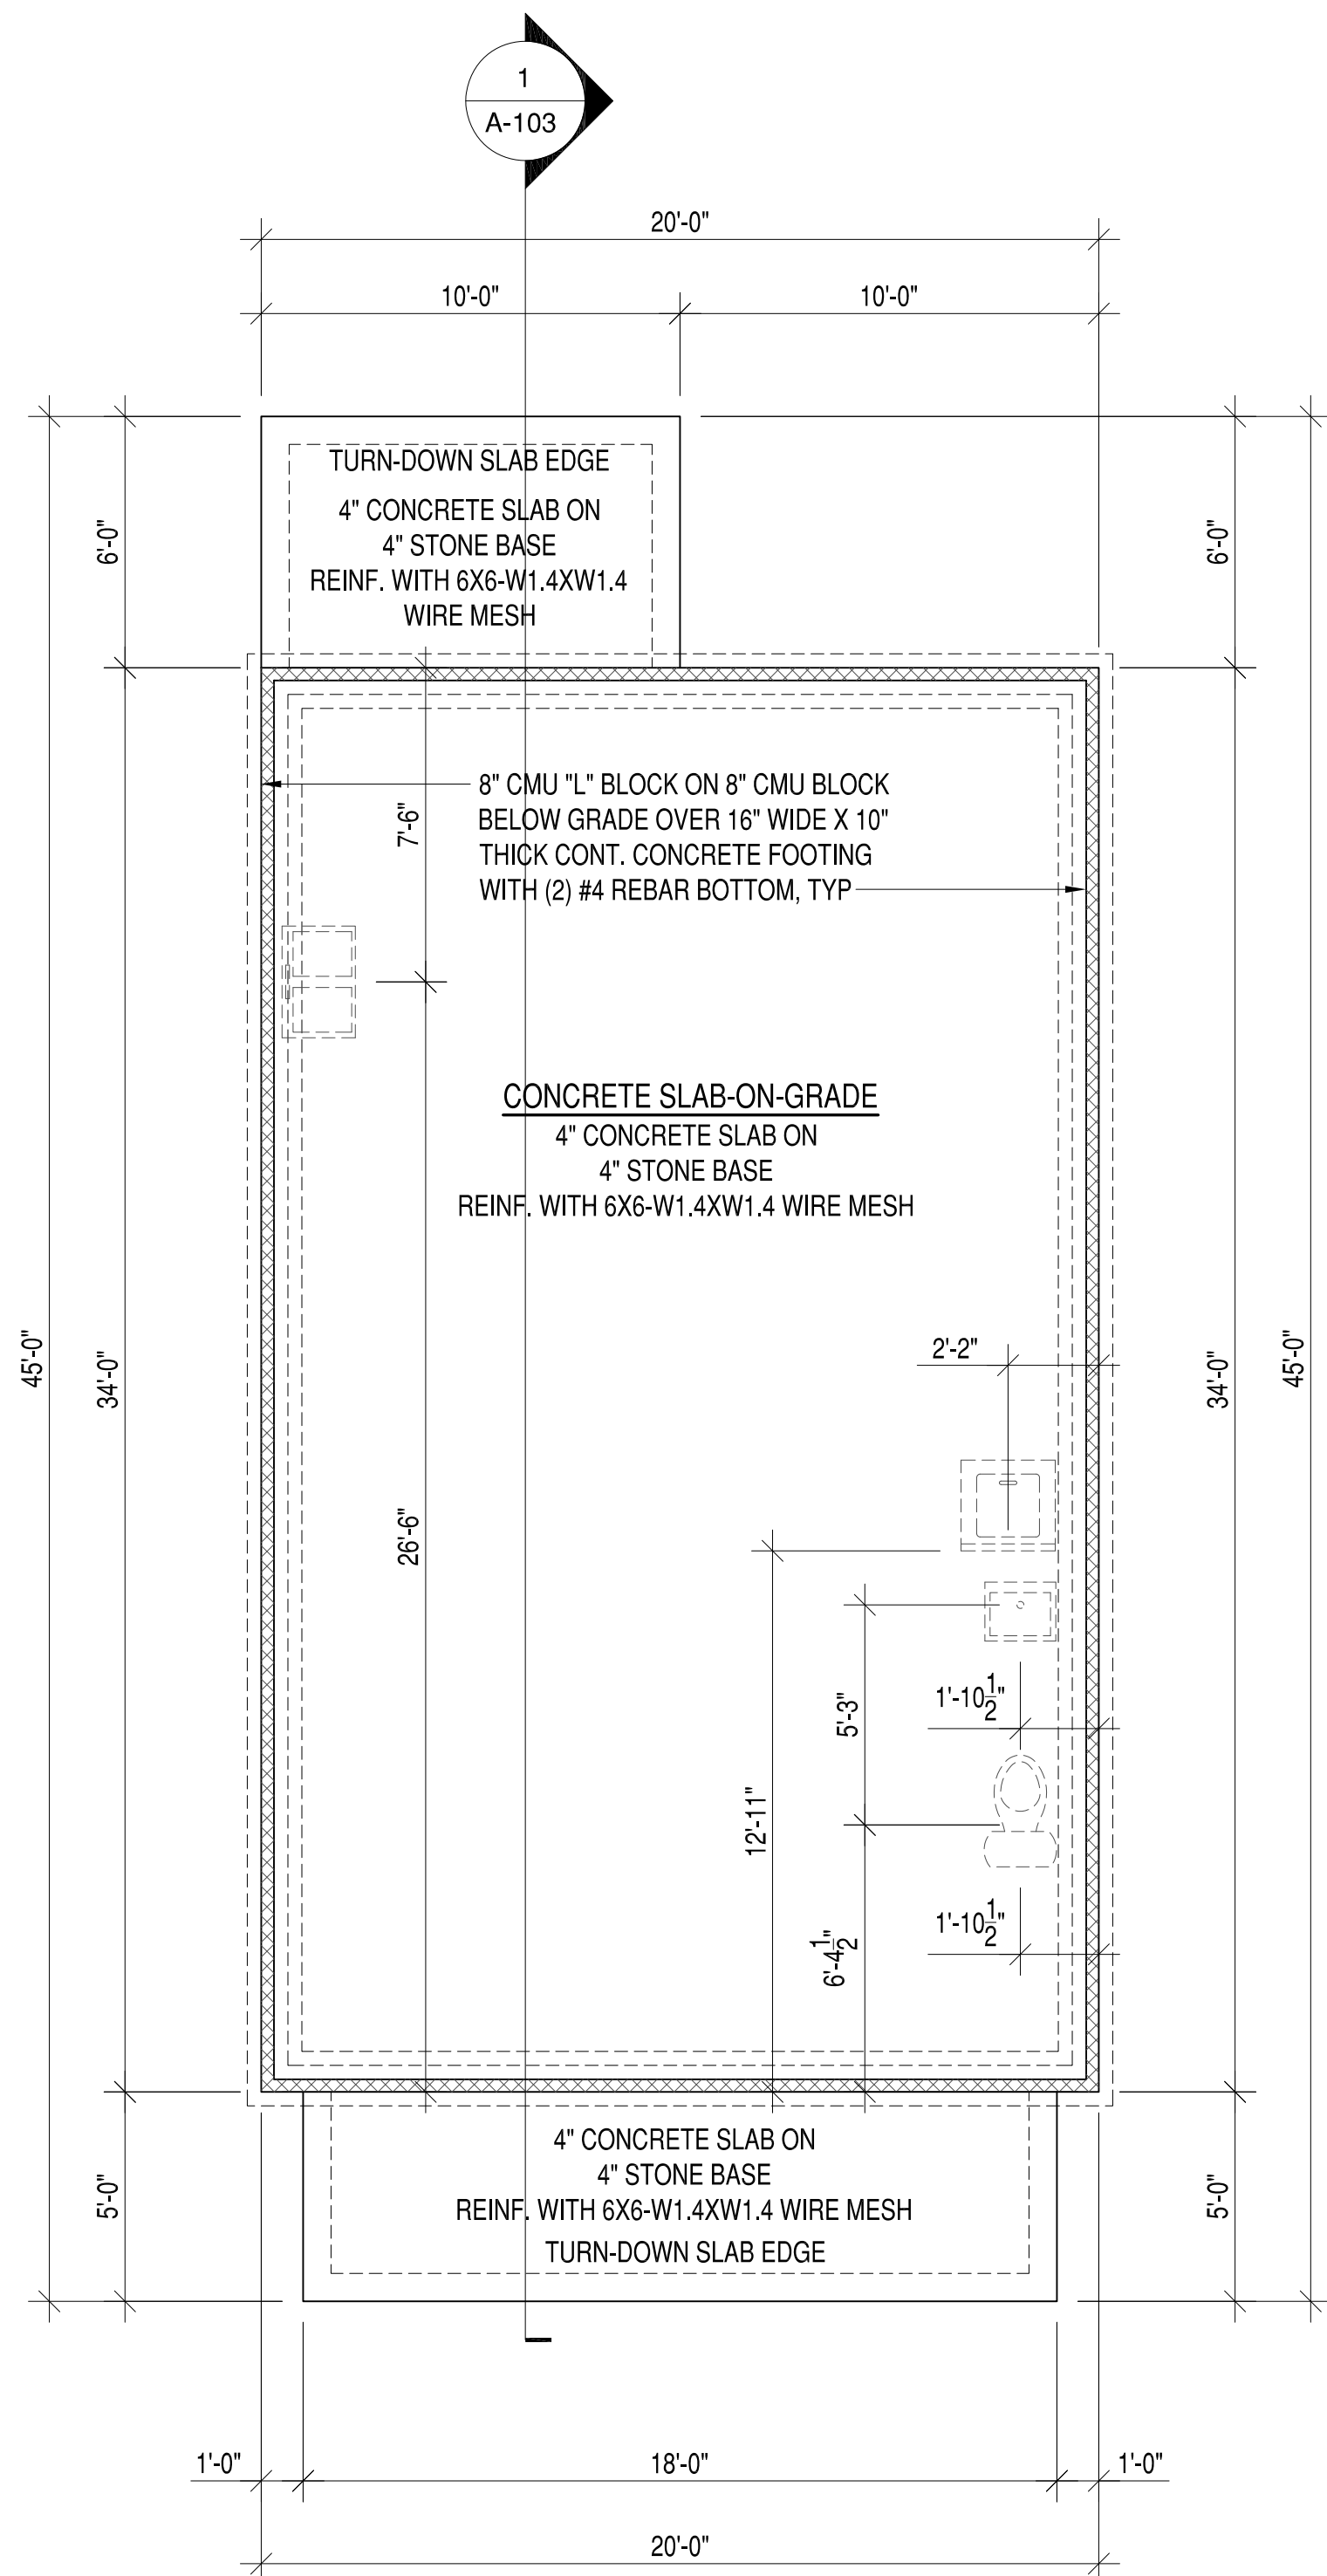

Project Location:
3917 Corbin St.
RVA 23227

GENERAL CONTRACTOR

APPROVED

ACTIVITY

SATISFACTORY TO DATE

DES: [Signature] | DRW: JRP3 | CHK: JRP3

NEW SINGLE FAMILY RESIDENCE

FOUNDATION, FIRST AND SECOND FLOOR PLAN

SCALE: 1/4"=1'-0"

PROJECT NO.: 2019-01


CONSTR. CONTR. NO.

DRAWING NO.

SHEET OF

A-101

NO.	DESCRIPTION	DATE	APPRO.
2	FINAL PERMIT PLANS	10-18-2020	
1	CLIENT REVIEW	10-15-2020	

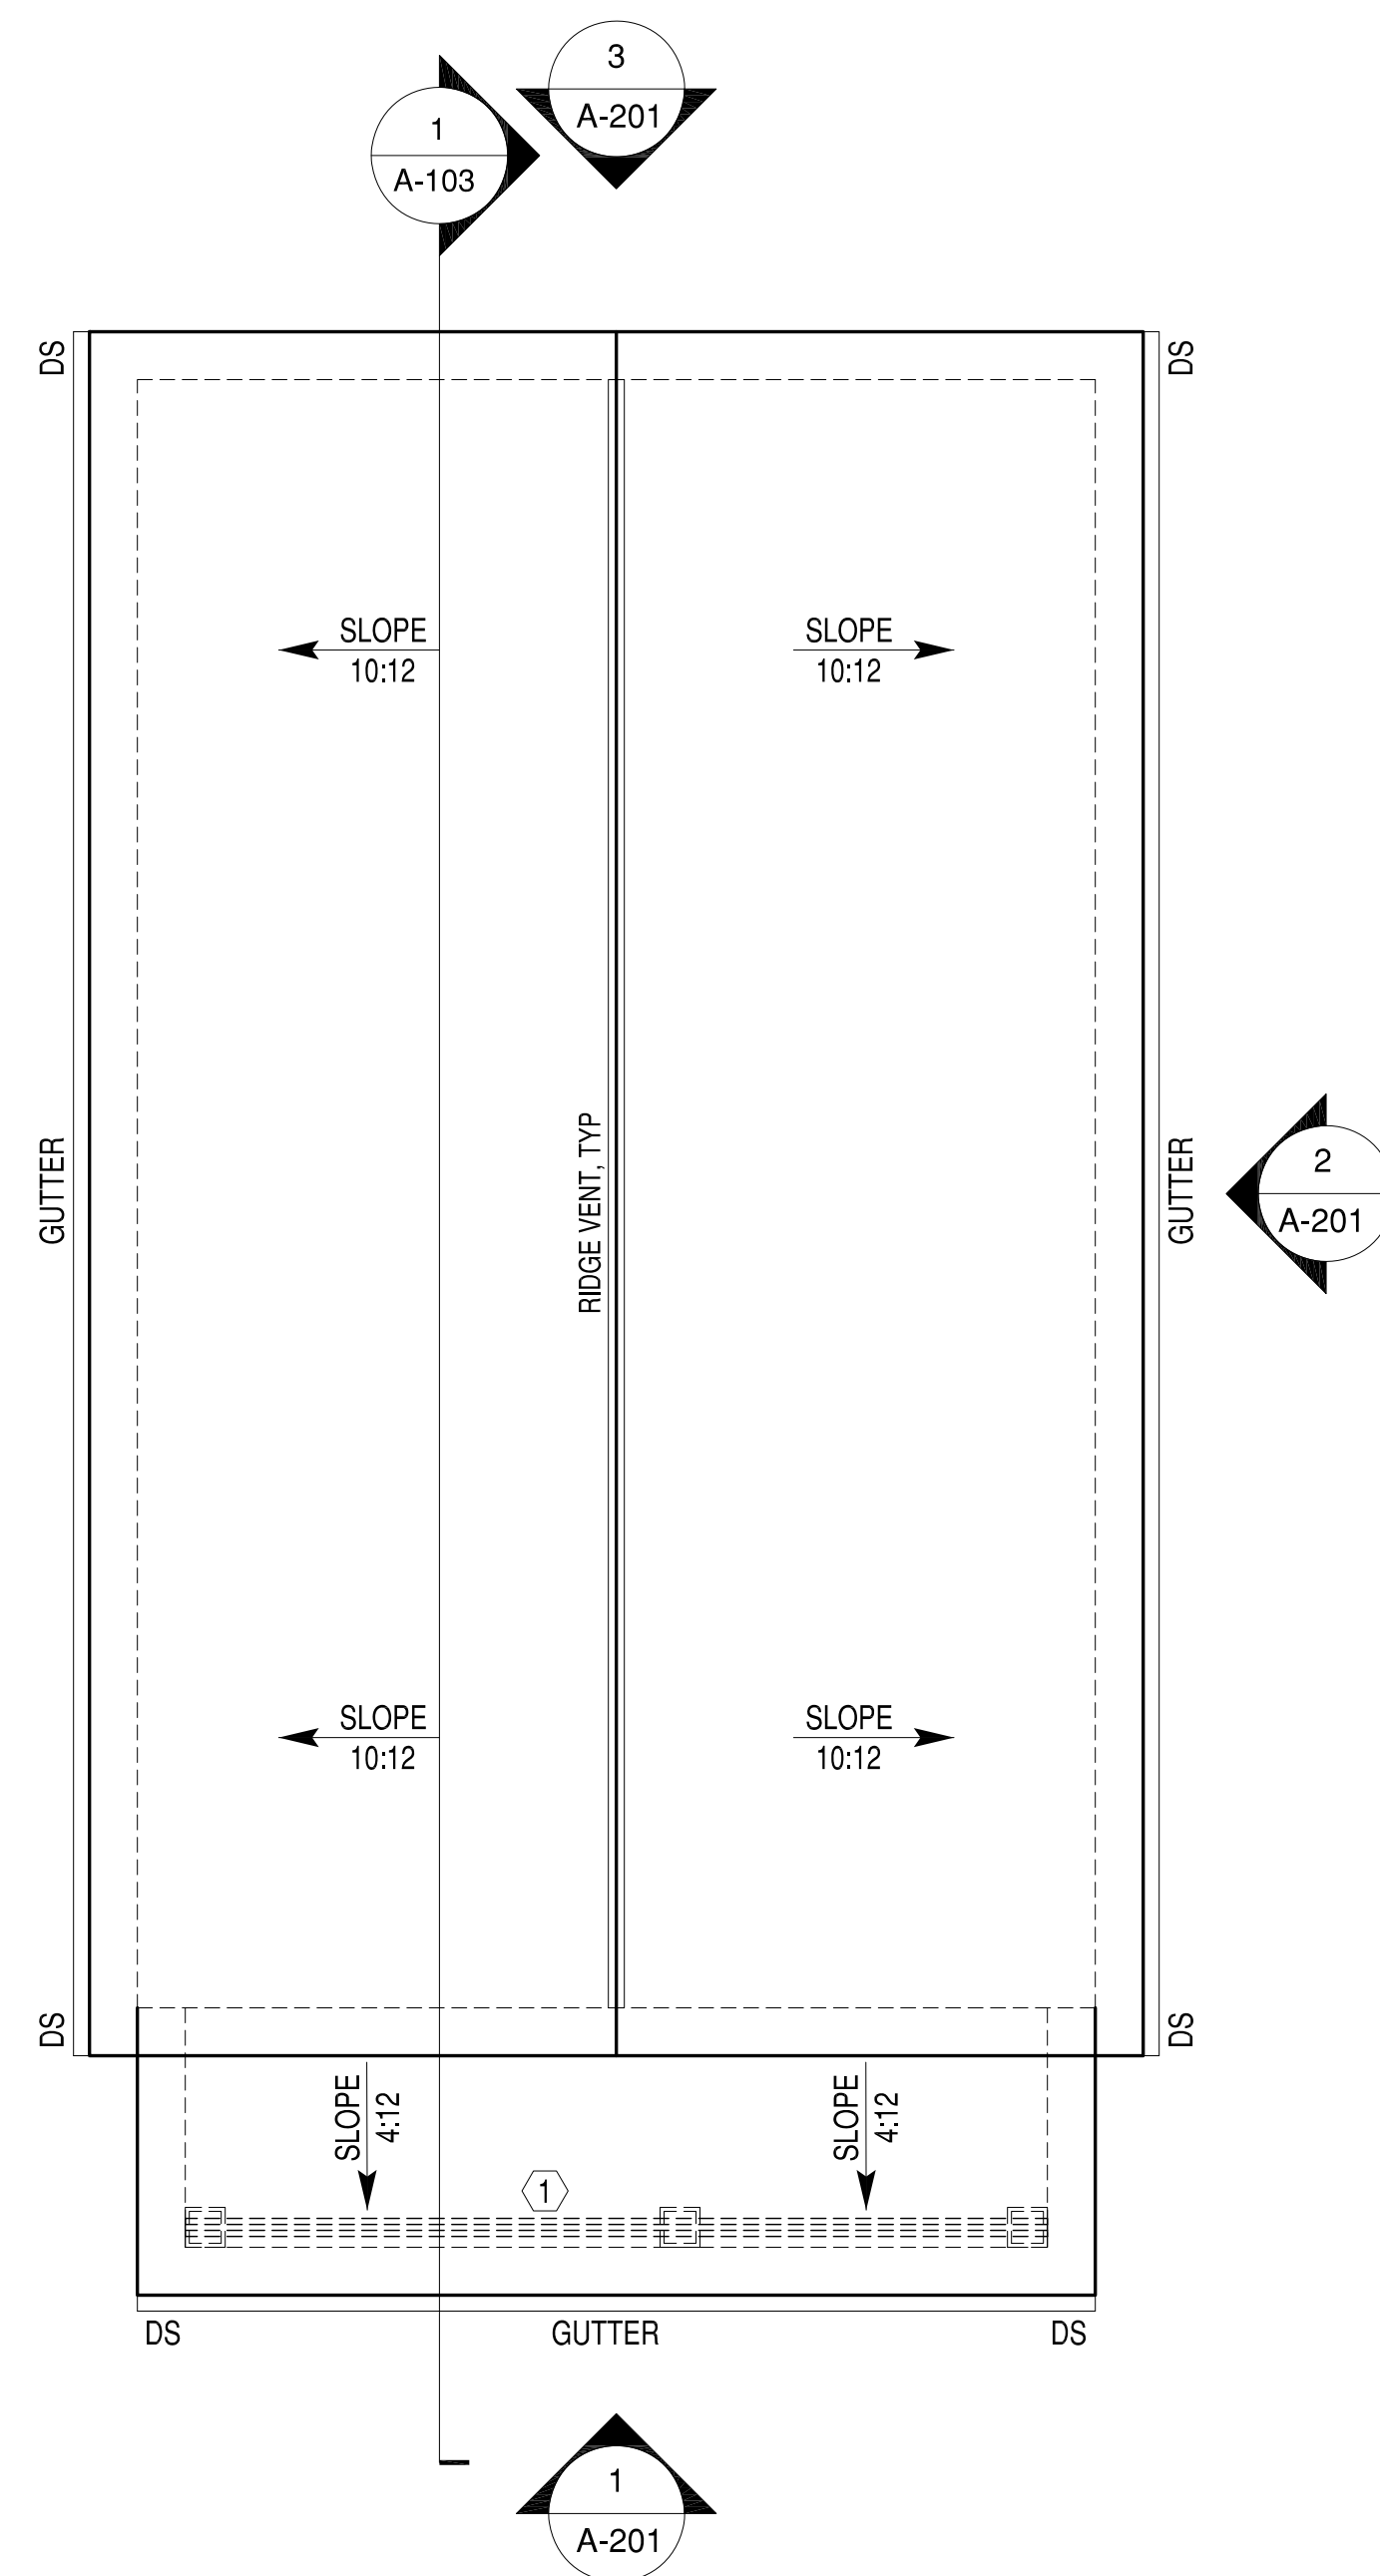

ATTIC AREA VENTILATION CALCULATIONS PER UNIT	
ATTIC AREA: 1565 SQ.FT. / 300*144 = 751 SQ. IN. NET FREE AREA REQUIRED (50% MIN AT RIDGE)	
RIDGE VENT:	20 L.F. X 18 SQ. IN. PER LINEAR FOOT = 360 SQ. IN. PROVIDED
SOFFIT VENT:	146 L.F. X 5.867 SQ. IN. PER LINEAR FOOT = 856 SQ. IN. PROVIDED
TOTAL NET FREE ARE PROVIDED = 1,216 SQ. IN.	
POWER VENT = (1) 12" AIRVENT, INC POWERCOOL PLUS 12 AUTOMATIC THERMOSTAT W/ HUMIDSTAT VENT FOR UP TO 1,650 SF OF ATTIC SPACE, INSTALL MULTIPLE VENTS FOR ADDITIONAL AREA. IF INSTALLING POWER VENT, DO NOT INSTALL RIDGE VENT	

PRE-ENGINEERED, PRE-FABRICATED WOOD TRUSSES

- THE DESIGN, FABRICATION AND INSTALLATION OF ALL PRE-ENGINEERED, PRE-FABRICATED WOOD TRUSSES SHALL CONFORM TO THE LATEST, ADOPTED EDITIONS OF THE STANDARDS AND MATERIAL SPECIFICATIONS REFERENCED HEREIN.
- REFERENCE STANDARDS
 - NDS "NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION" BY THE AMERICAN FOREST & PAPER ASSOCIATION (AF&PA).
 - TP-1, "DESIGN STANDARDS FOR METAL PLATE CONNECTED WOOD TRUSS CONSTRUCTION" BY THE TRUSS PLATE INSTITUTE.
- MATERIALS
 - THE TERM "TRUSS" USED IN THIS SECTION APPLIES TO TRUSSES THAT ARE DESIGNED AND FABRICATED AS SEPARATE ENGINEERED PRODUCTS, AND DELIVERED TO THE PROJECT SITE FOR INSTALLATION.
 - LUMBER: SPECIES PER DESIGN BY THE TRUSS MANUFACTURER, NO.2 GRADE OR BETTER, 15% MAXIMUM M.C., EXCEPT THE TRUSS MANUFACTURER MAY USE STUD-GRADE FOR WEB MEMBERS.
- DESIGN
 - THE TRUSS MANUFACTURER SHALL DESIGN, DETAIL, PROVIDE AND INSTALL ALL INTERNAL TRUSS COMPONENT CONNECTIONS.
 - THE TRUSS MANUFACTURER SHALL DESIGN AND DESIGNATE ALL TRUSS-TO-TRUSS HANGERS. THE CONTRACTOR SHALL FURNISH AND INSTALL ALL TRUSS-TO-TRUSS HANGERS IN ACCORDANCE WITH THE HANGER MANUFACTURER'S SPECIFICATIONS.
 - METAL CONNECTOR PLATES: USE GALVANIZED SHEET STEEL CONFORMING WITH ASTM A653, COATING CLASS G60. MANUFACTURE WITH HOLES, PLUGS, TEETH, OR PRONGS UNIFORMLY SPACED AND FORMED.
 - IN ADDITION TO THE UNIFORM LOADS INDICATED BELOW, DESIGN TRUSSES FOR ALL SUPERIMPOSED DEAD LOADS INCLUDING BUT NOT LIMITED TO OVERLAY FRAMING, CHIMNEYS, MECHANICAL EQUIPMENT, ETC. DESIGN TRUSSES AND REQUIRED BRACING TO RESIST THE NET WIND UPLIFT INDICATED ON THE DRAWINGS.
 - DESIGN OF MEMBERS AND CONNECTIONS SHALL BE PERFORMED BY A PROFESSIONAL ENGINEER, REGISTERED IN THE DISTRICT OF COLUMBIA, EXPERIENCED IN SIMILAR DESIGN, RETAINED BY THE MANUFACTURER.
 - DESIGN BOTTOM CHORDS OF GIRDER TRUSSES FOR THE END REACTIONS OF SUPPORTED TRUSSES.
 - DESIGN ALL TRUSSES FOR ADDITIONAL SERVICE LOADS INDICATED ON PLAN.
- DESIGN LOADS
 - ROOF
 - TOP CHORD DEAD LOAD = 10 PSF
 - TOP CHORD LIVE LOAD = 20 PSF
 - BOTTOM CHORD DEAD LOAD = 10 PSF
 - BOTTOM CHORD LIVE LOAD = 0 PSF
 - WIND LOADING: SEE DESIGN LOADS SECTION ON SHEET S 001
 - NET WIND UPLIFT = 8 PSF
 - DEFLECTIONS
 - ROOF
 - MAXIMUM LIVE LOAD DEFLECTION = L/360, OR .625" MAXIMUM
 - MAXIMUM TOTAL LOAD DEFLECTION = L/240, OR 1.0" MAXIMUM
 - DESIGN ALL BRACING AND BRACING CONNECTIONS FOR ALL TRUSS TO CHORDS, BOTTOM CHORDS AND WEB MEMBERS. PARTICULAR ATTENTION SHALL BE GIVEN TO AREAS IN THE FINISHED STRUCTURE WHICH CONTAIN TRUSSES WITH UN-SHEATHED TOP AND/OR BOTTOM CHORD MEMBERS.
- SUBMITALS
 - SUBMIT TRUSS SHOP DRAWINGS WHICH EXHIBIT THE SEAL OF THE ENGINEER RESPONSIBLE FOR TRUSS DESIGN.
 - SUBMIT LAYOUT DRAWING WHICH INDICATES THE LOCATION OF EACH TRUSS.
 - SUBMIT HANGER CONNECTOR TYPES AND LOCATIONS.
 - INDICATE ALL TEMPORARY AND PERMANENT BRACING REQUIREMENTS OF TRUSS MEMBERS. IN AREAS WHERE TRUSS TOP CHORDS AND/OR BOTTOM CHORDS DO NOT RECEIVE SHEATHING, INDICATE THE REQUIRED CHORD BRACING AND BRACE SPACINGS FOR ALL APPLICABLE LOAD CASES. INDICATE ANCHORAGE OF "CAP" TRUSSES AND/OR "OVERLAY" TRUSSES.

ROOF PLAN
SCALE: 1/4"=1'-0"

- PLAN NOTES
- ROOF FRAMING TO BE PRE-ENGINEERED ROOF TRUSSES AT 24" OC, TYP UNLESS OTHERWISE NOTED.
 - 12" OVERHANGS AND 12" GABLE END EXTENSIONS, TYP.

MARK	BEAM SIZE	REMARKS
①	(3) SPF NO.2 2X10 OR BETTER	DROPPED GIRDER

EXTERIOR DOOR SCHEDULE						
MARK	DESCRIPTION	WIDTH	HEIGHT	OPERATION	HARDWARE	NOTES
DR01	FRONT ENTRY	3'-0"	6'-8"	SINGLE SWING DOOR	01	1/2 LITE STEEL DOOR
DR02	REAR ENTRY	3'-0"	6'-8"	SINGLE SWING DOOR	01	1/2 LITE STEEL DOOR

- DOOR NOTES:**
- GENERAL CONTRACTOR SHALL VERIFY ALL DOOR SCHEDULE INFORMATION PRIOR TO ORDERING DOORS AND FRAMES.
 - ALL EXTERIOR DOORS SHALL BE PROVIDED WITH WEATHERSTRIPPING AND THRESHOLD.
 - ALL SWING DOORS SHALL BE PROVIDED WITH HINGE-OR WALL-MOUNTED DOOR STOPS.
 - ALL GLASS IN DOORS AND TRANSOMS SHALL BE TEMPERED.

- DOOR HARDWARE SETS:**
- (3) HINGES, ENTRY HANDLE LOCK SET, DEAD BOLT.

WINDOW SCHEDULE						
MARK	DESCRIPTION	WIDTH	HEIGHT	HEADER HEIGHT	NOTES	
SH01	SINGLE HUNG	3'-0"	5'-0"	6'-8"	VINYL 1 OVER 1	
SH02	SINGLE HUNG	3'-0"	3'-0"	6'-8"	VINYL 1 OVER 1	
FIXED	FIXED WINDOW	3'-0"	2'-0"	SEE PLAN	VINYL 1 OVER 1	
TR01	TRANSOM	1'-0"	4'-0"	6'-8"	VINYL	

- WINDOW NOTES:**
- GENERAL CONTRACTOR SHALL VERIFY ALL WINDOW SCHEDULE INFORMATION PRIOR TO ORDERING WINDOWS AND FRAMES.
 - ALL WINDOWS NOMINAL. GENERAL CONTRACTOR TO VERIFY ACTUAL SIZES AND FRAMING REQUIREMENTS WITH WINDOW MANUFACTURER.
 - SECOND FLOOR WINDOWS REQUIRED FOR EMERGENCY EGRESS SHALL MEET THE REQUIREMENTS OF IRC R310.1, GENERALLY 20" MIN. CLEAR WIDTH, 24" MIN. CLEAR HEIGHT, AND 5.7 SQUARE FEET NET CLEAR OPENING.
 - NO WINDOW GLAZING SHALL BE WITHIN 18" OF FINISH FLOOR.
 - SAFETY GLAZING SHALL BE TEMPERED.

NO.	DESCRIPTION	DATE	APPRO.
2	FINAL PERMIT PLANS	10-18-2020	
1	CLIENT REVIEW	10-15-2020	

Project Location:
3917 Corbin St.
RVA 23227

WATCHTOWER
homes & construction

GENERAL CONTRACTOR

APPROVED

ACTIVITY

SATISFACTORY TO DATE

DES: JRP3 | CHK: JRP3

NEW SINGLE FAMILY RESIDENCE

ROOF PLAN & DOOR AND WINDOW SCHEDULE

SCALE: 1/4"=1'-0"

PROJECT NO.: 2019-01


CONSTR. CONTR. NO.

DRAWING NO.

SHEET OF

A-102

R VALUE	INSULATION LOCATION
R-15	EXTERIOR WALLS
R-19	FLOORS
R-30	CANTILEVERS & OVERHANGS
R-19	FLOOR ABOVE GARAGE
R-38	ALL CEILINGS

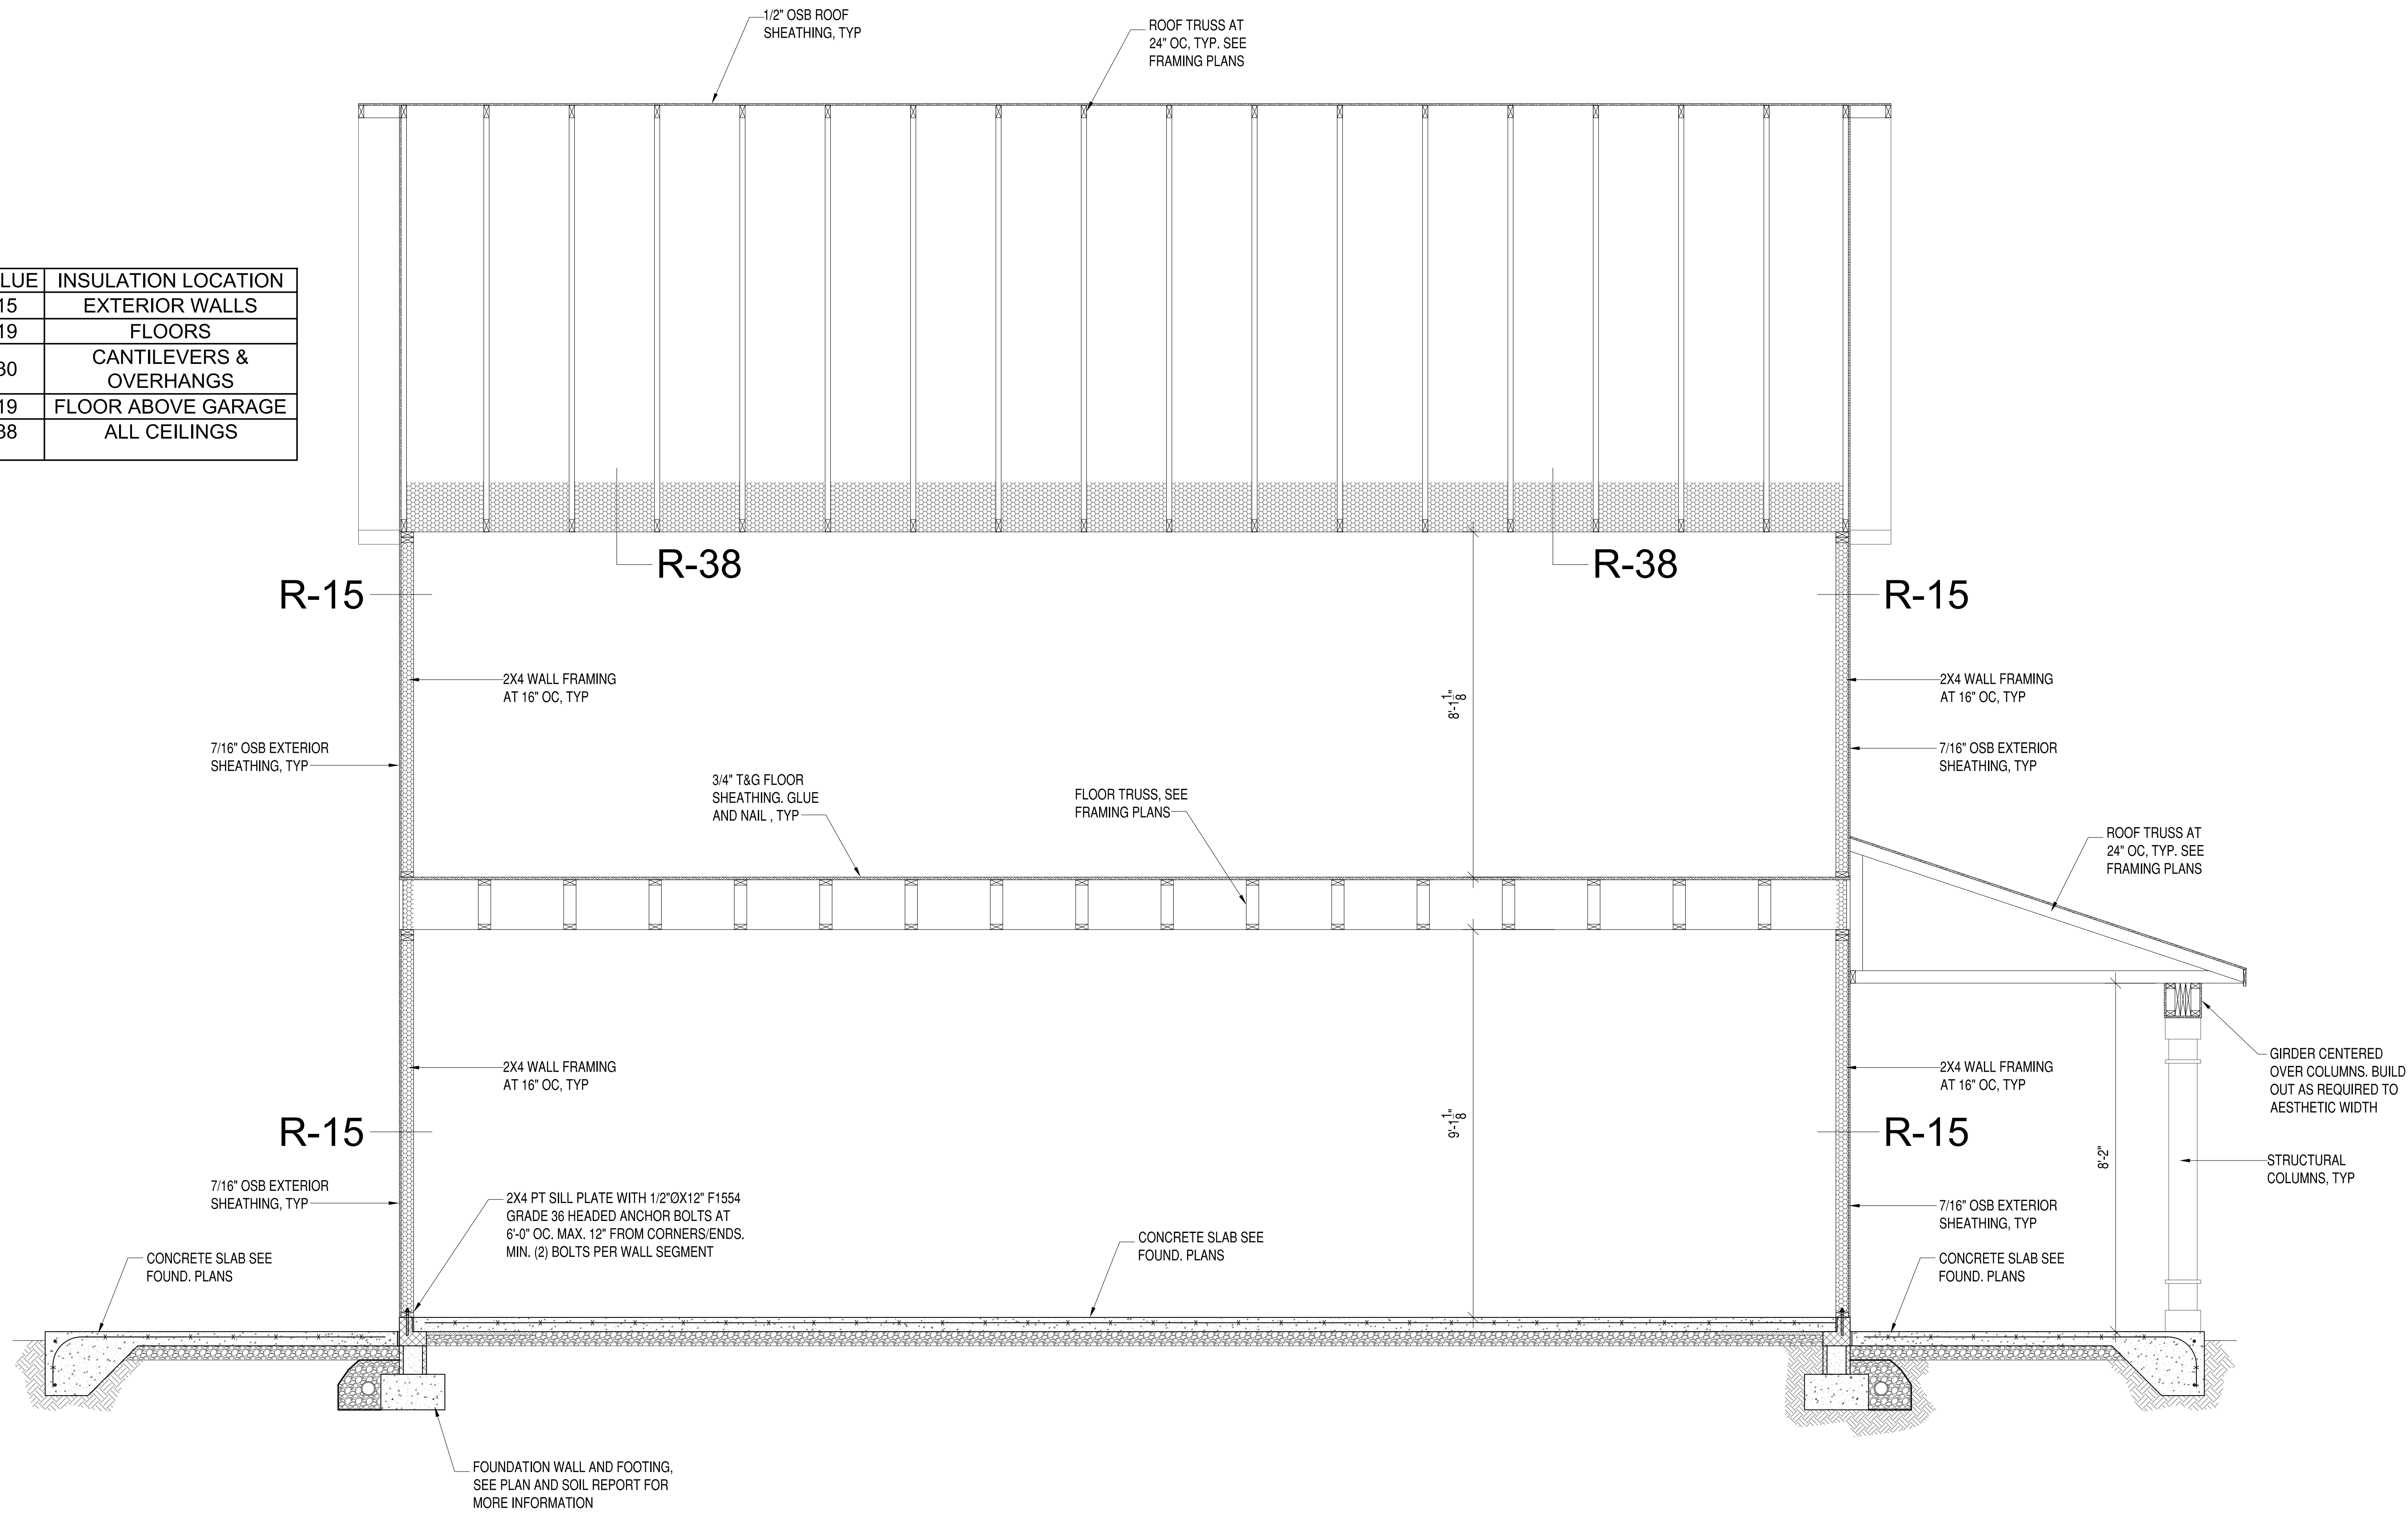

Project Location:
3917 Corbin St.
RVA 23227




NEW SINGLE FAMILY RESIDENCE


BUILDING SECTION

SCALE: 1/4"=1'-0"
PROJECT NO.: 2019-01
CONSTR. CONTR. NO.
DRAWING NO.
SHEET OF
A-103


NO.	DESCRIPTION	DATE	APPRO.
2	FINAL PERMIT PLANS	10-18-2020	
1	CLIENT REVIEW	10-15-2020	

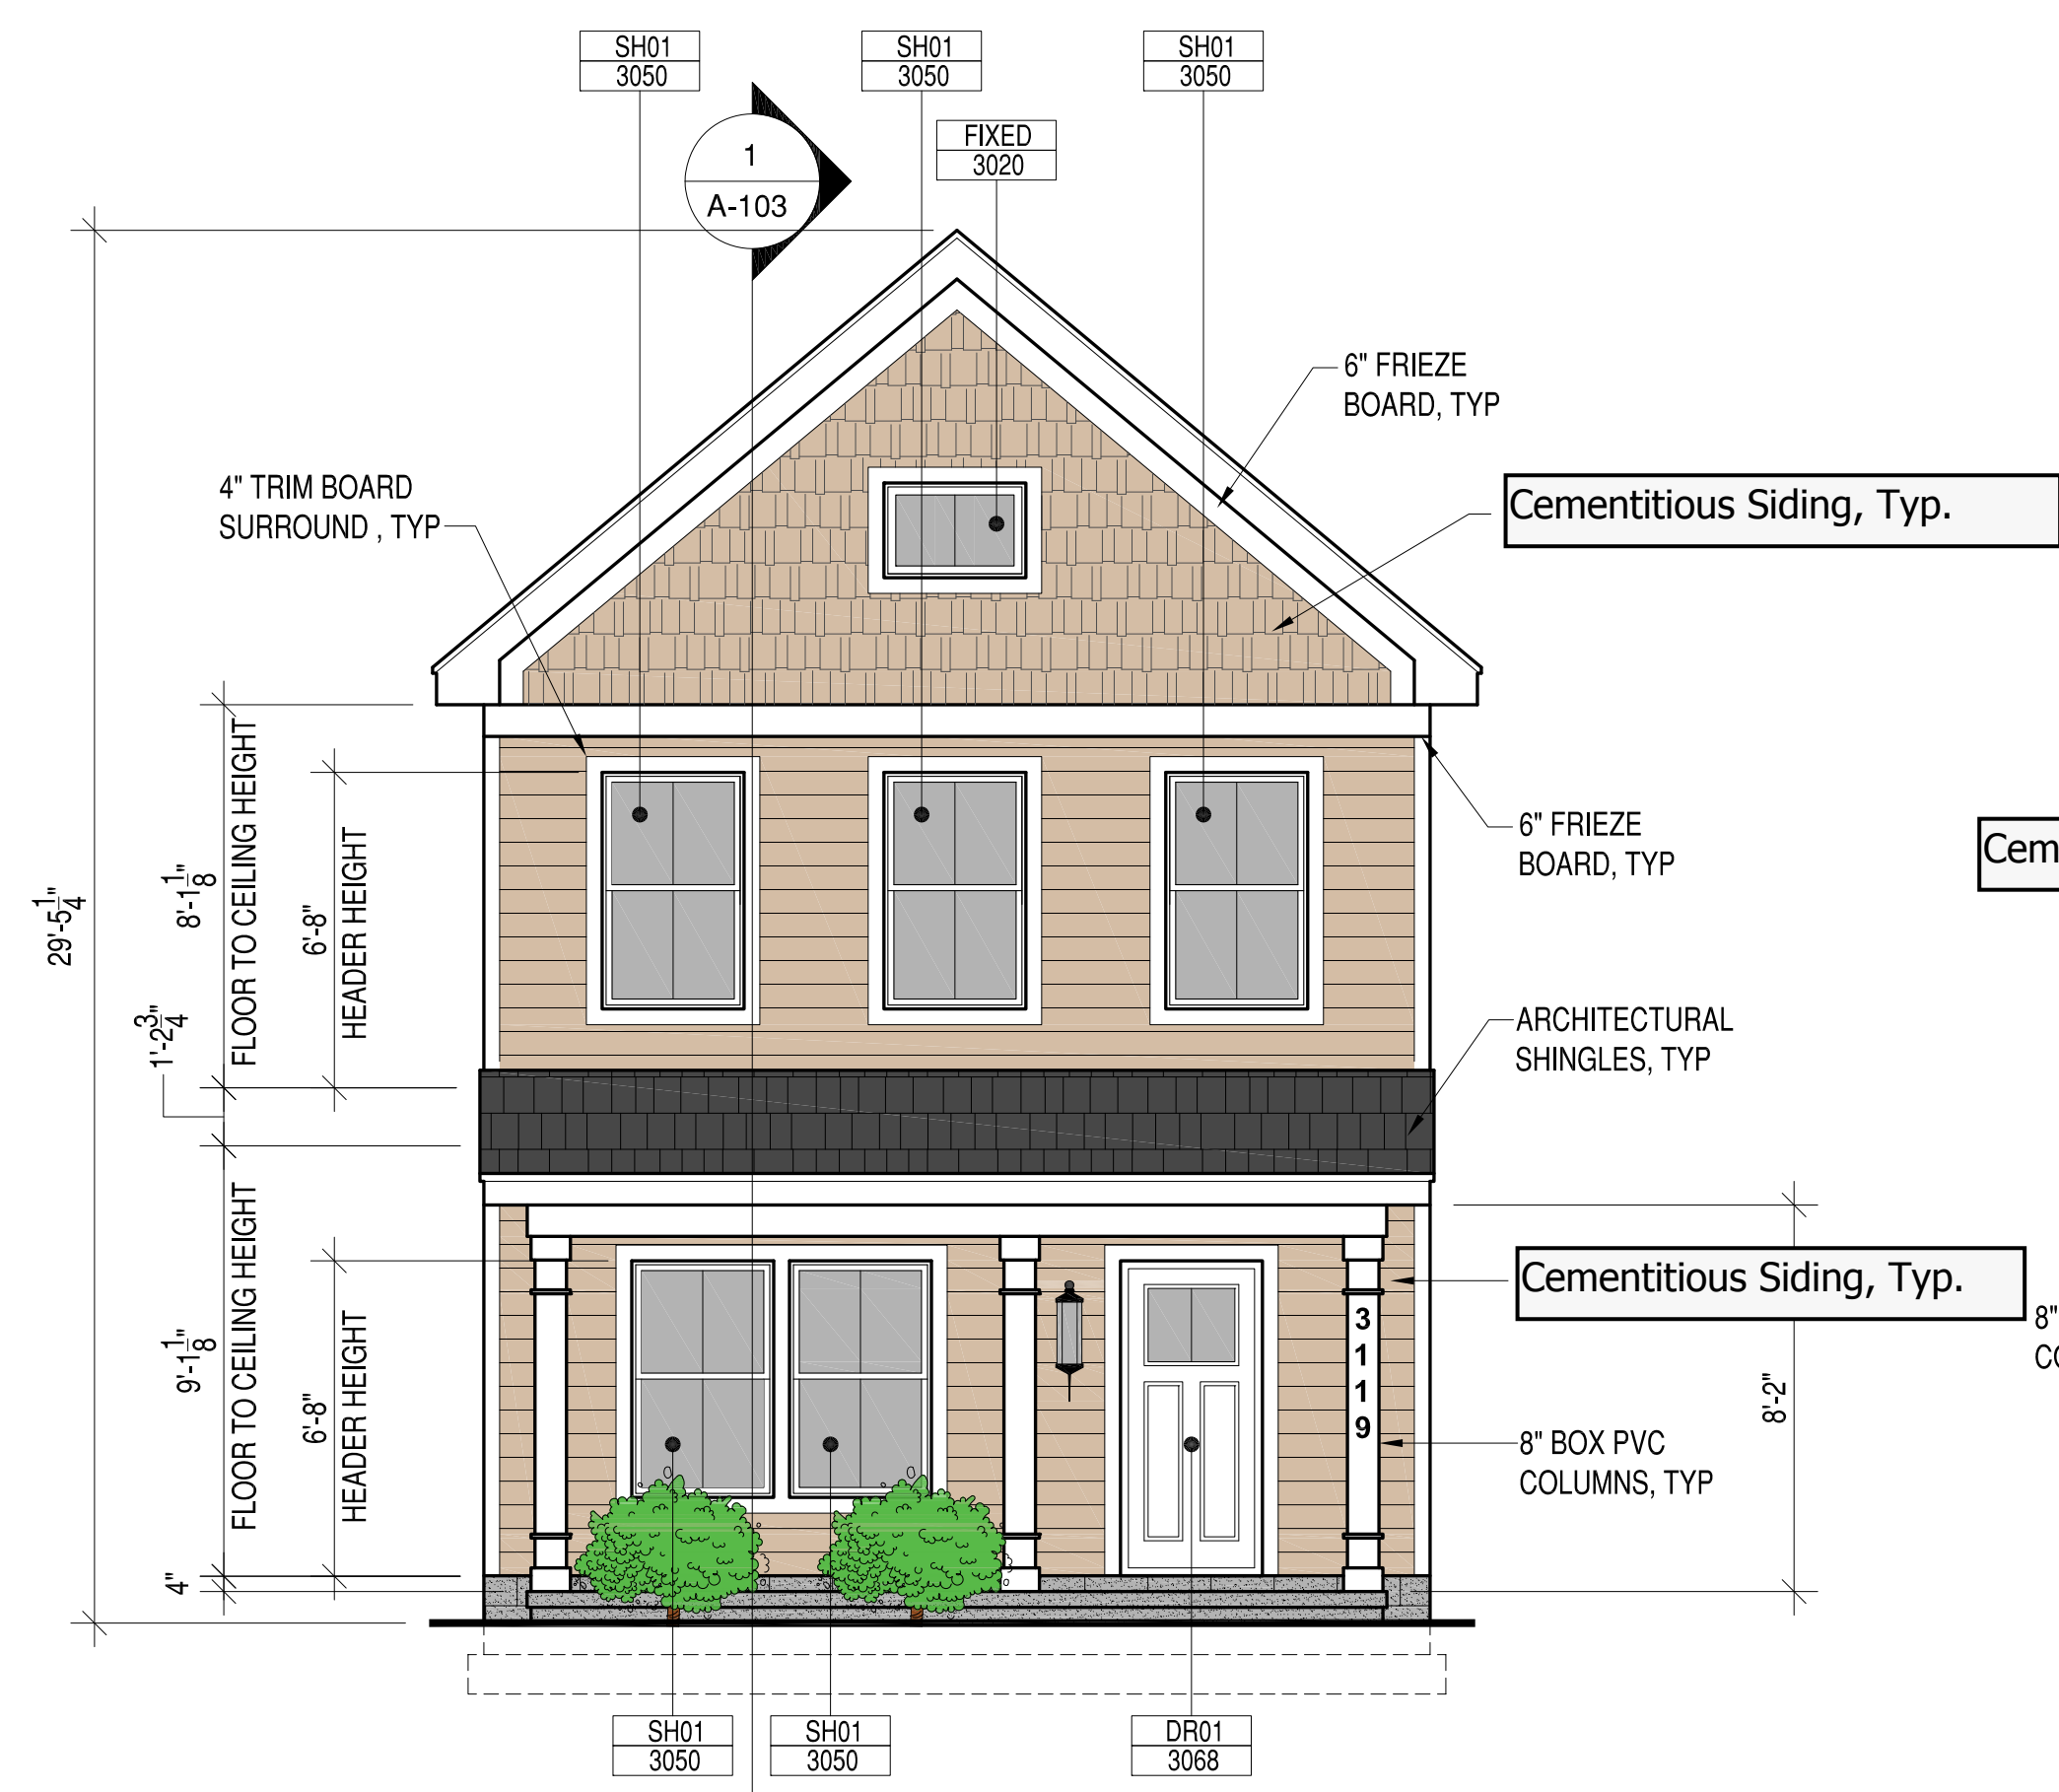


1 FRONT ELEVATION
A-201 SCALE: 1/4"=1'-0"

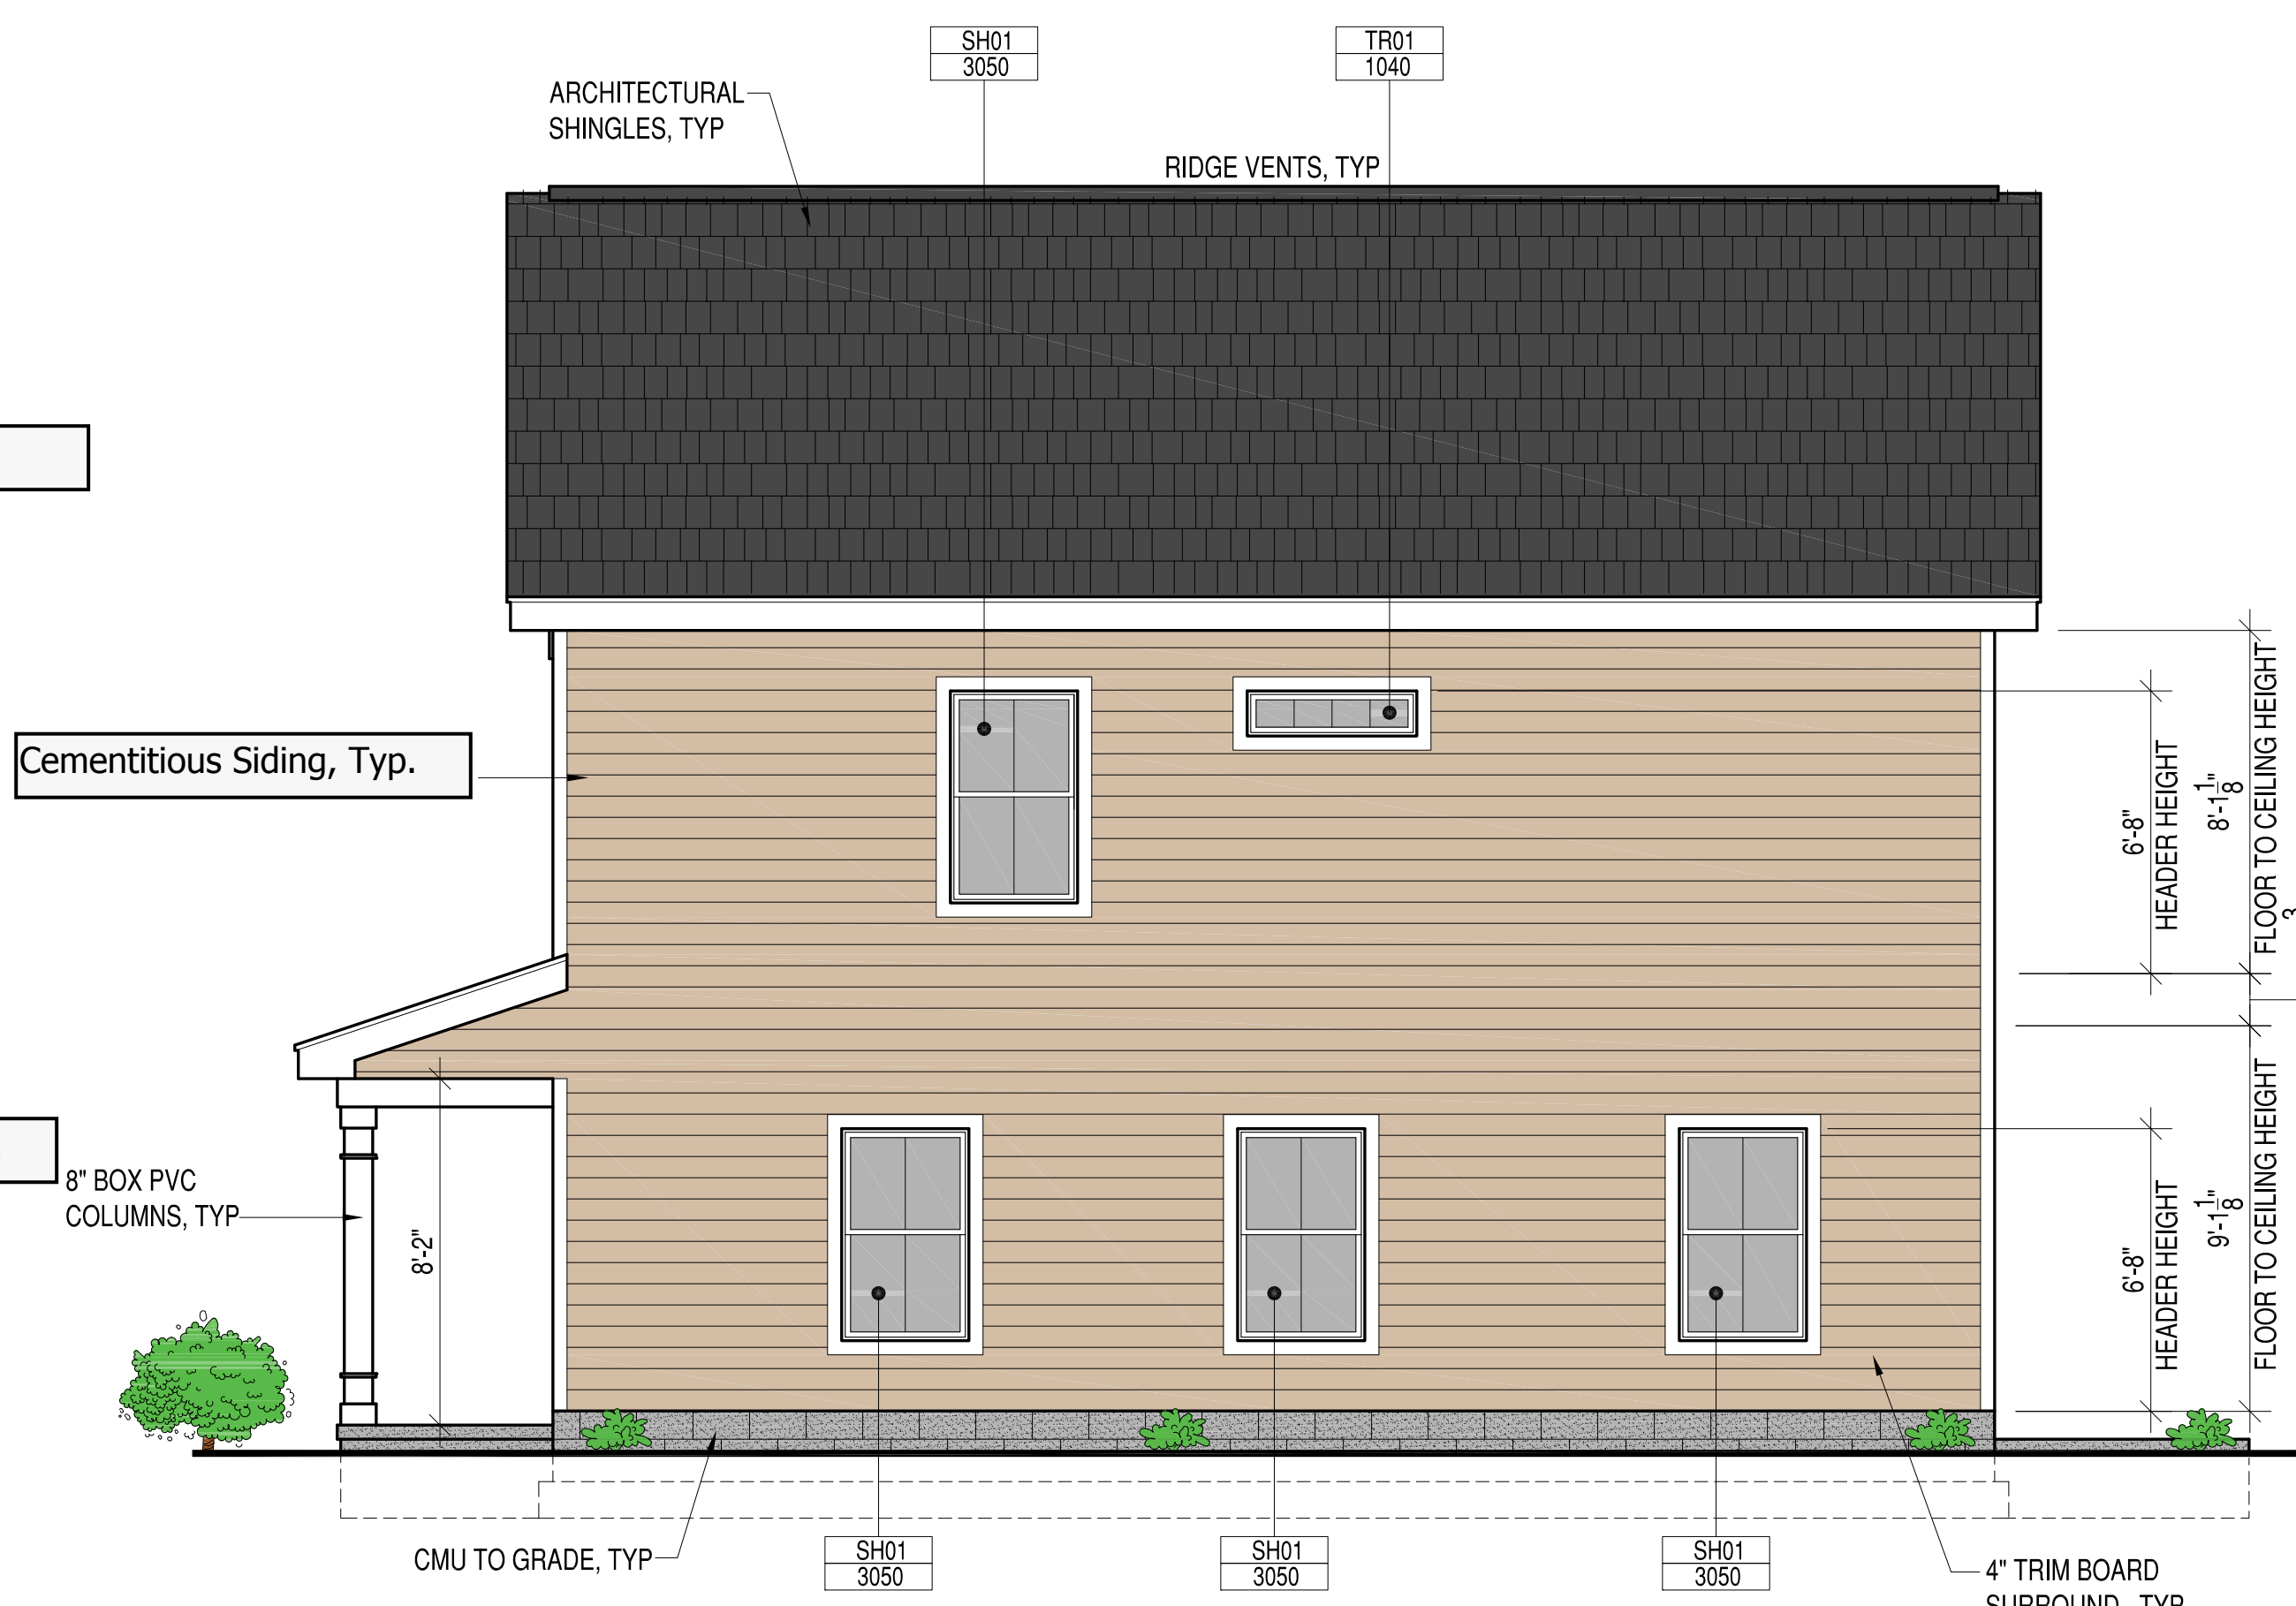

2 LEFT ELEVATION
A-201 SCALE: 1/4"=1'-0"

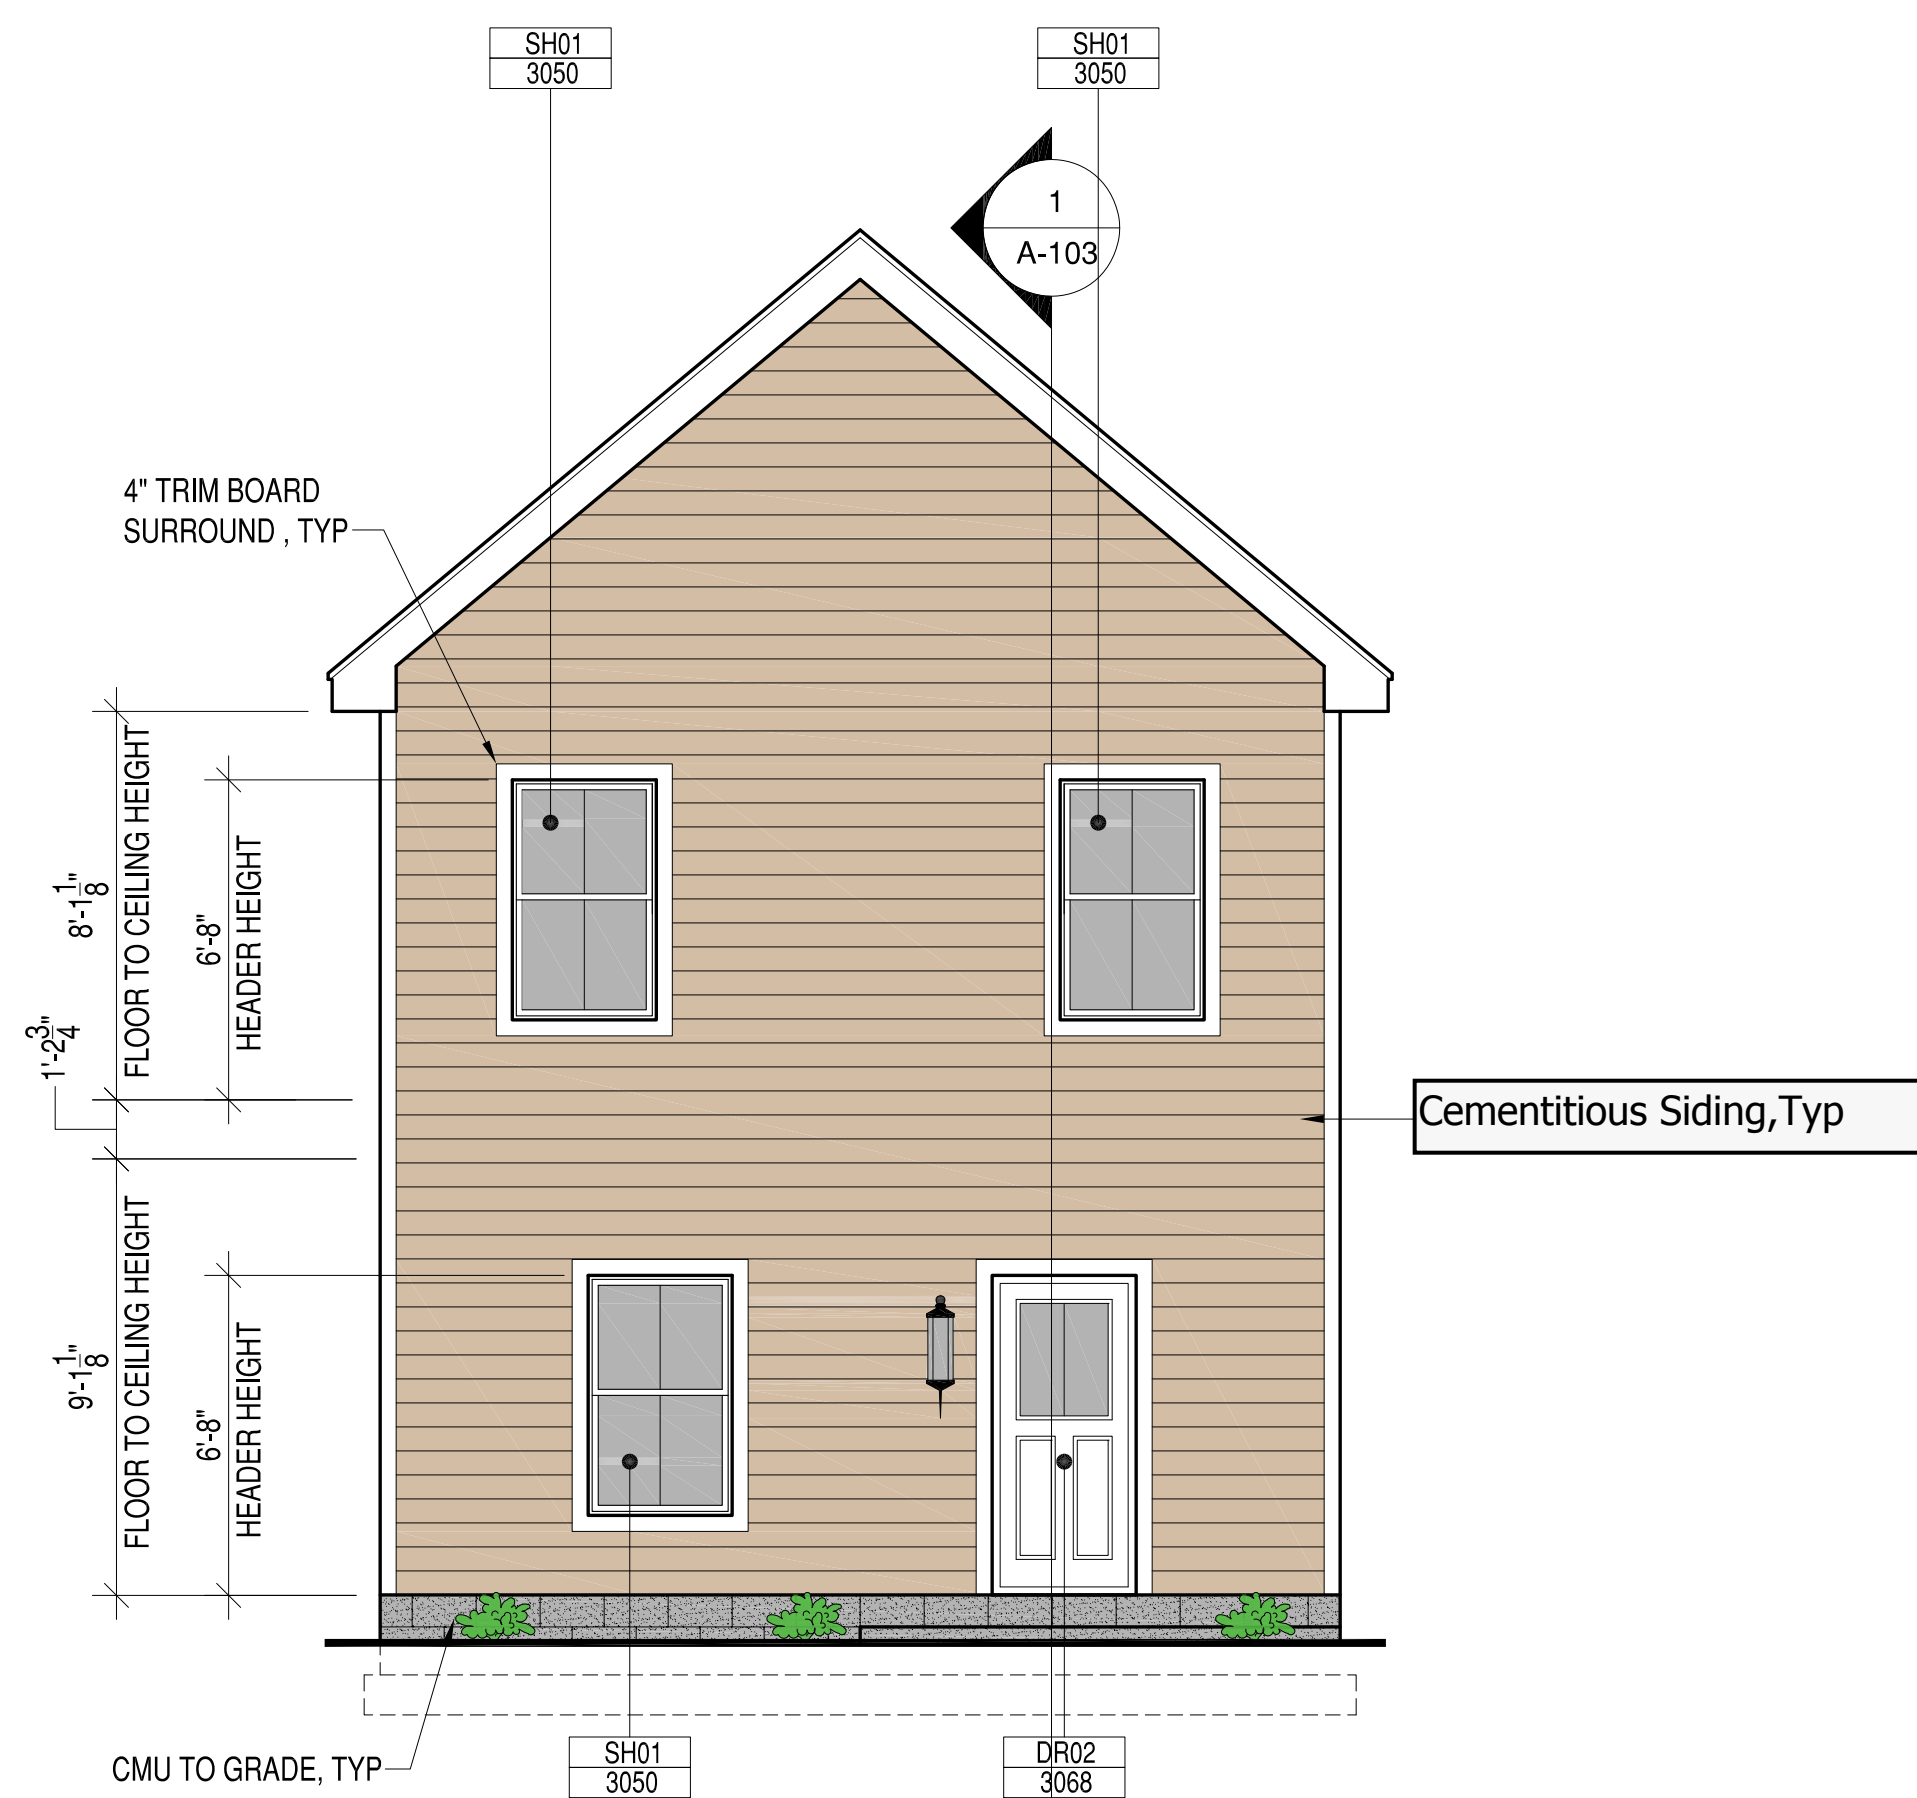

3 REAR ELEVATION
A-201 SCALE: 1/4"=1'-0"

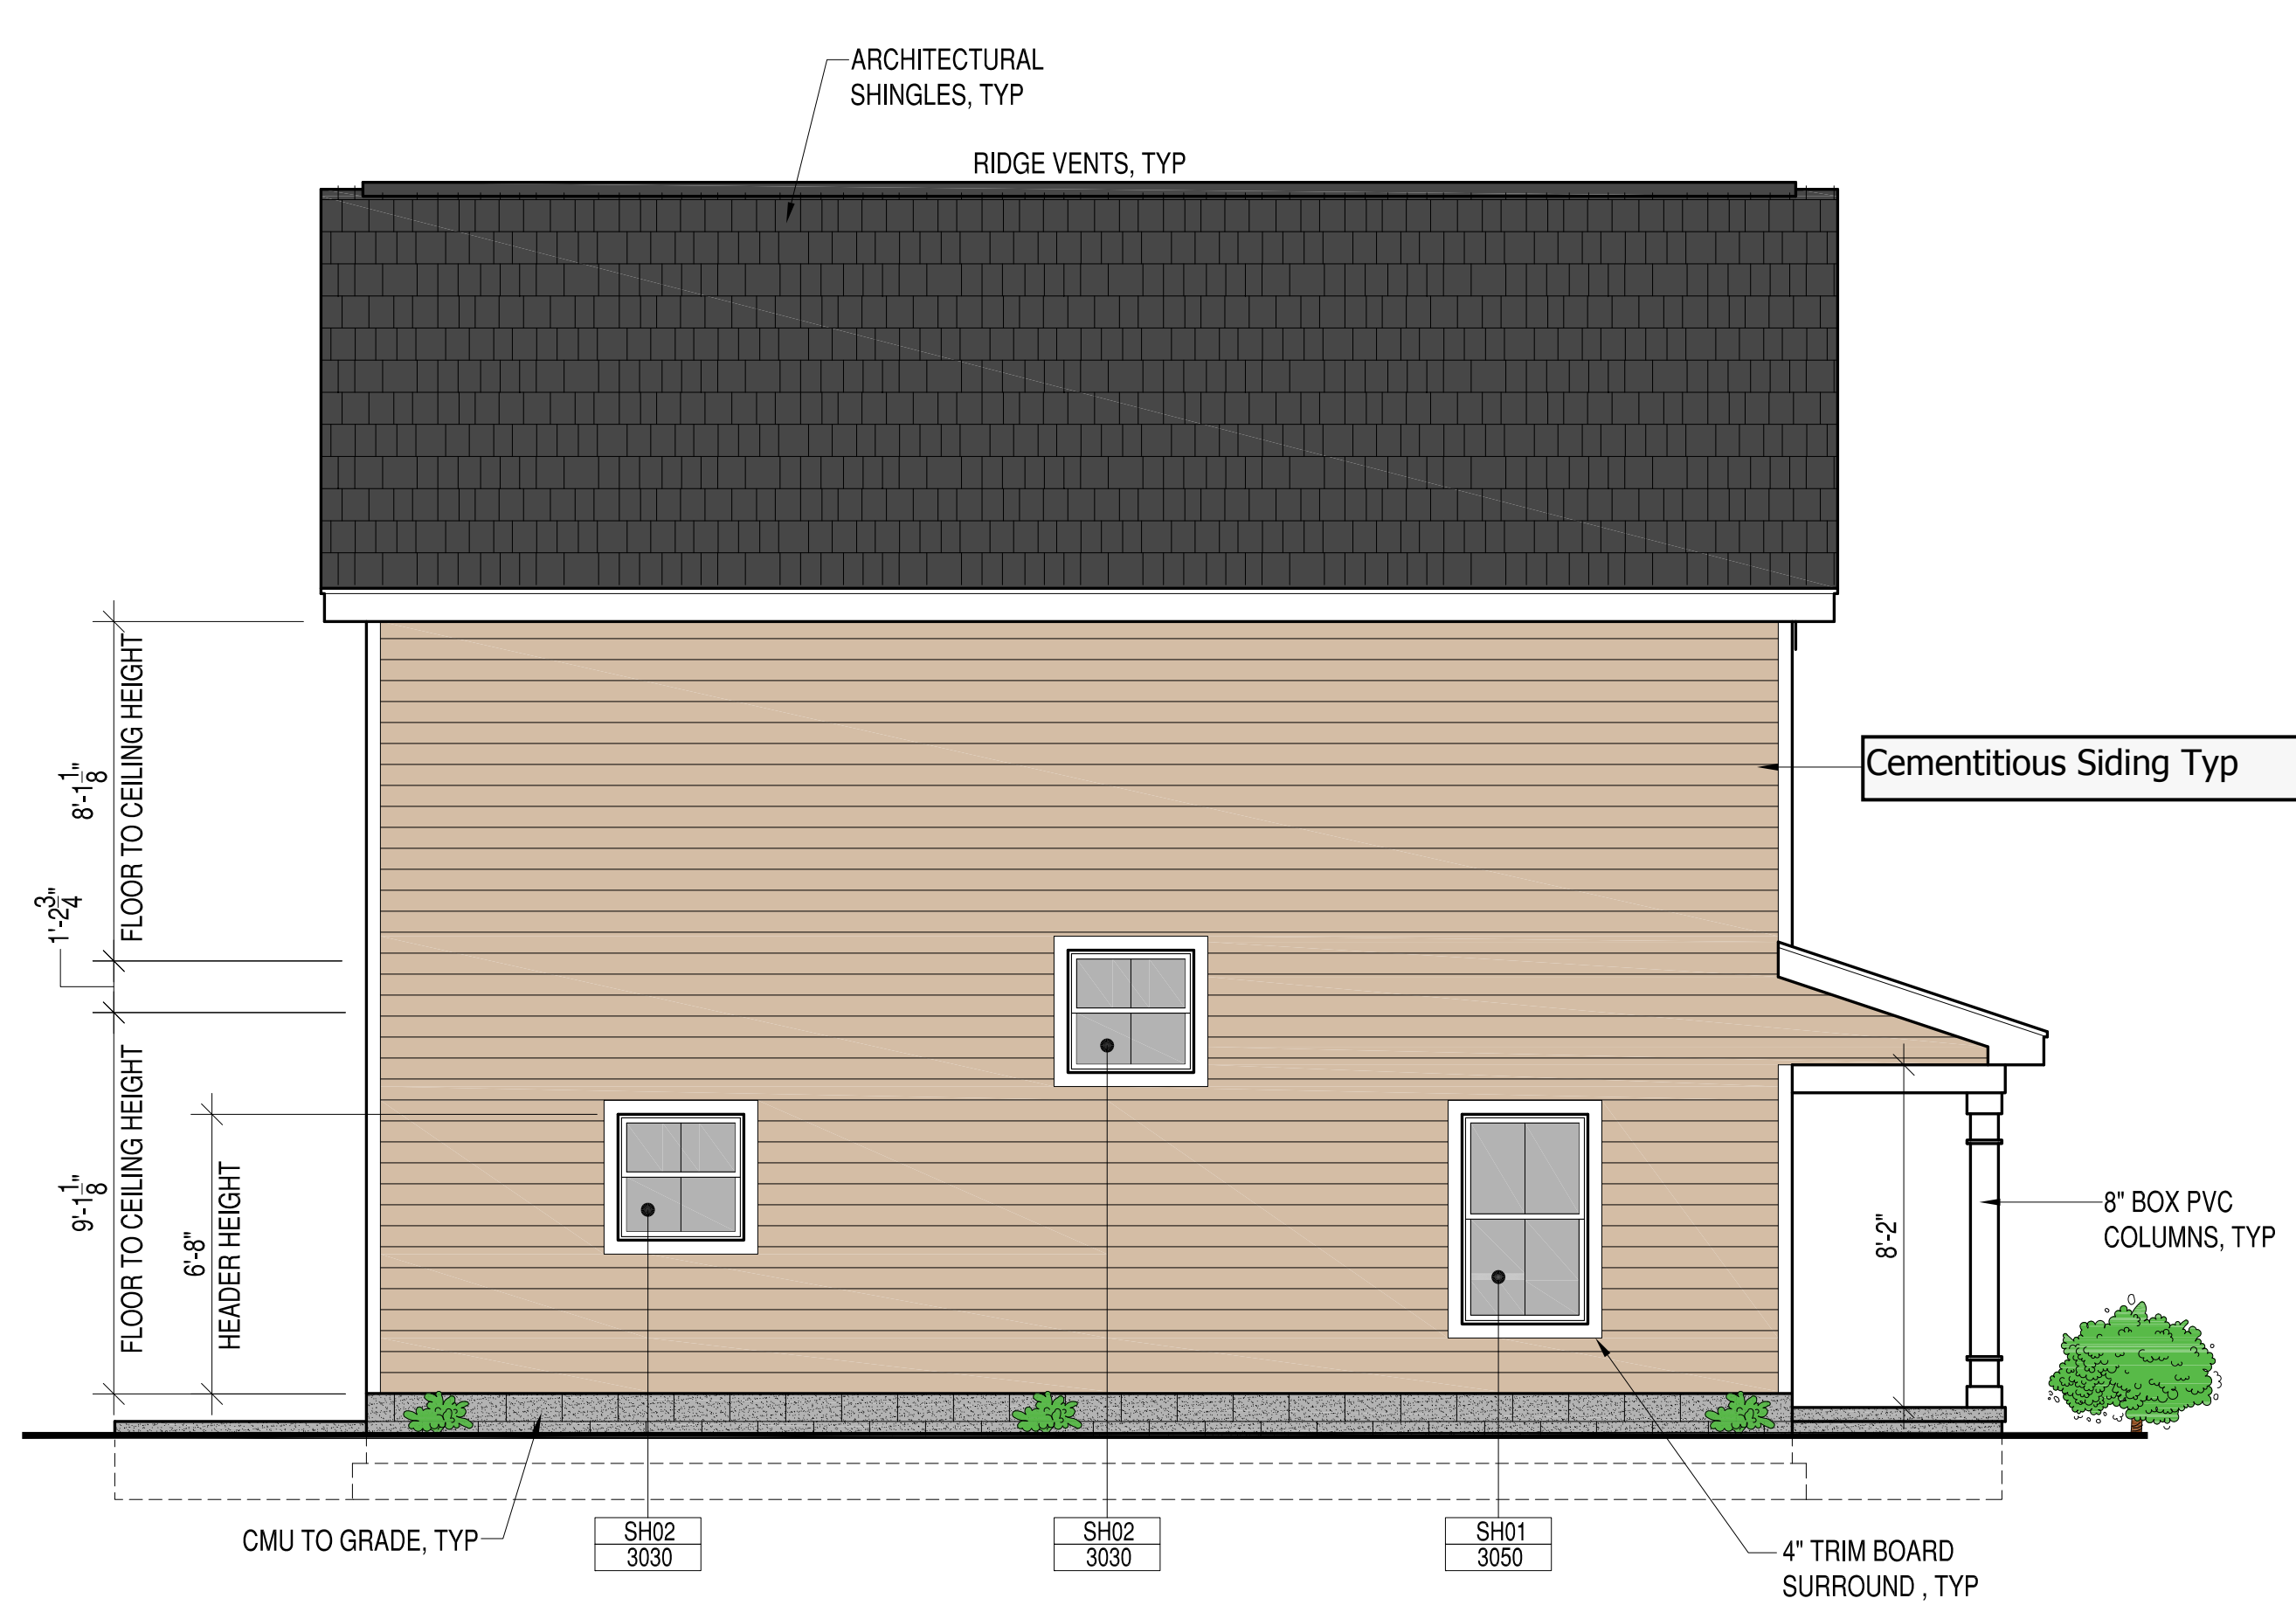

4 RIGHT ELEVATION
A-201 SCALE: 1/4"=1'-0"

EXTERIOR SIDING
FINISH COLORS TO
VARY WITH EACH
HOUSE

NO.	DESCRIPTION	DATE	APPROVED
2	FINAL PERMIT PLANS	10-18-2020	
1	CLIENT REVIEW	10-15-2020	

Project Location:
3917 Corbin St.
RVA 23227



APPROVED	
ACTIVITY	
SATISFACTORY TO DATE	
DES	DRW JRP3 CHK JRP3

NEW SINGLE FAMILY RESIDENCE
FRONT, REAR, RIGHT AND LEFT ELEVATIONS

SCALE: 1/4"=1'-0"
PROJECT NO: 2019-01
CONSTR. CONTR. NO.
DRAWING NO.
SHEET OF
A-201

GENERAL NOTES

- 1. DESIGN BUILD CODE: 2015 VIRGINIA RESIDENTIAL BUILDING CODE
2. THE CONTRACTOR SHALL COORDINATE ALL DIMENSIONS AND ELEVATIONS SHOWN ON THESE DRAWINGS WITH ARCHITECTURAL AND OTHER TRADES DRAWINGS.
3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING TEMPORARY BRACING AND SHORING.
4. DESIGN LOADS: LIVE LOADS, DEAD LOADS, WIND

SITE WORK

- 1. SUBGRADE DESIGN VALUES: THE FOLLOWING SUBSURFACE INFORMATION IS ASSUMED FOR DESIGN PURPOSES.
2. BOTTOM OF ALL EXTERIOR FOOTINGS SHALL BE MINIMUM OF 1'-6" BELOW GRADE.
3. ALL FOOTINGS SHALL PROJECT AT LEAST 1'-0" INTO UNDISTURBED NATURAL SOIL OR COMPACTED STRUCTURAL FILL.

CAST-IN-PLACE CONCRETE

- 1. ALL CONCRETE WORK SHALL BE IN ACCORDANCE WITH ACI 301, ACI 318 AND ACI 302, EDITIONS REFERENCED BY BUILDING CODE.
2. REINFORCING STEEL SHALL BE DEFORMED BILLET STEEL CONFORMING TO ASTM A615 GRADE 60.
3. REINFORCEMENT SPLICES SHALL BE LAP SPLICES WITH A MINIMUM LAP OF 40 BAR DIAMETERS UNLESS NOTED OTHERWISE.

WOOD

- 1. ALL FOLLOWING DESIGN VALUES ARE IN ACCORDANCE WITH THE NATIONAL DESIGN SPECIFICATIONS (NDS) AND SUPPLEMENT NATIONAL DESIGN SPECIFICATIONS (EDITION REFERENCED BY BUILDING CODE.)
2. ALL HEADERS AND BEAMS SHALL BE SPF NO. 2 OR OTHER SPECIES HAVING THE FOLLOWING MINIMUM PROPERTIES: UNLESS NOTED OTHERWISE
3. EXTERIOR AND INTERIOR BEARING WALL STUDS SHALL BE SPF NO. 2 OR OTHER SPECIES HAVING THE FOLLOWING MINIMUM PROPERTIES: UNLESS NOTED OTHERWISE

- 6. LVL (LAMINATED VENEER LUMBER) SHALL BE 1-3/4" WIDE, OF THE DEPTH SPECIFIED ON THE PLANS, AND SHALL BE SECURED TOGETHER AS DIRECTED BY THE MANUFACTURER UNO.
7. ALL LUMBER SHALL BE SOUND, SEASONED, AND FREE FROM WARP.
8. ALL STUDS SHALL BE INSTALLED IN ACCORDANCE WITH AF & PA (AMERICAN FOREST & PAPER ASSOCIATION) REQUIREMENTS.
9. STUD BEARING WALLS AND EXTERIOR STUD WALLS SHALL BE CONTINUOUSLY BRIDGED WITH WOOD BLOCKING AT MIDSPAN VERTICAL SPACING BETWEEN FLOORS (AND ROOF) LEVELS.

CONCRETE MASONRY

- 1. HOLLOW LOAD BEARING UNITS SHALL CONFORM TO ASTM C90, NORMAL WEIGHT, TYPE 1, GRADE N WITH A MINIMUM 28 DAY NET COMPRESSIVE UNIT STRENGTH OF 1900 PSI.
2. MORTAR SHALL BE TYPE M BELOW GRADE AND IN CONTACT WITH SOIL AND TYPE S AT ALL OTHER LOCATIONS.
3. FILLED CELLS SHALL BE FILLED WITH COARSE GROUT. COARSE GROUT SHALL CONFORM TO ASTM C476, PROPERTIES SHALL INCLUDE: 2500 PSI AT 28 DAY, 3/8" MAX. AGGREGATE, AND 8"-11" SLUMP.

MASONRY

- 1. ALL MASONRY SHALL CONFORM TO BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES" (ACI 530/ASCE 5/TMS 402) AND "SPECIFICATIONS FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 6/TMS 602) FOR THE YEAR REFERENCED IN THE BUILDING CODE NOTED.
2. ALL BRICK AND CONCRETE MASONRY AND CONSTRUCTION SHALL COMPLY WITH THE RECOMMENDATIONS OF BRICK INSTITUTE OF AMERICA (BIA) AND THE NATIONAL CONCRETE MASONRY ASSOCIATION (NCMA) AND MINIMUM REQUIREMENTS ESTABLISHED BY NOTED BUILDING CODES.
3. GROUT TO FILL CORES SHALL BE ASTM C476, COARSE GROUT (3/8" MAXIMUM AGGREGATE) WITH A MINIMUM COMPRESSIVE STRENGTH OF 2500 PSI IN 28 DAYS.

Project Location:

3917 Corbin St. RVA 23227



NEW SINGLE FAMILY RESIDENCE

STRUCTURAL GENERAL NOTES


SCALE: 1/4"=1'-0" PROJECT NO.: 2019-01 CONSTR. CONTR. NO.:

DRAWING NO.:


SHEET OF

S-001

Table with columns for DATE, DESCRIPTION, and APPROVAL. Includes entries for FINAL PERMIT PLANS (10-18-2020) and CLIENT REVIEW (10-15-2020).

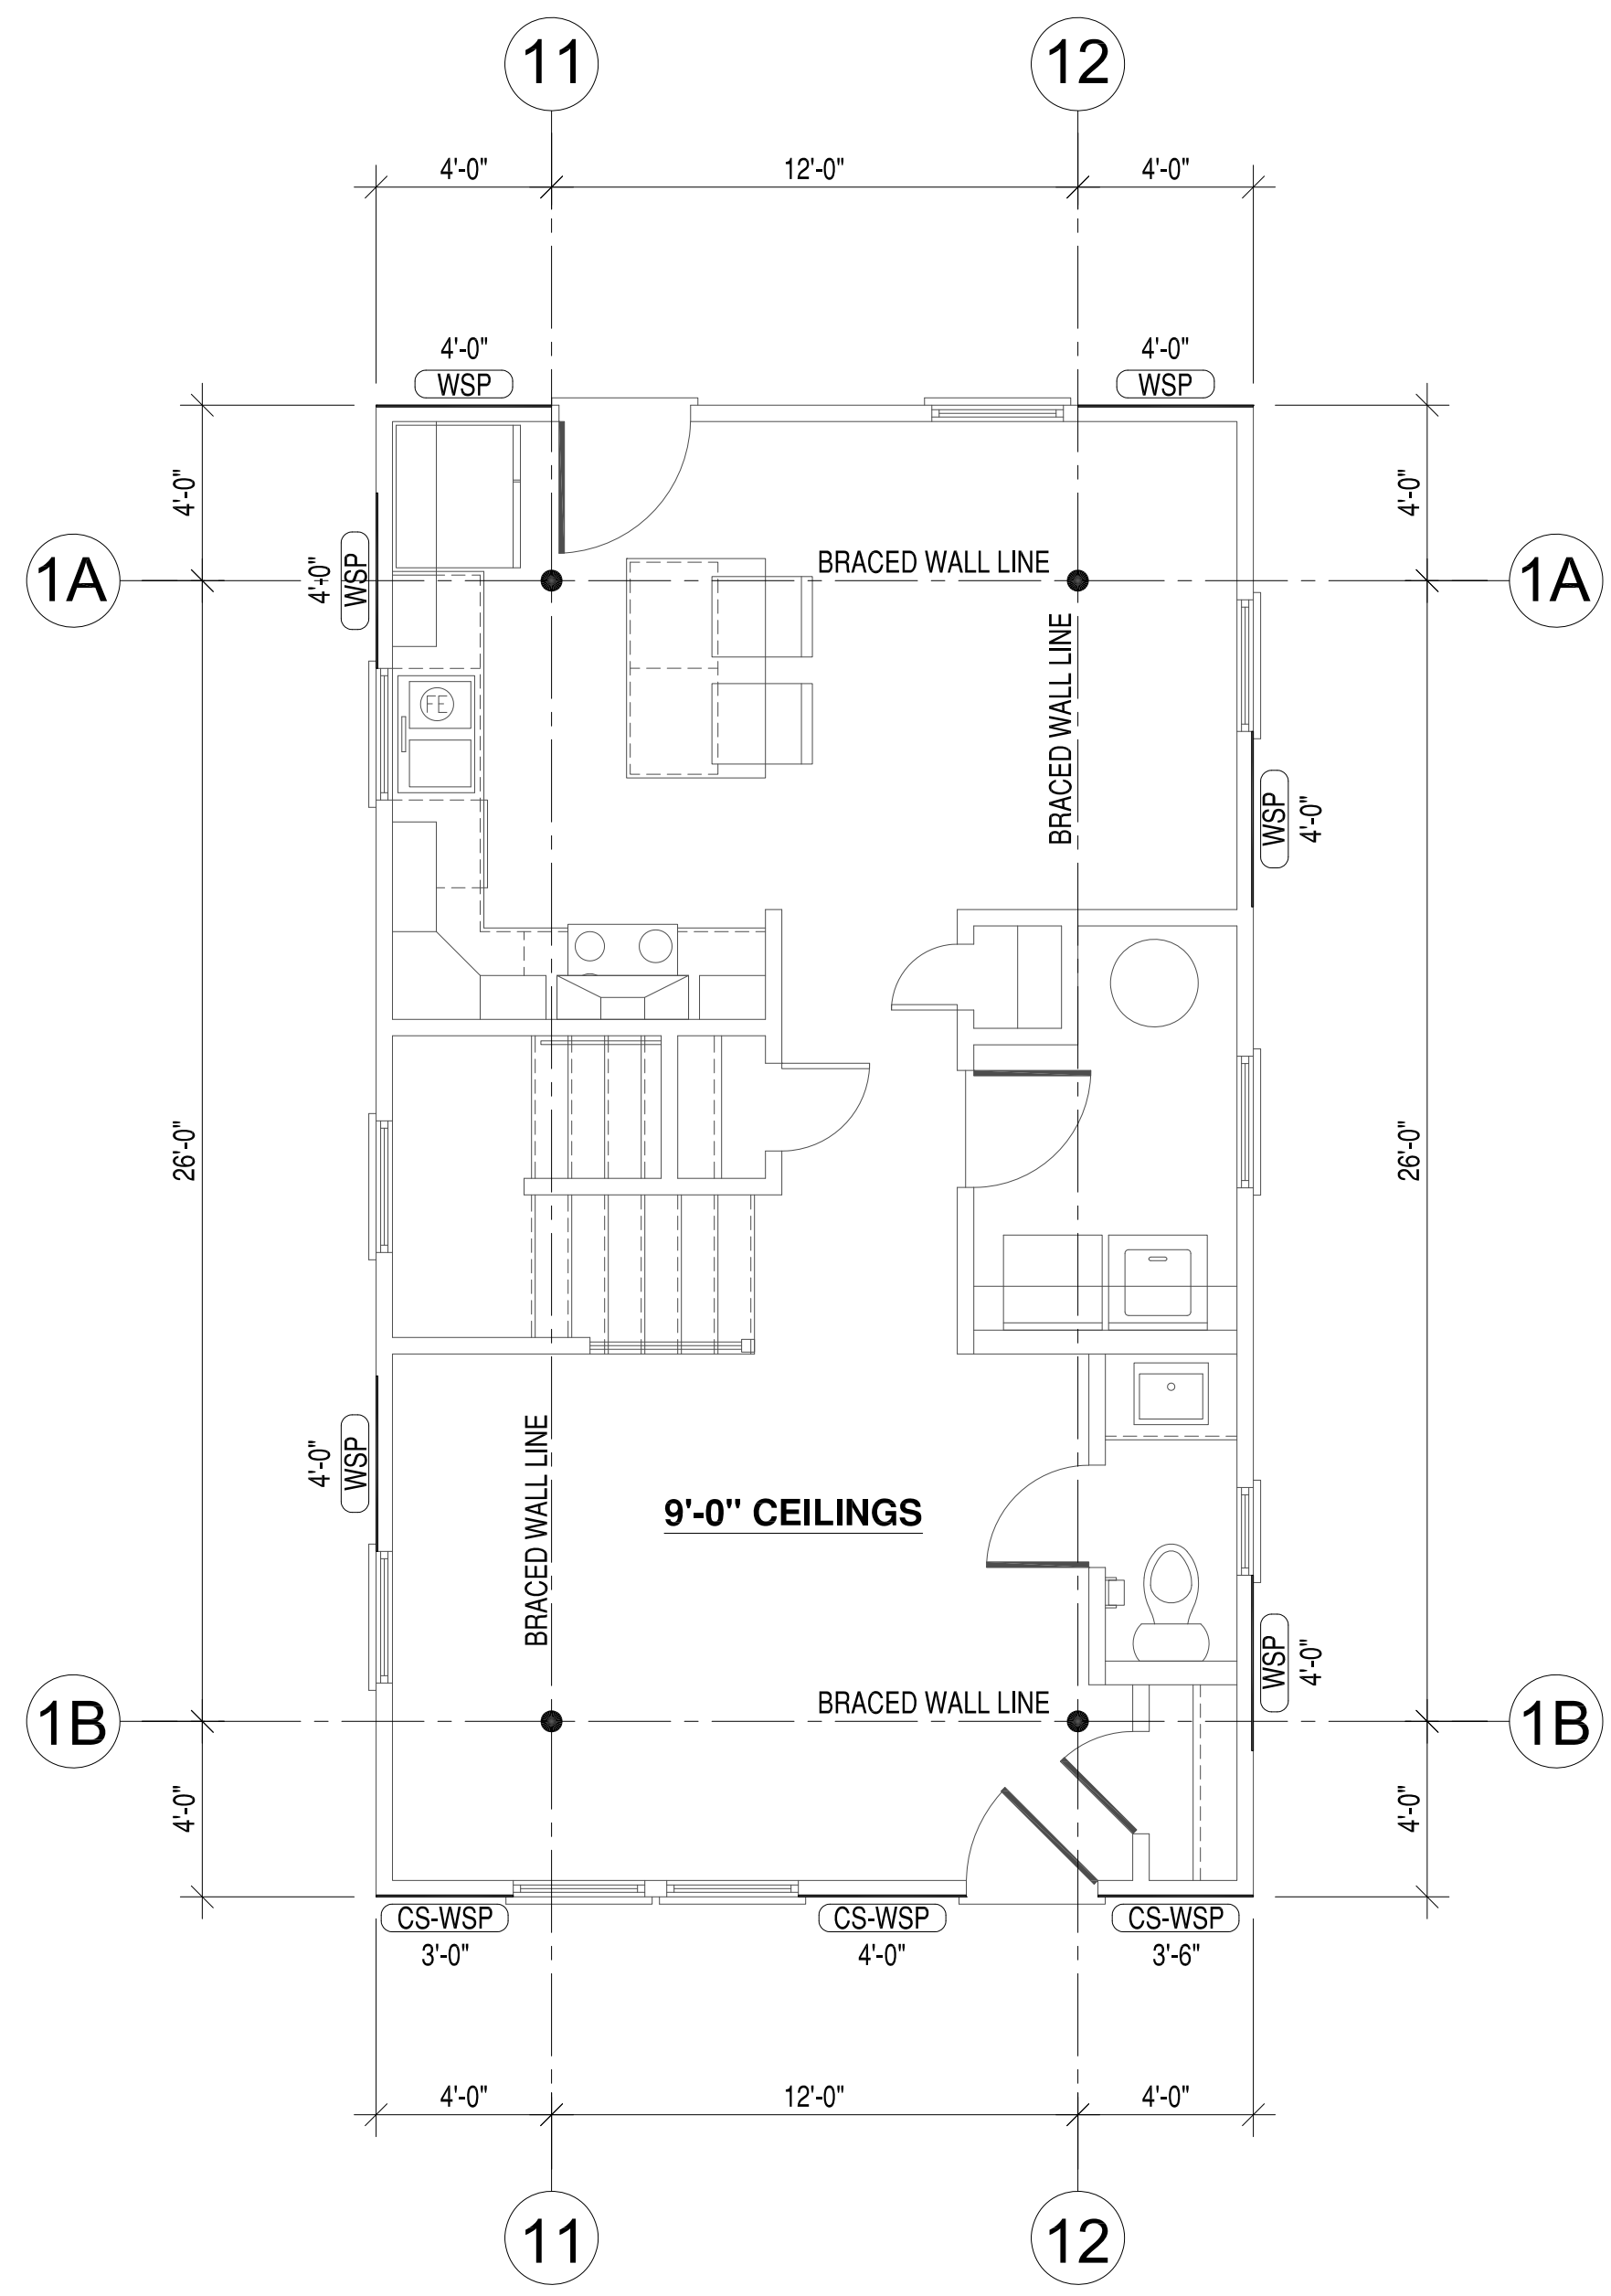

FIRST FLOOR BRACED WALL PLAN
SCALE: 1/4"=1'-0"

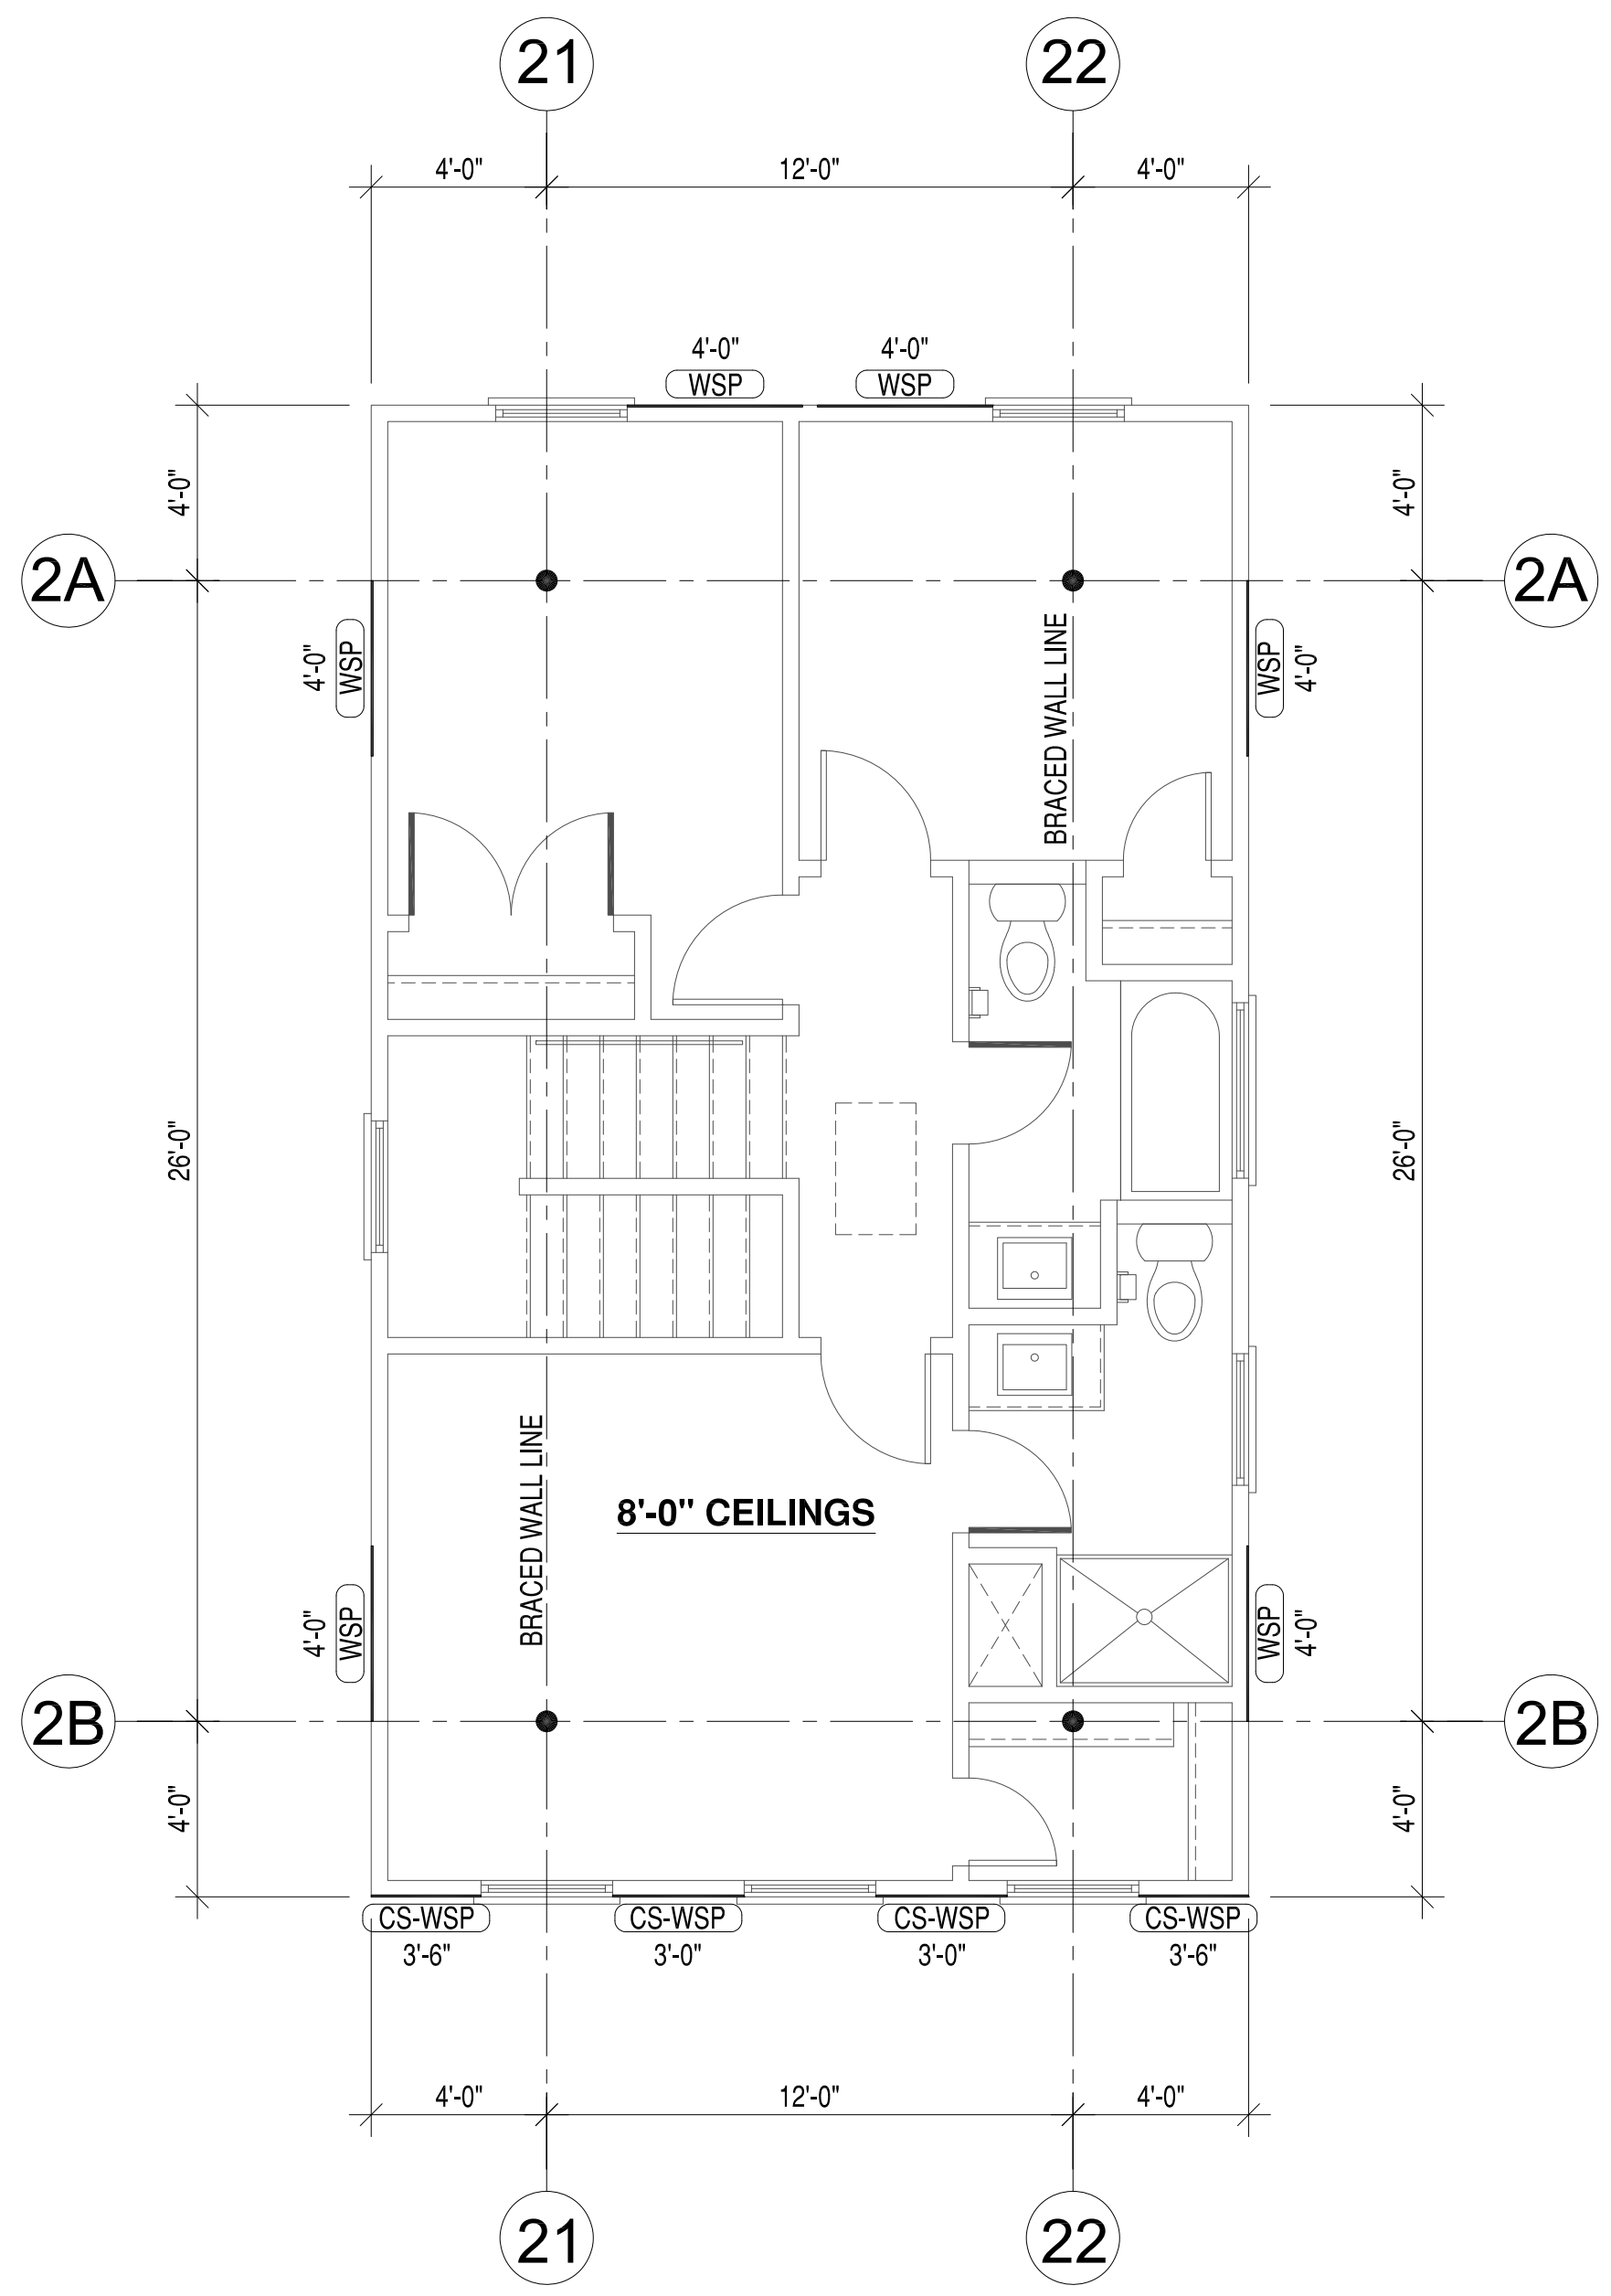

SECOND FLOOR BRACED WALL PLAN
SCALE: 1/4"=1'-0"

- BRACED WALL PLAN NOTES:**
1. DESIGN AND CALCULATIONS BASED ON 2015 IRC SECTION R602.10.
 2. DESIGN BASED ON 90 MPH WIND SPEED, SEE CALCULATIONS.
 3. CLASSIC WALL BRACING METHOD USED.
 4. ——— DENOTES BRACED WALL PANELS.
 5. BLOCK HORIZONTAL SHEATHING JOINTS AT ALL BRACED WALL LINES AT FIRST FLOOR AND BRACED WALL LINES 2A AND 2B AT SECOND FLOOR.

NO.	DATE	DESCRIPTION	APPROVED
2	10-18-2020	FINAL PERMIT PLANS	
1	10-15-2020	CLIENT REVIEW	


Project Location:
3917 Corbin St.
RVA 23227




APPROVED	
ACTIVITY	
SATISFACTORY TO DATE	
DES	DRW JRP3 Chk JRP3

NEW SINGLE FAMILY RESIDENCE
FIRST & SECOND FLOOR BRACED WALL PLAN


SCALE: 1/4"=1'-0"
PROJECT NO.: 2019-01
CONSTR. CONTR. NO.
DRAWING NO.
SHEET OF
S-102

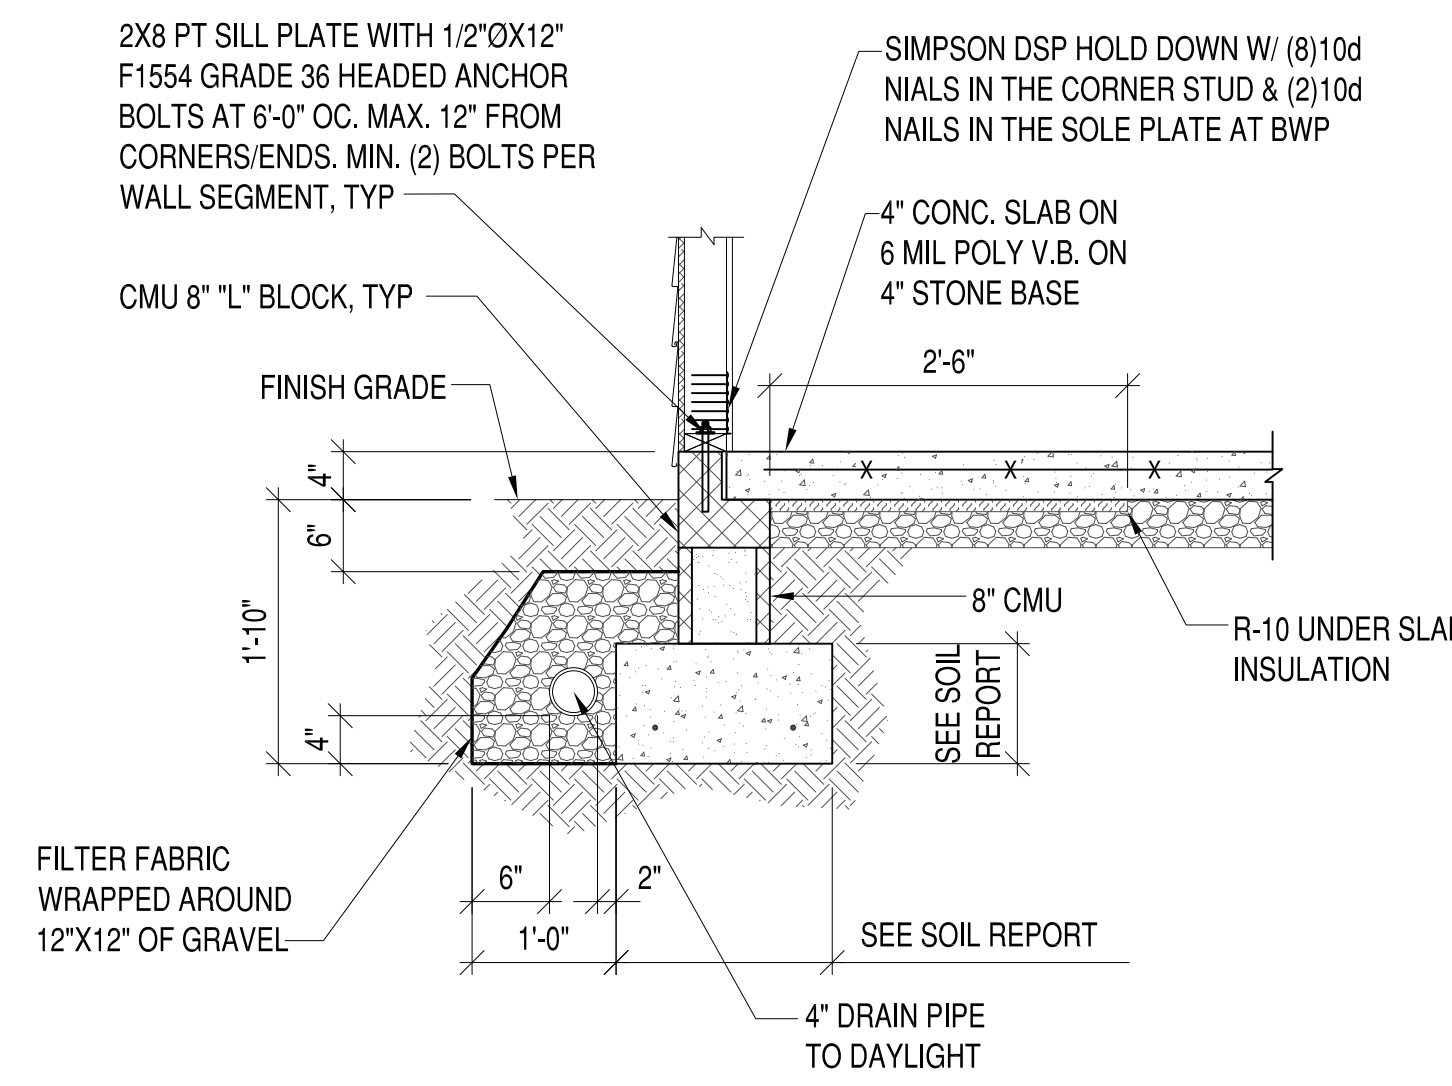


1 TYP. FOUNDATION SECTION
S-201 3/4"=1'-0"

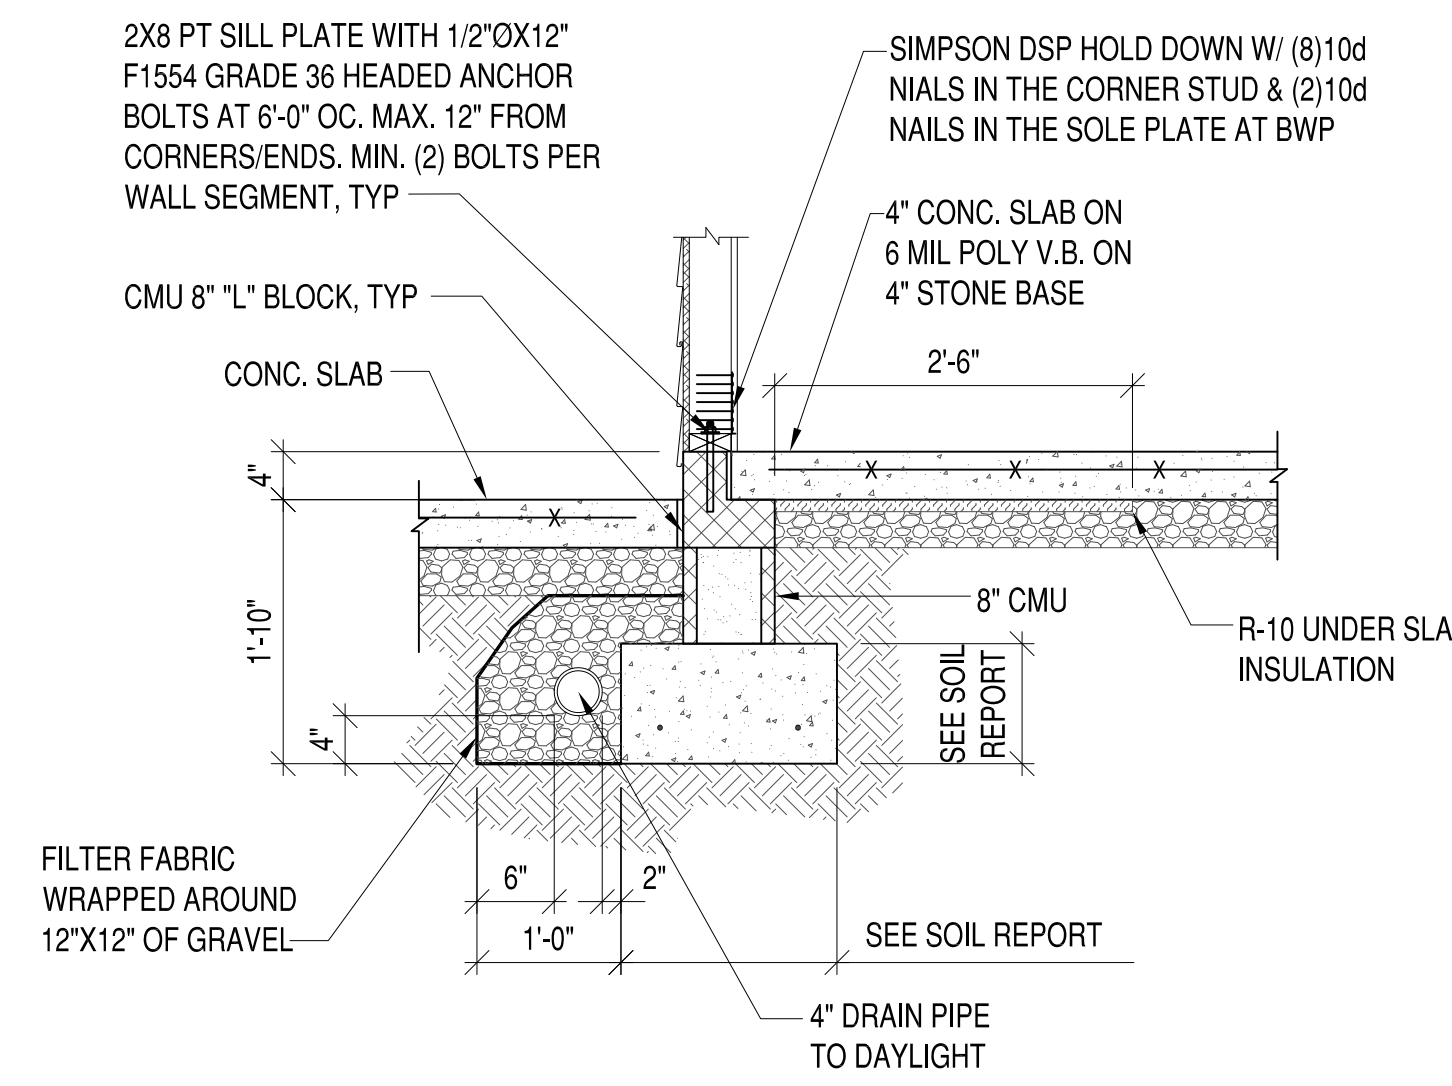


2 FOUNDATION SECTION AT PORCH
S-201 3/4"=1'-0"

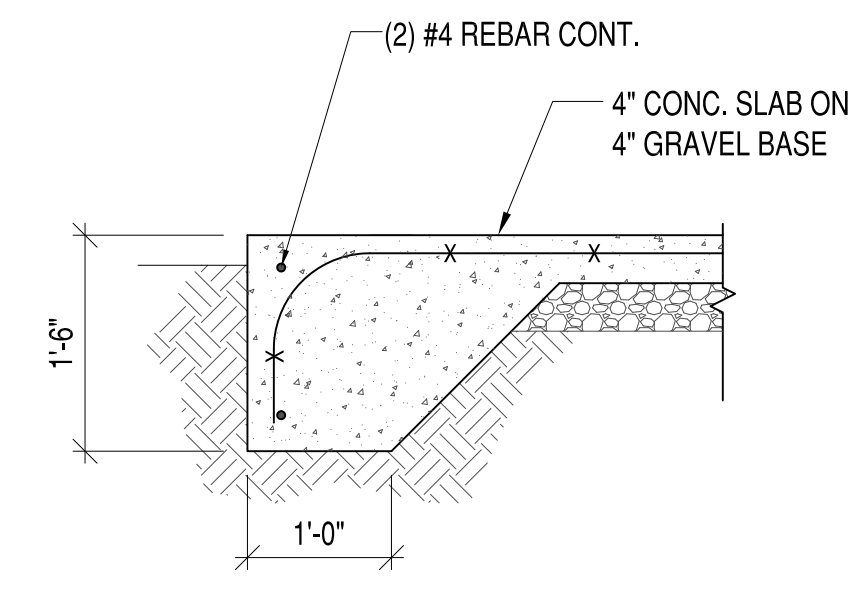


3 FOUNDATION SECTION AT PORCH EDGE
S-201 3/4"=1'-0"

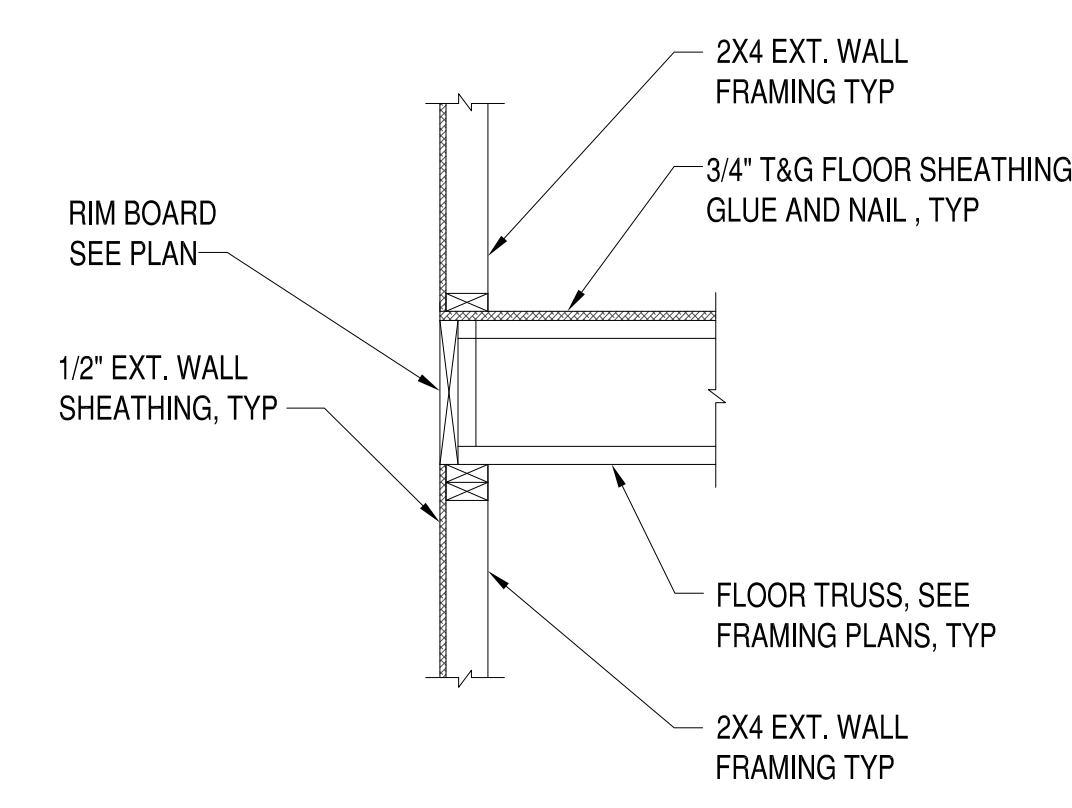


4 SECTION AT 2ND. FLOOR JOIST
S-201 3/4"=1'-0"

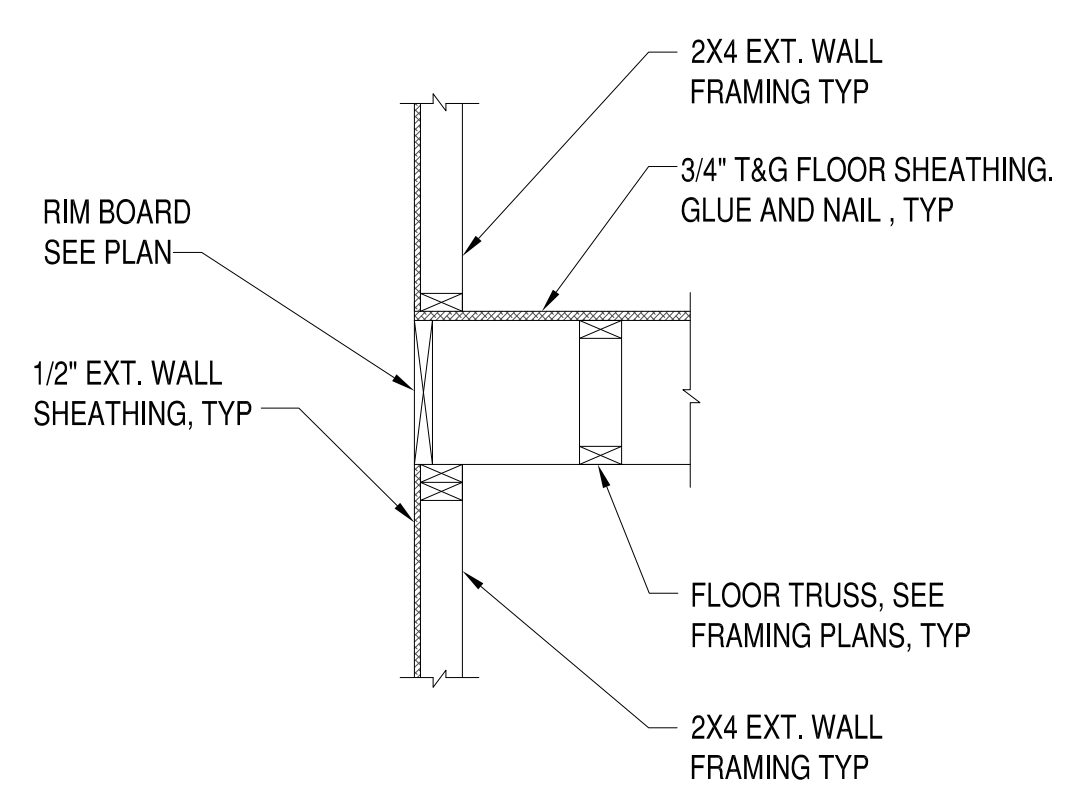

5 SECTION AT 2ND. FLOOR JOIST
S-201 3/4"=1'-0"

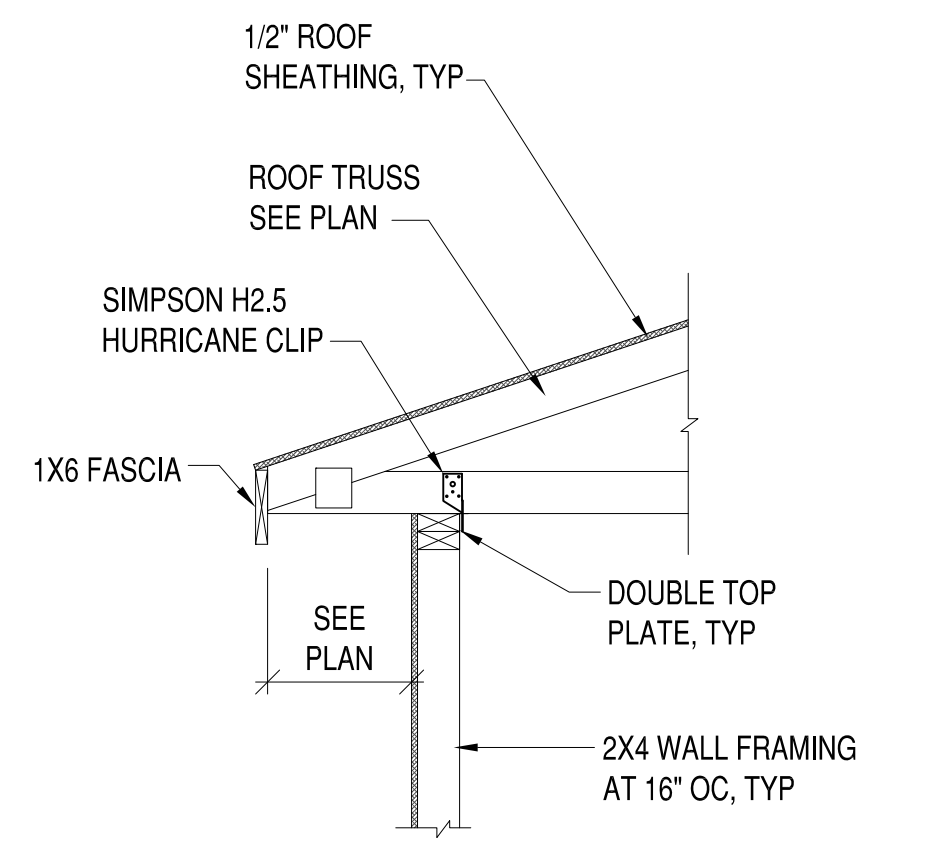

6 SECTION @ ROOF TRUSS
S-201 3/4"=1'-0"

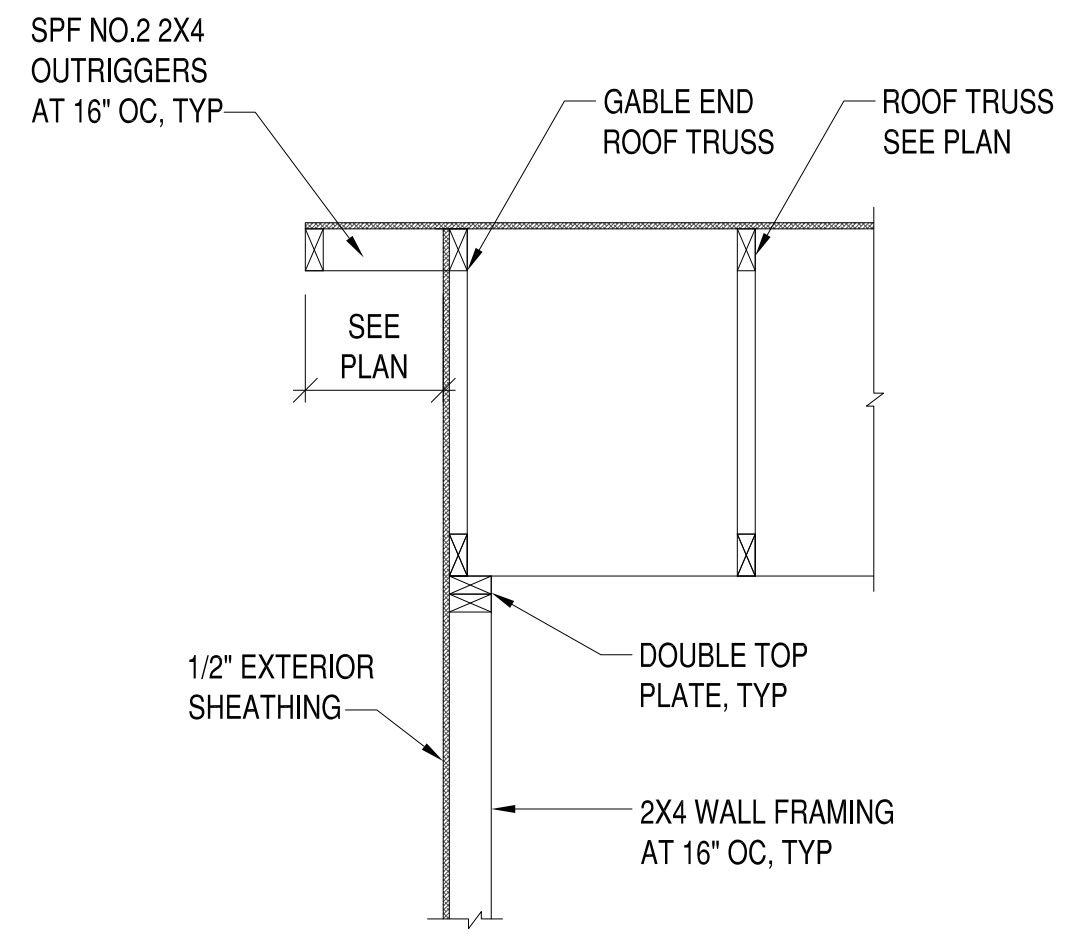

7 SECTION @ ROOF GABLE END
S-201 3/4"=1'-0"

NO.	DESCRIPTION	DATE	APPRO.
2	FINAL PERMIT PLANS	10-18-2020	
1	CLIENT REVIEW	10-15-2020	

Project Location:
3917 Corbin St.
RVA 23227



APPROVED
ACTIVITY
SATISFACTORY TO DATE
DES: [initials] DRW: JRP3 CHK: JRP3

NEW SINGLE FAMILY RESIDENCE
TYPICAL FOUNDATION AND FRAMING SECTIONS

SCALE: 1/4"=1'-0"
PROJECT NO.: 2019-01
CONSTR. CONTR. NO.
DRAWING NO.
SHEET OF
S-201