




OFFICE OF THE MAYOR


Dr. Danny Avula

Update on the City of Richmond's water restoration efforts

Mayor Danny Avula, Jan. 13, 2025





Timeline





OFFICE OF THE MAYOR

Dr. Danny Ayula

Timeline: Monday

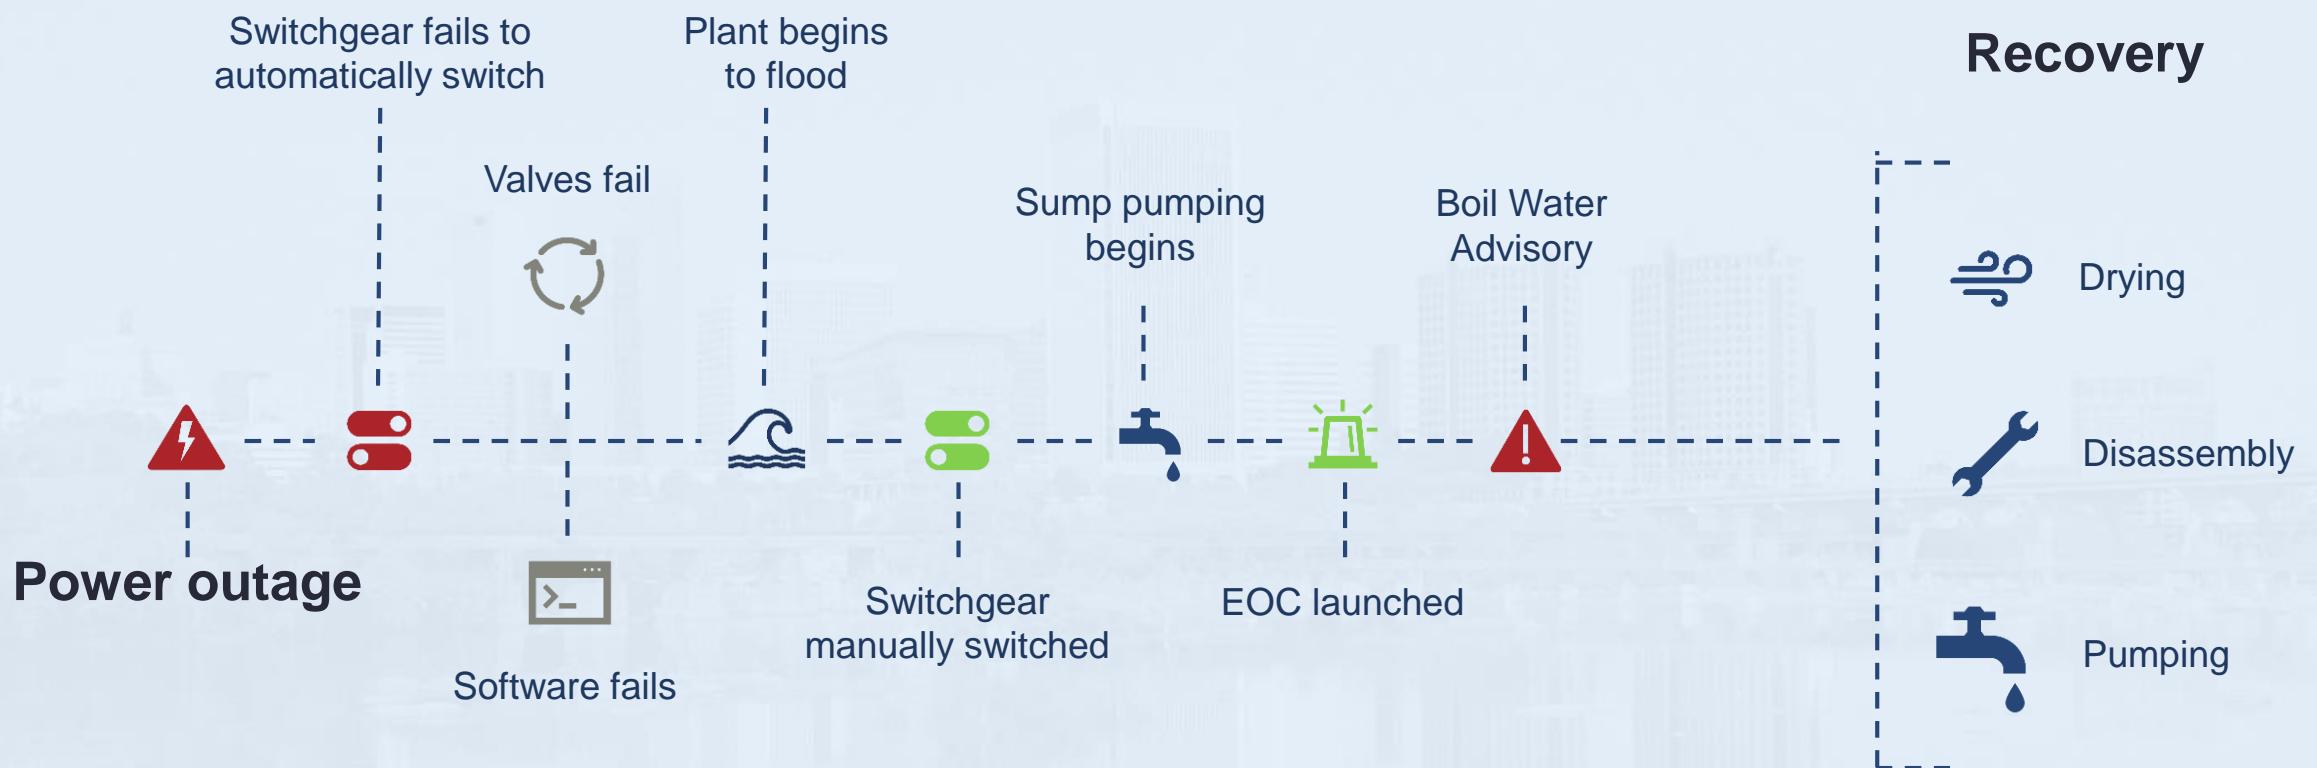

Timeline: Tuesday

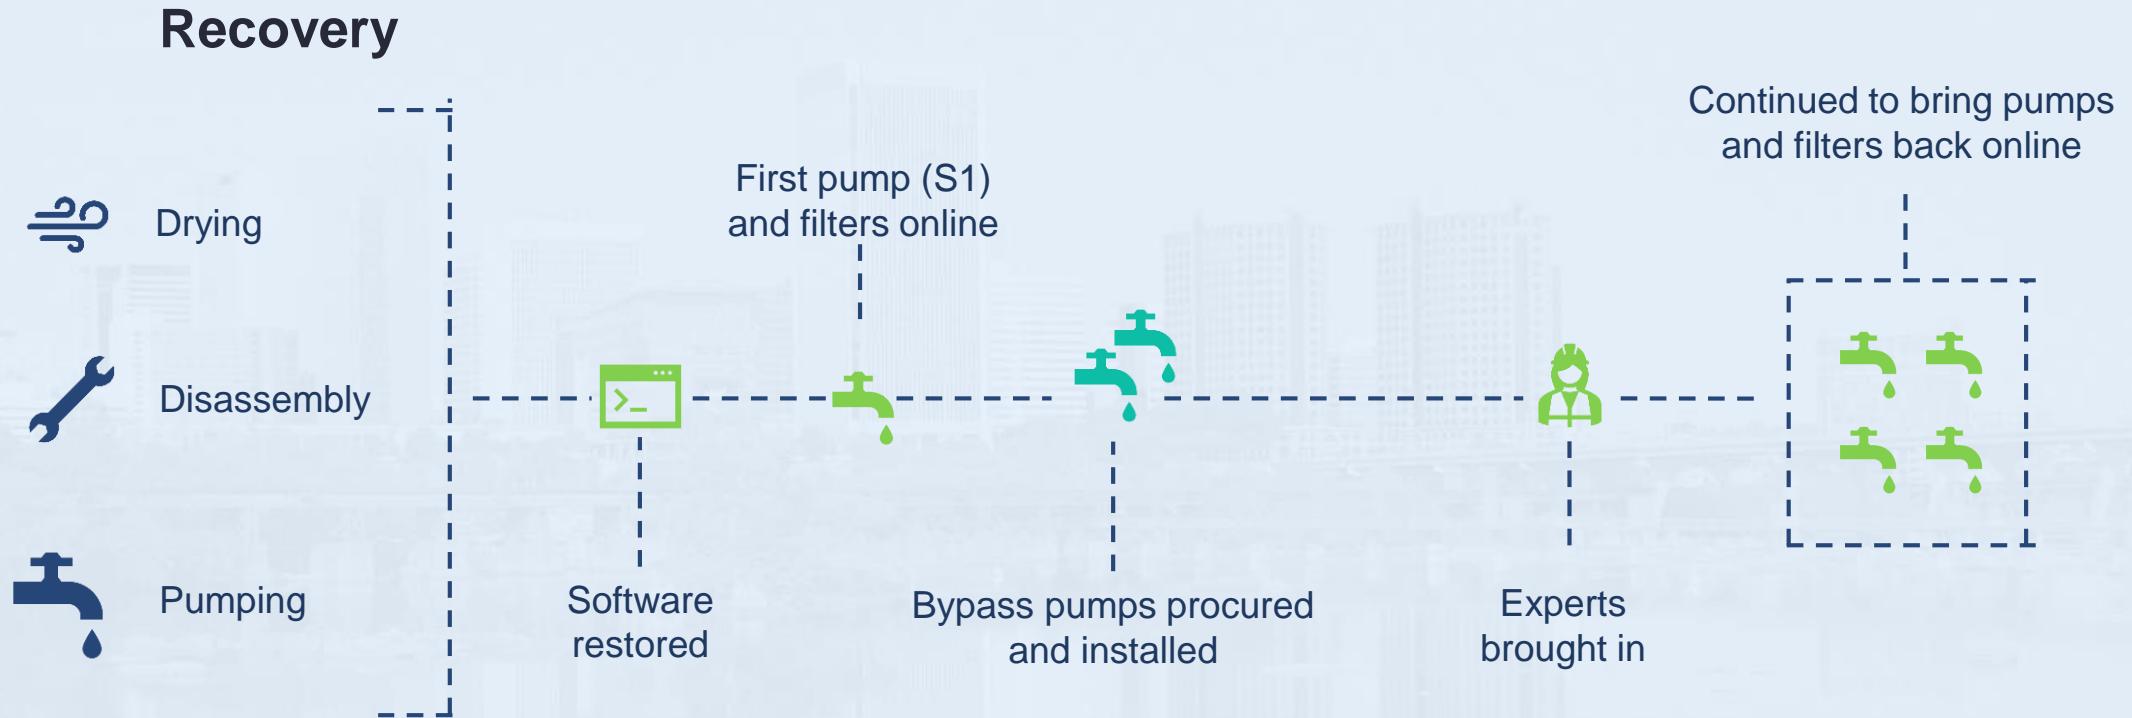

OFFICE OF THE MAYOR
Dr. Danny Ayula

Timeline: Wednesday




Refilling water distribution network begins

1,200 miles of empty pipes

Over a dozen water tanks and reservoir

Continued to bring pumps and filters back online




Timeline: Thursday

Reservoir
continues to fill




Full pressure in the water
system



Testing of the water
system begins

80 million gallons
per day

Typical usage: 40 million
gallons per day




OFFICE OF THE MAYOR
Dr. Danny Ayula


Timeline: Friday



Normal operation of water distribution continues




Testing of the water system continues




Timeline: Saturday

Boil Water Advisory Lifted




Stabilizing



OFFICE OF THE MAYOR

Dr. Danny Ayula


Resiliency



OFFICE OF THE MAYOR

Dr. Danny Ayula

Lessons learned



OFFICE OF THE MAYOR

Dr. Danny Ayula



OFFICE OF THE MAYOR

Dr. Danny Avula